

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.


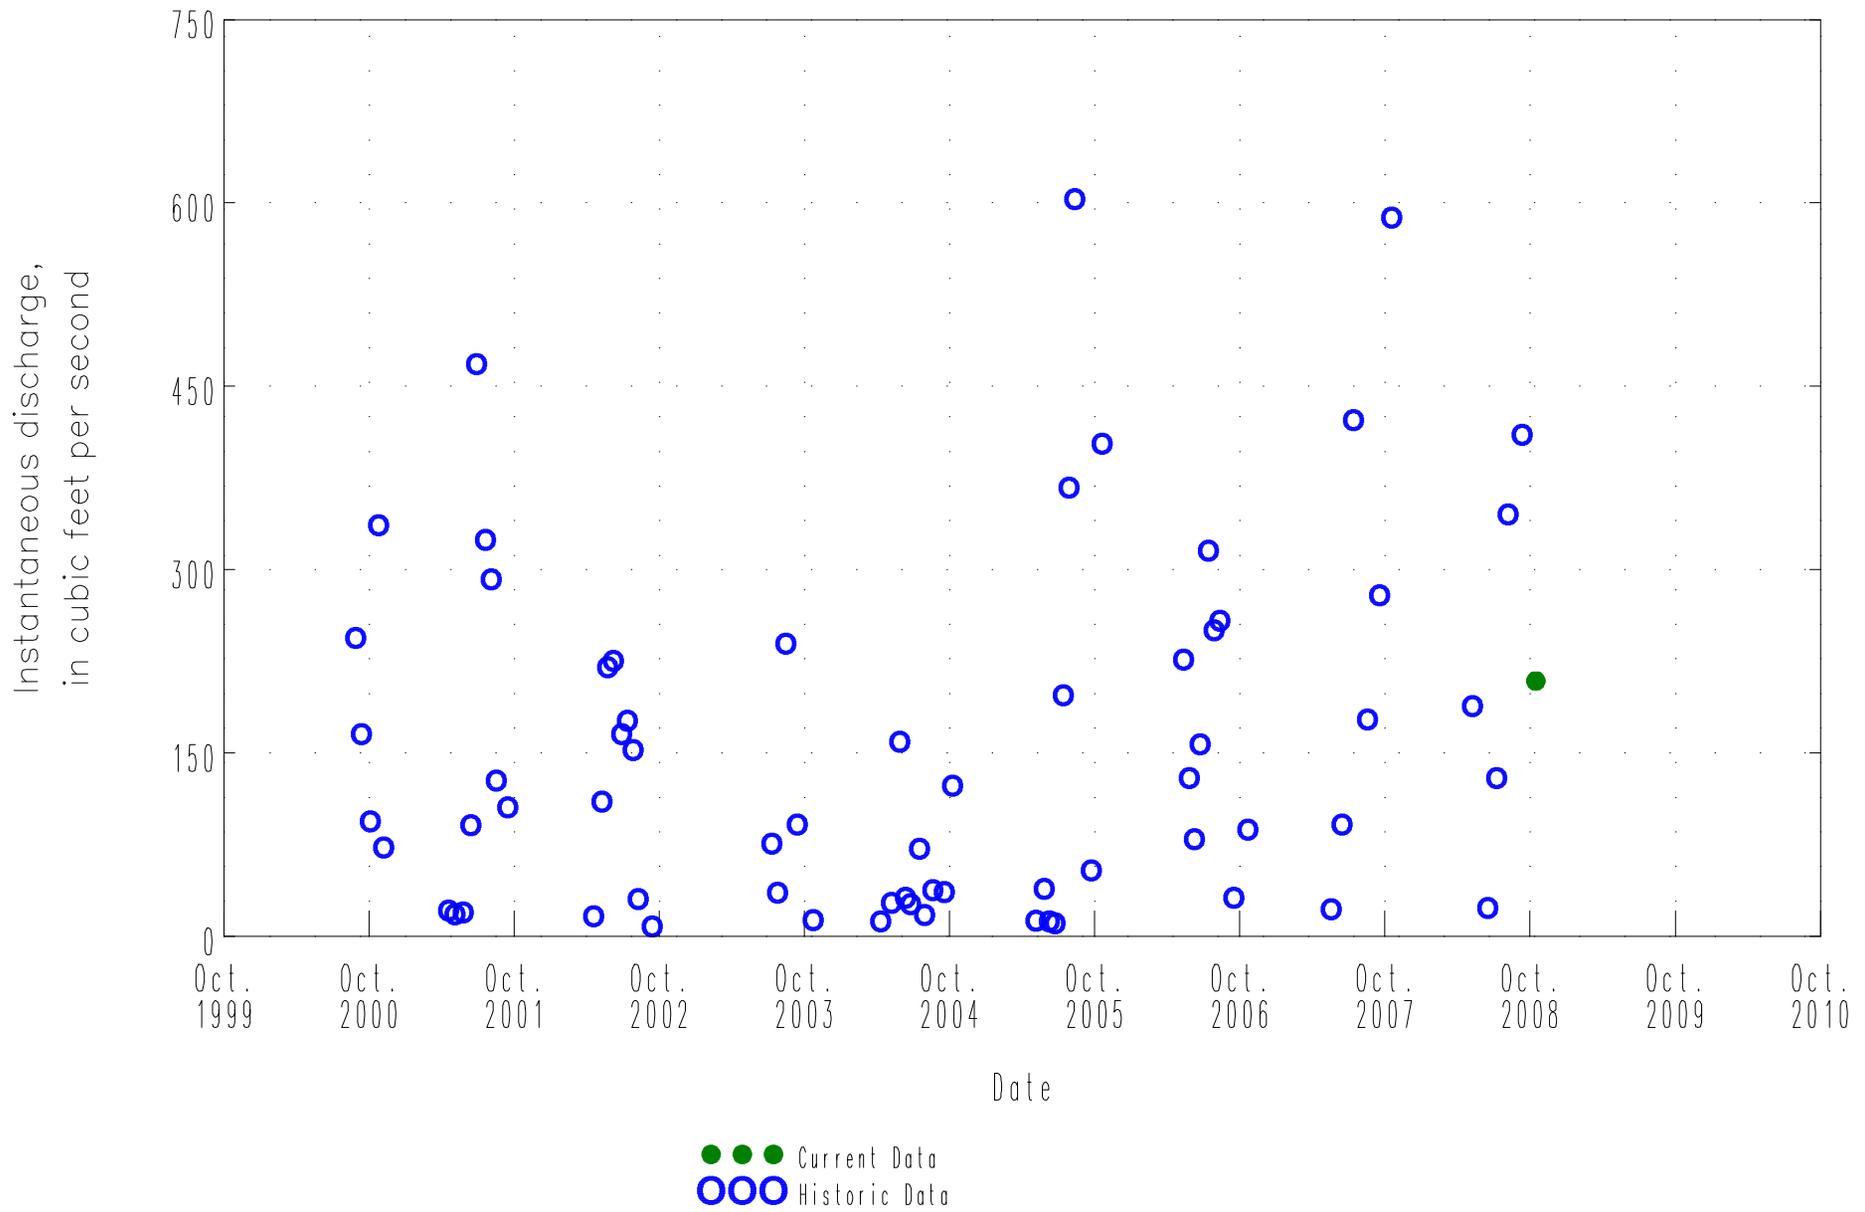


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

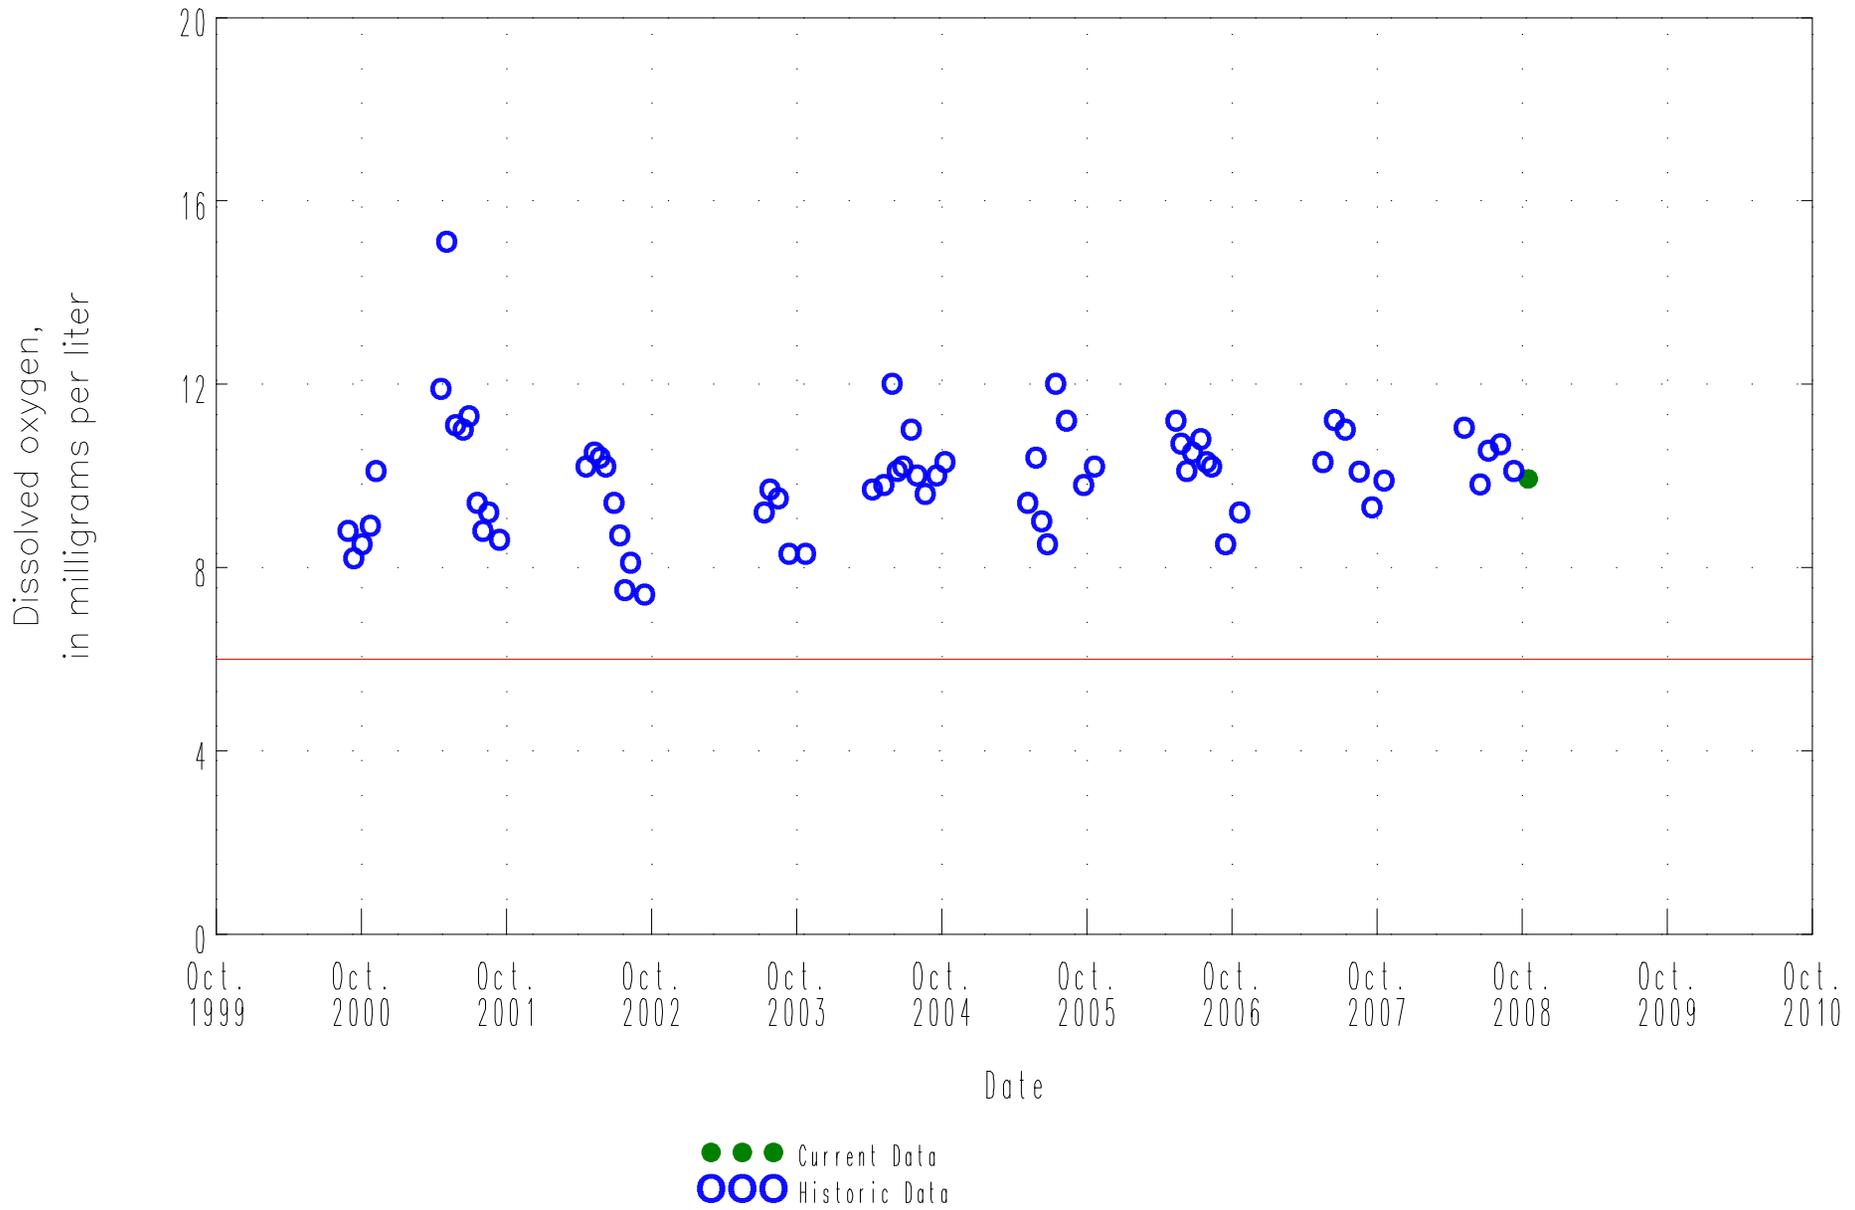

Standard 6

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.


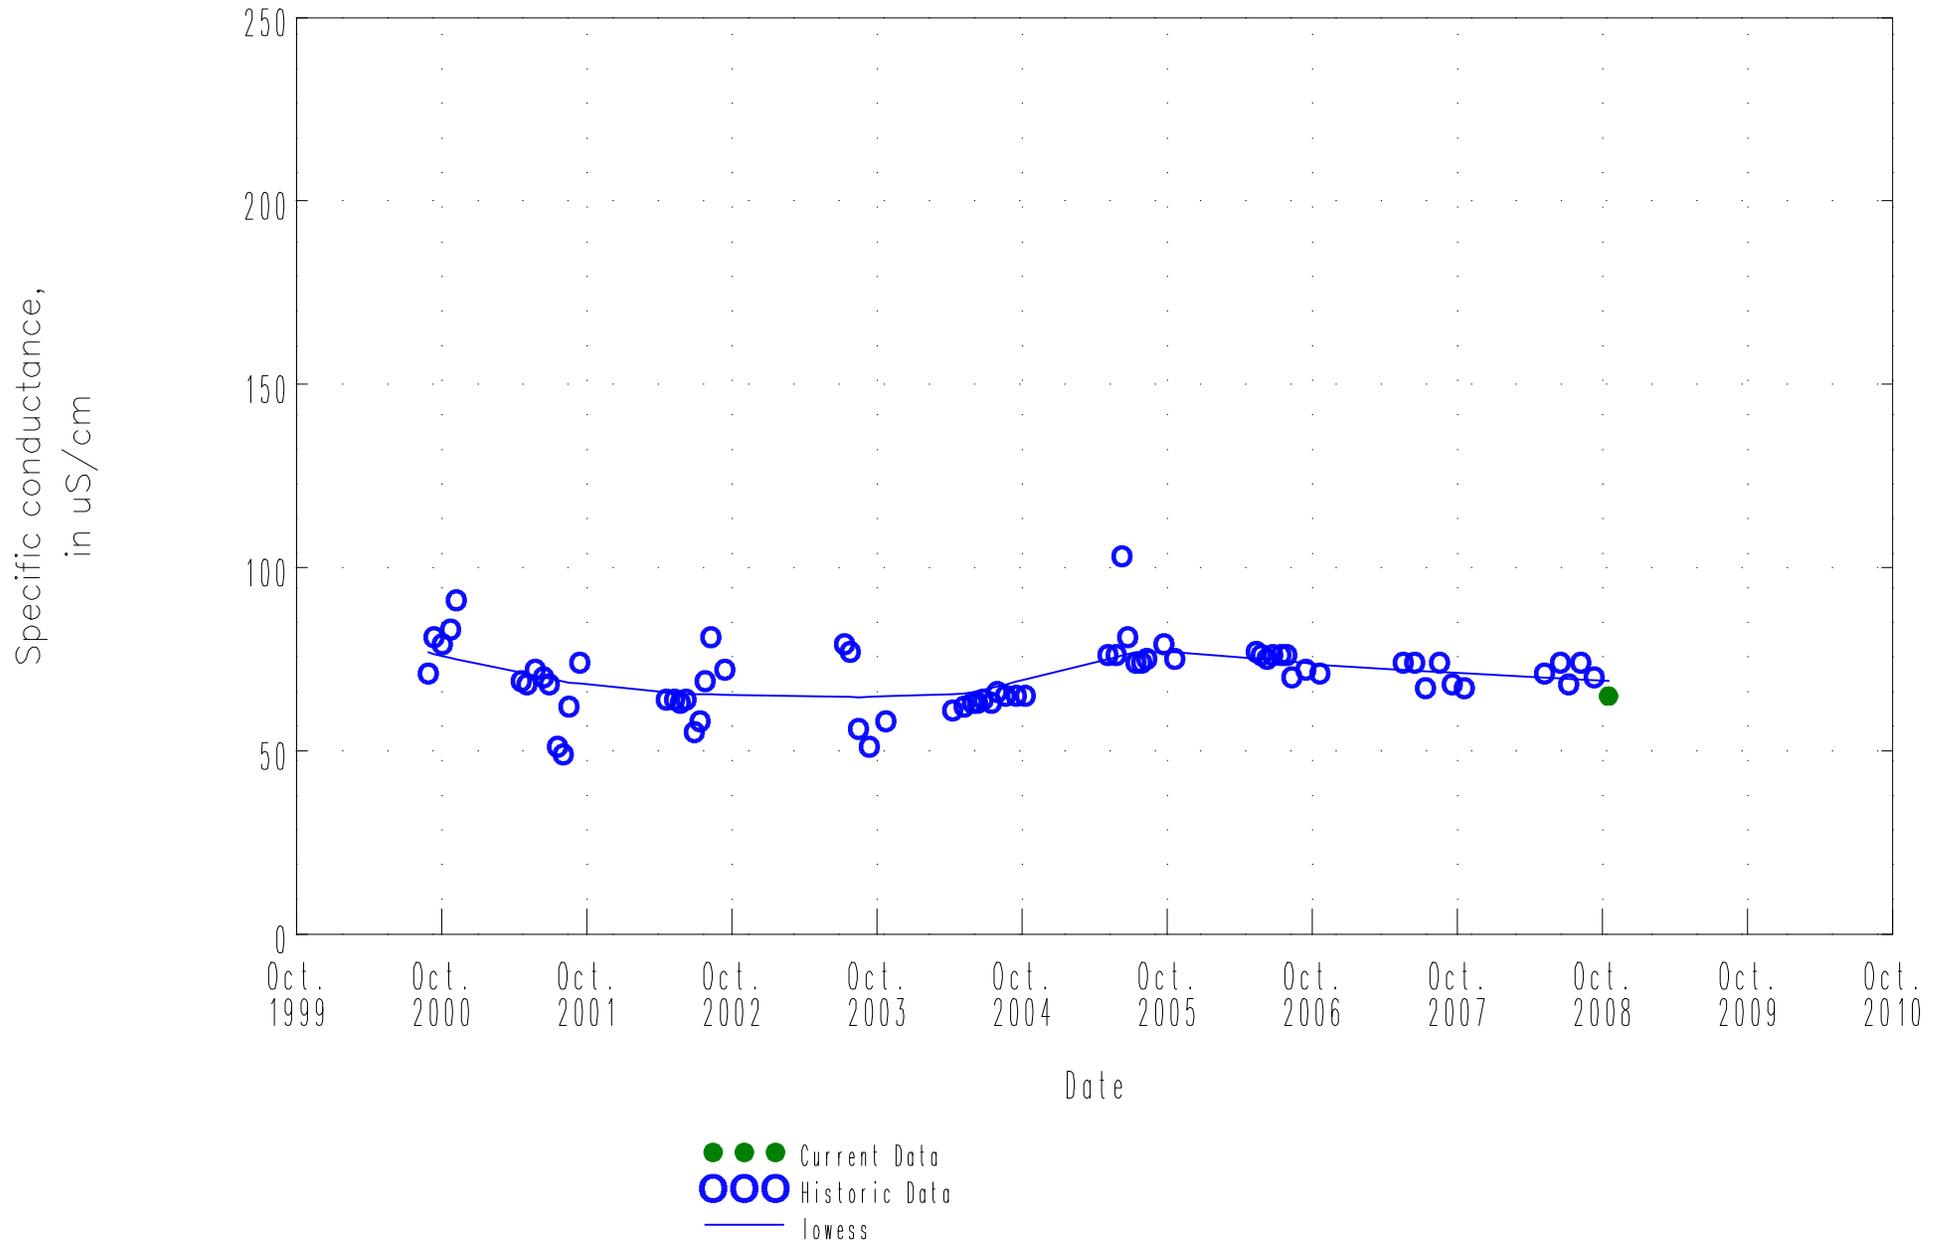


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

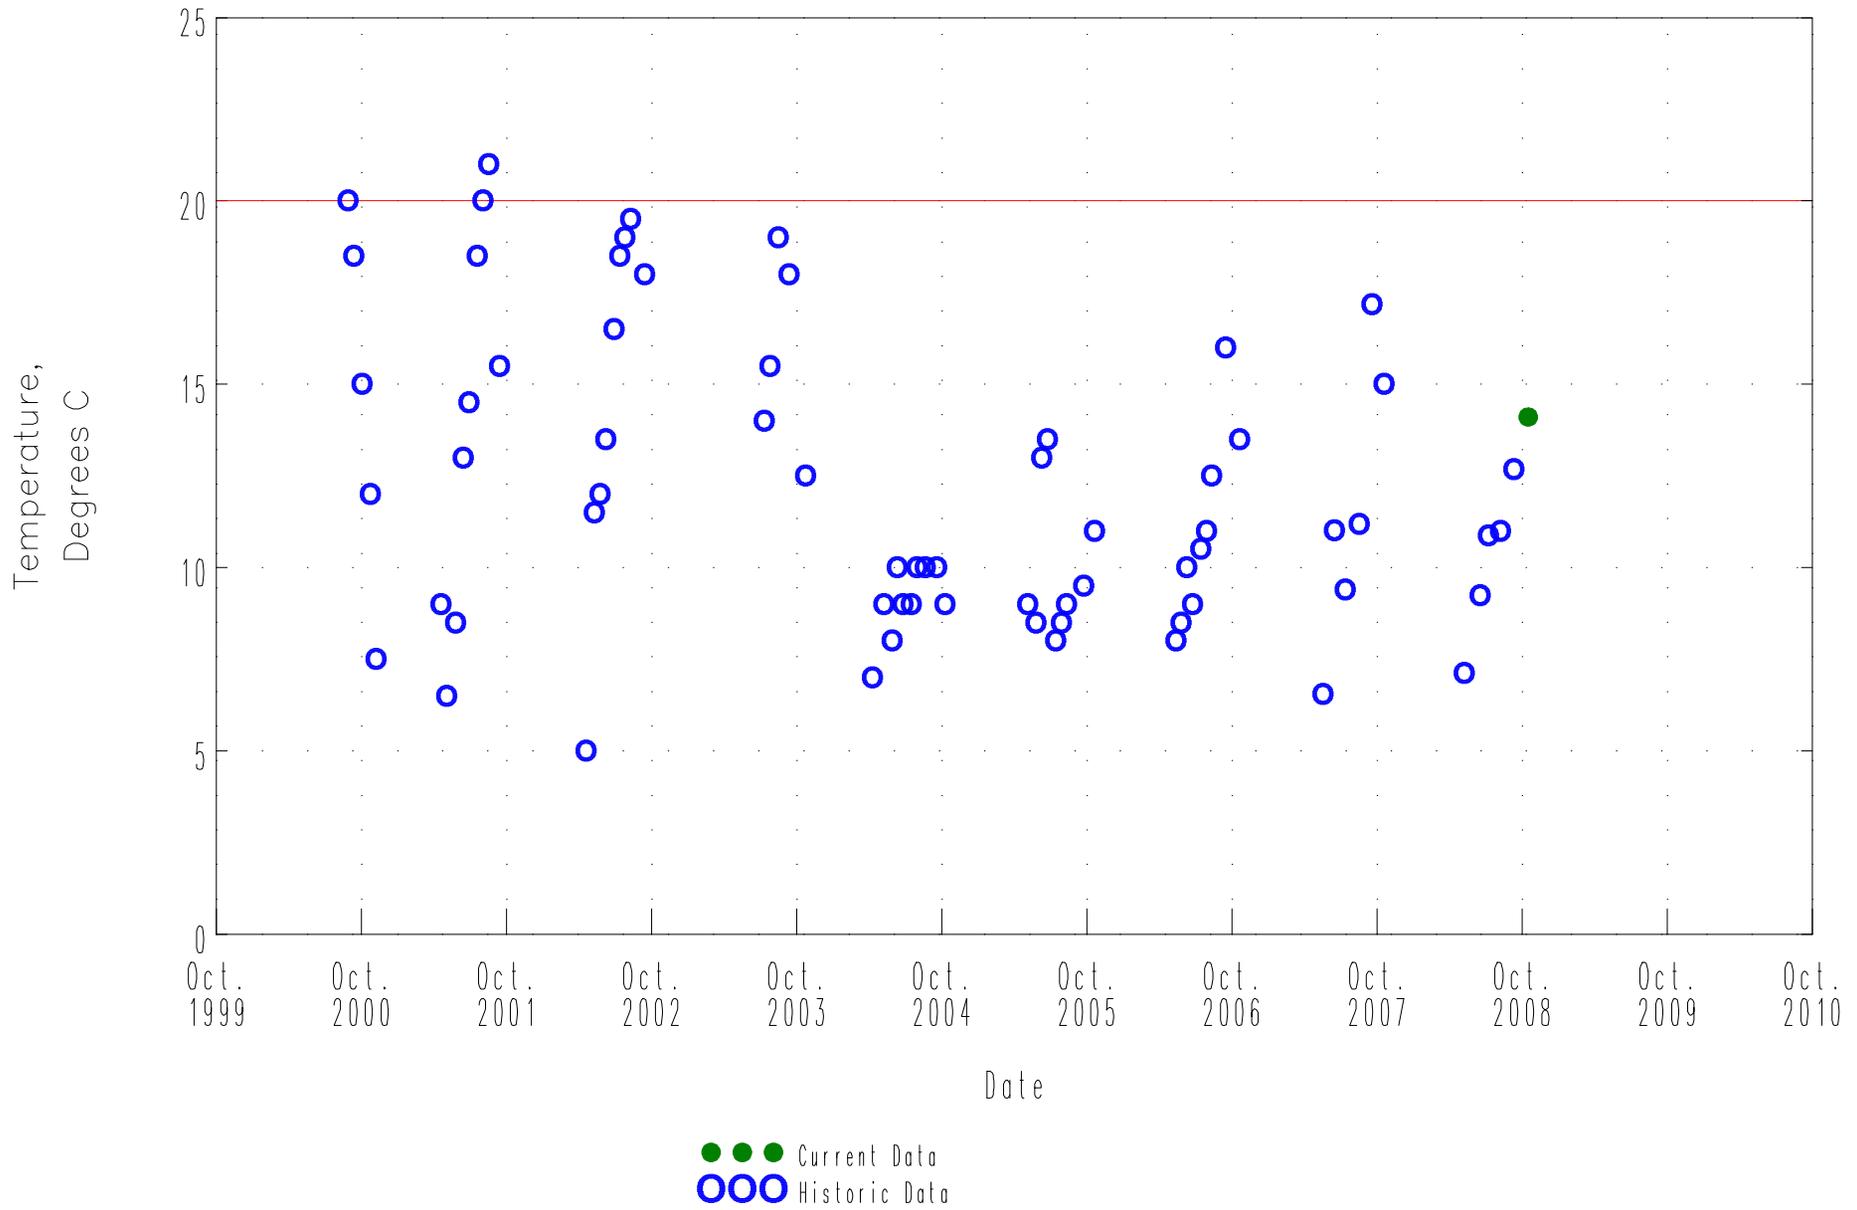

Standard 20

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

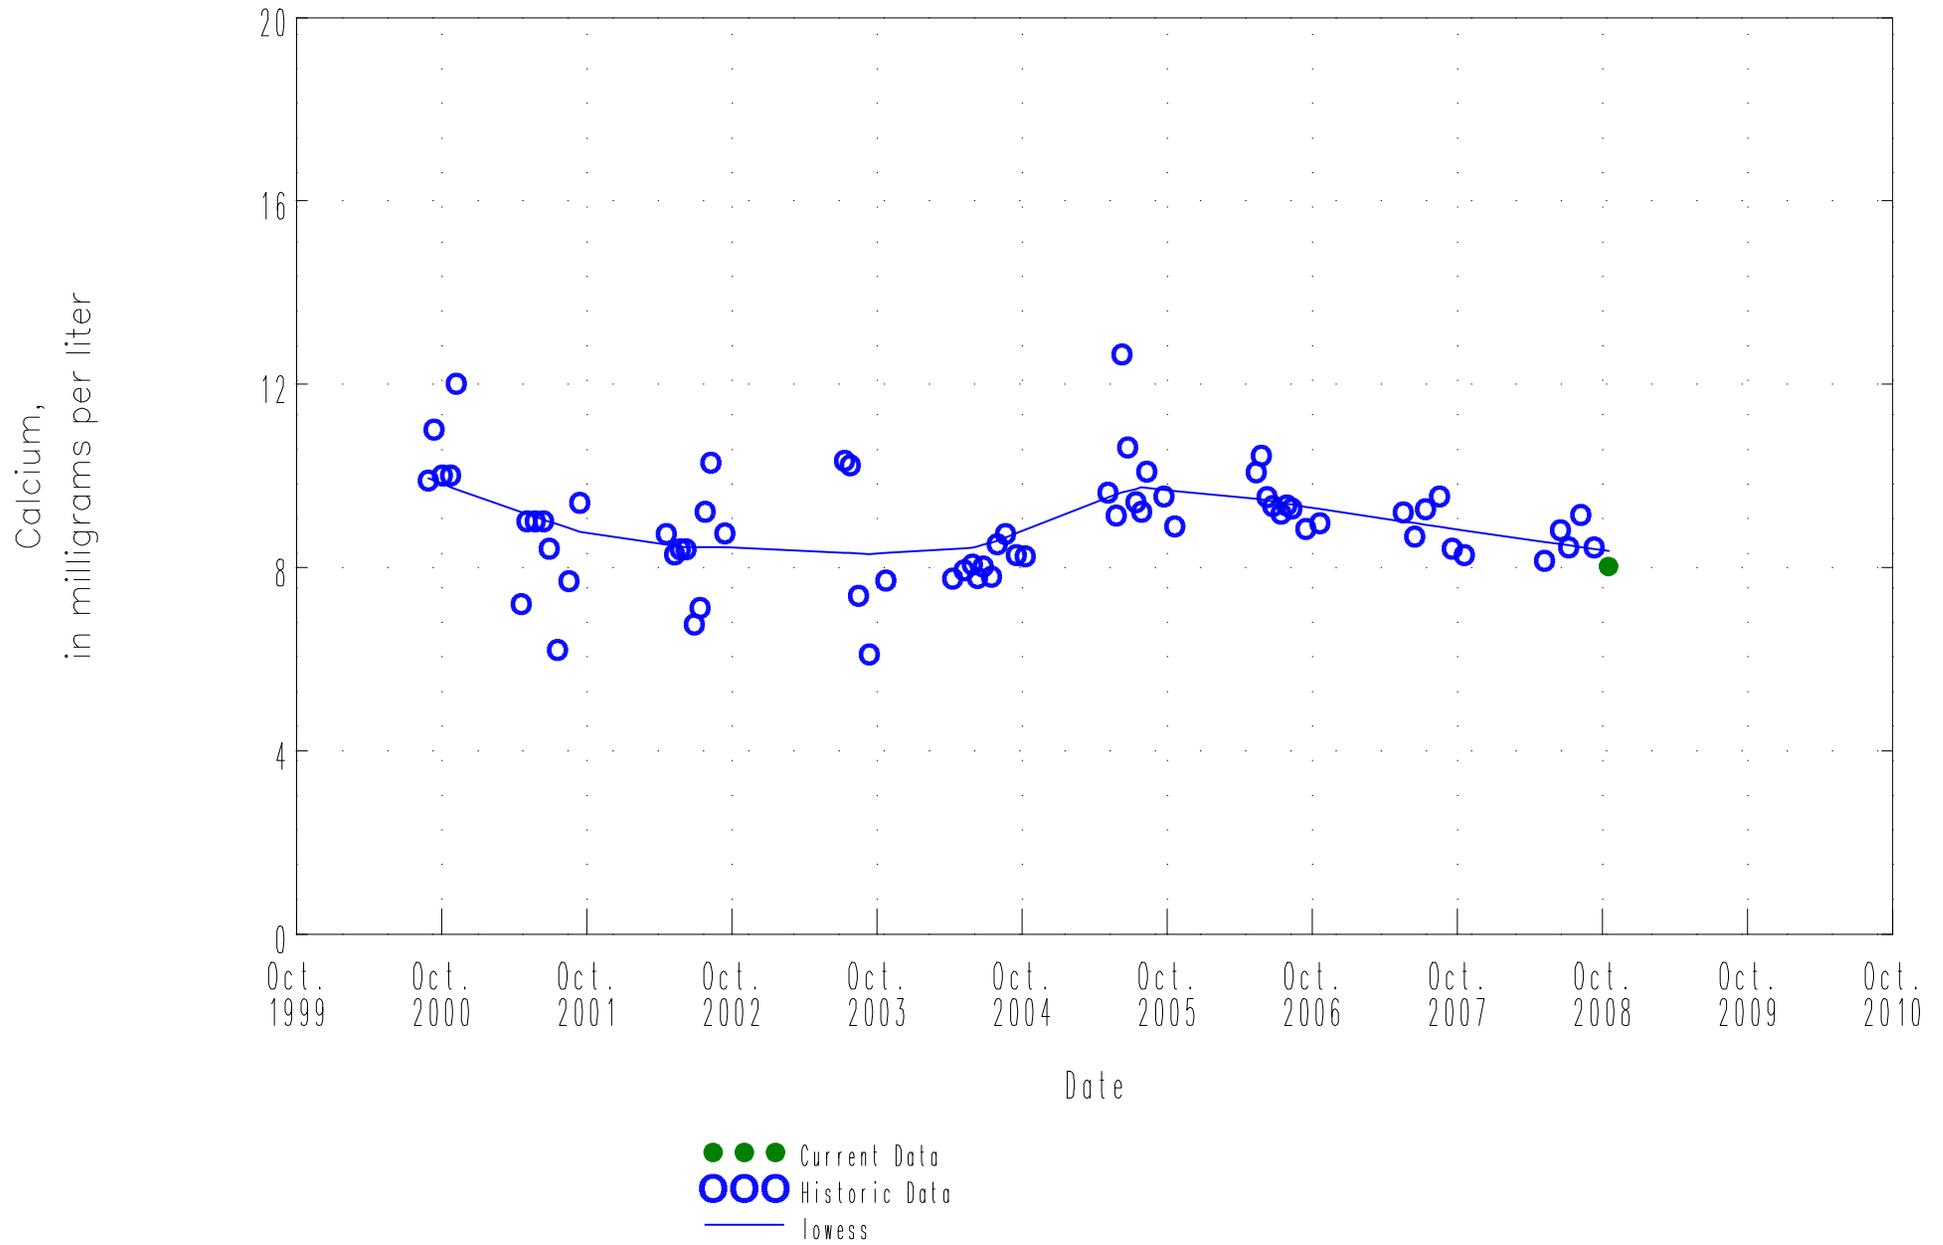


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

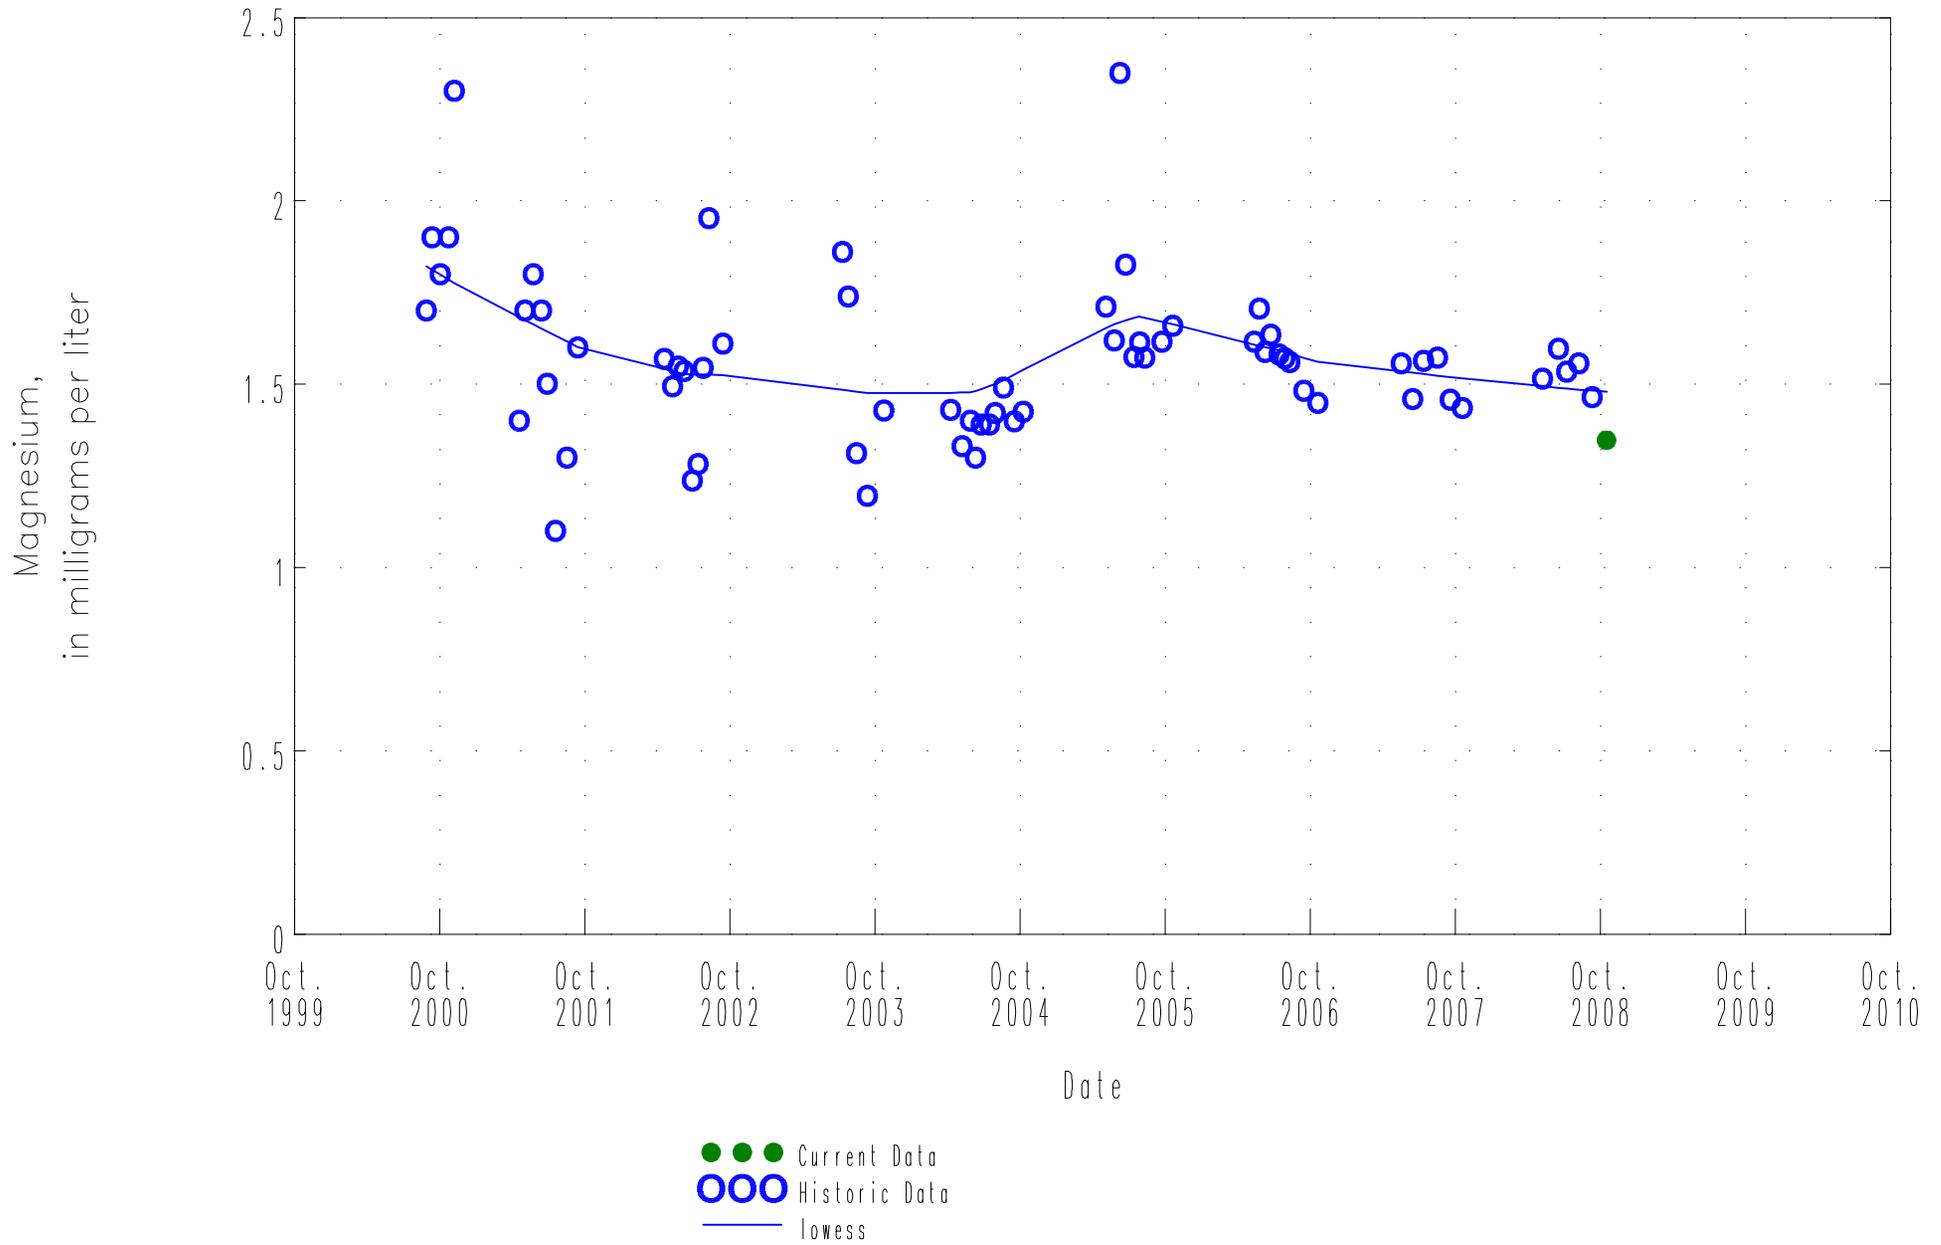


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

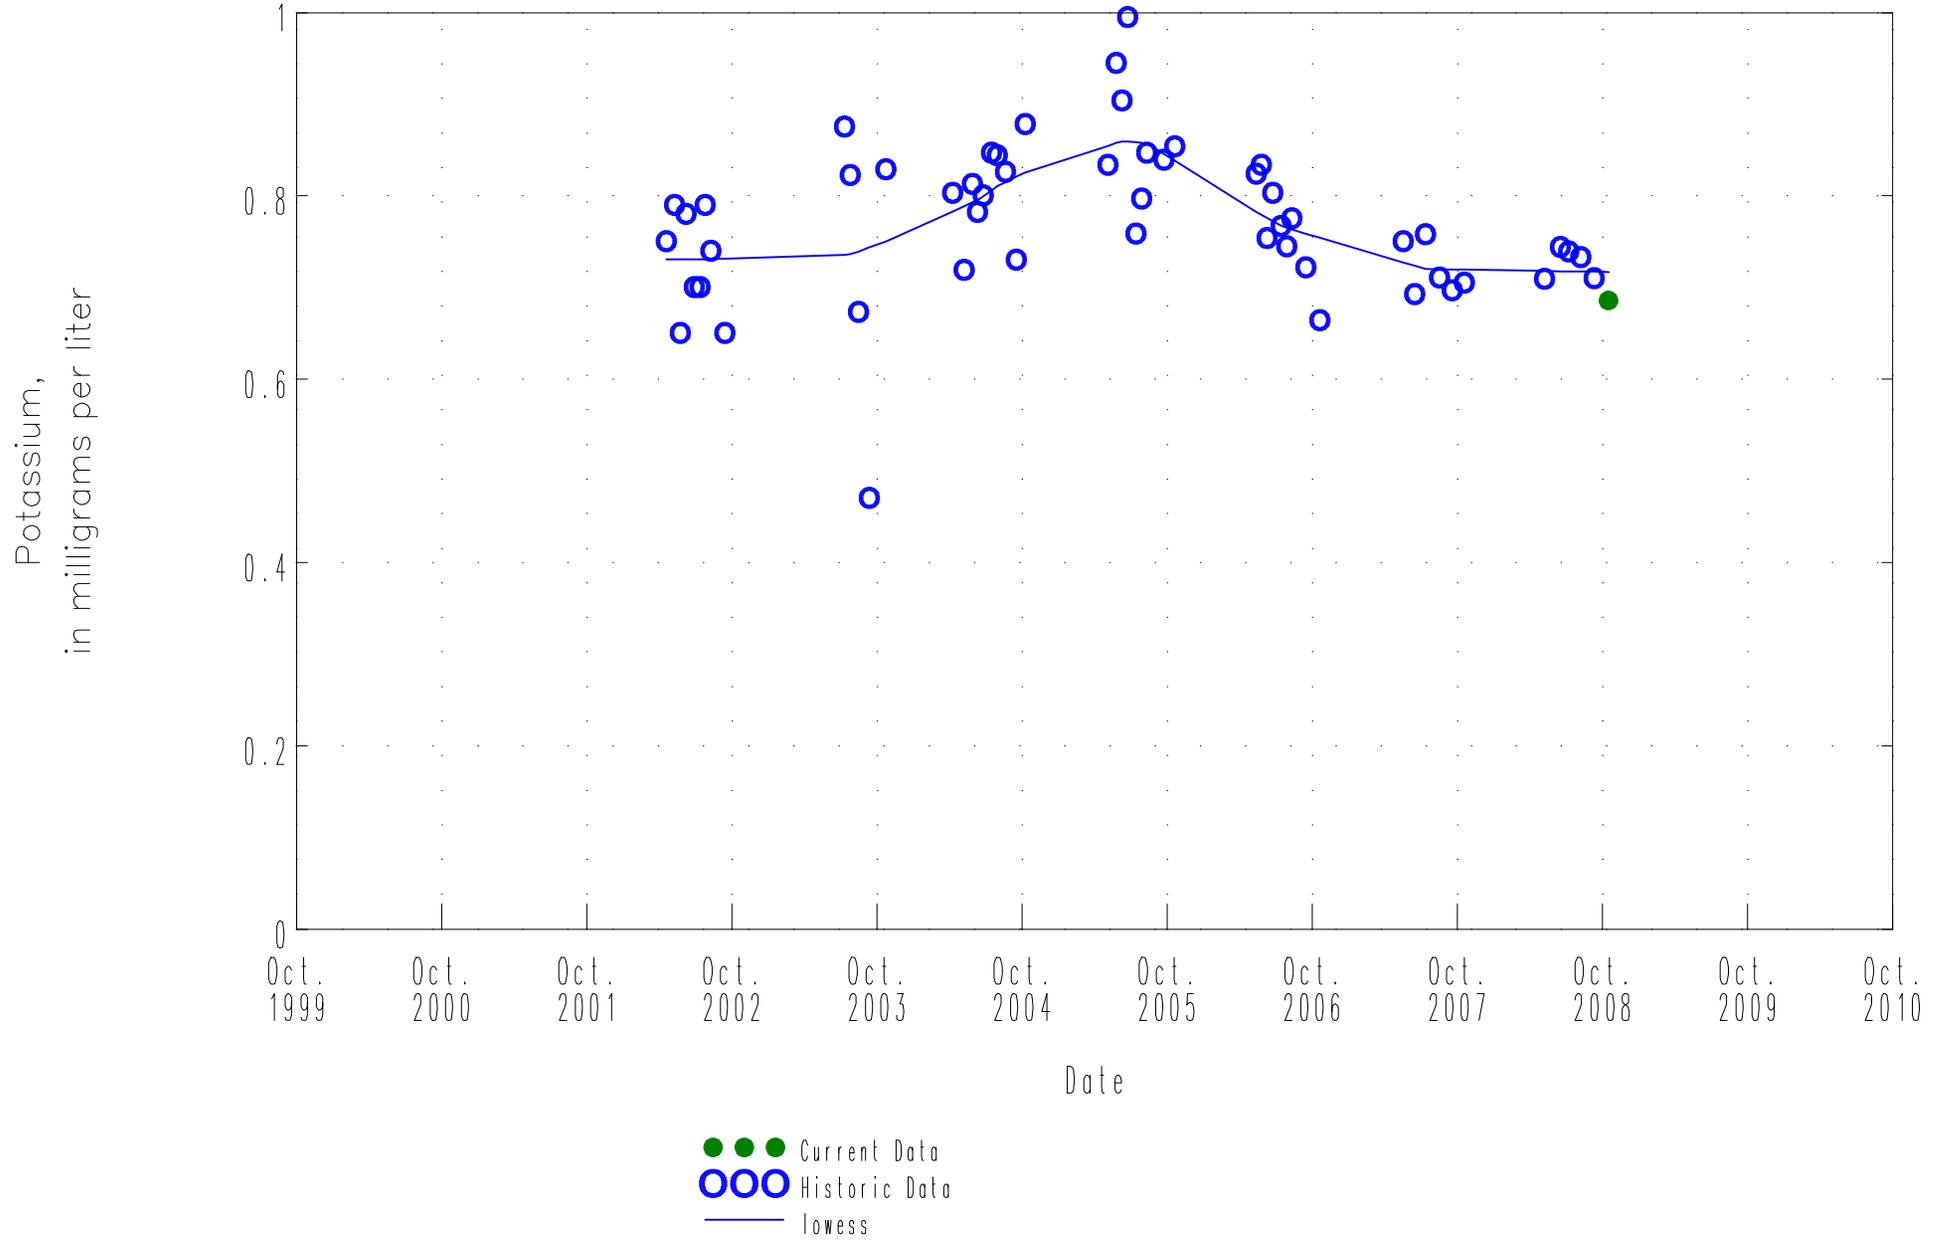


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

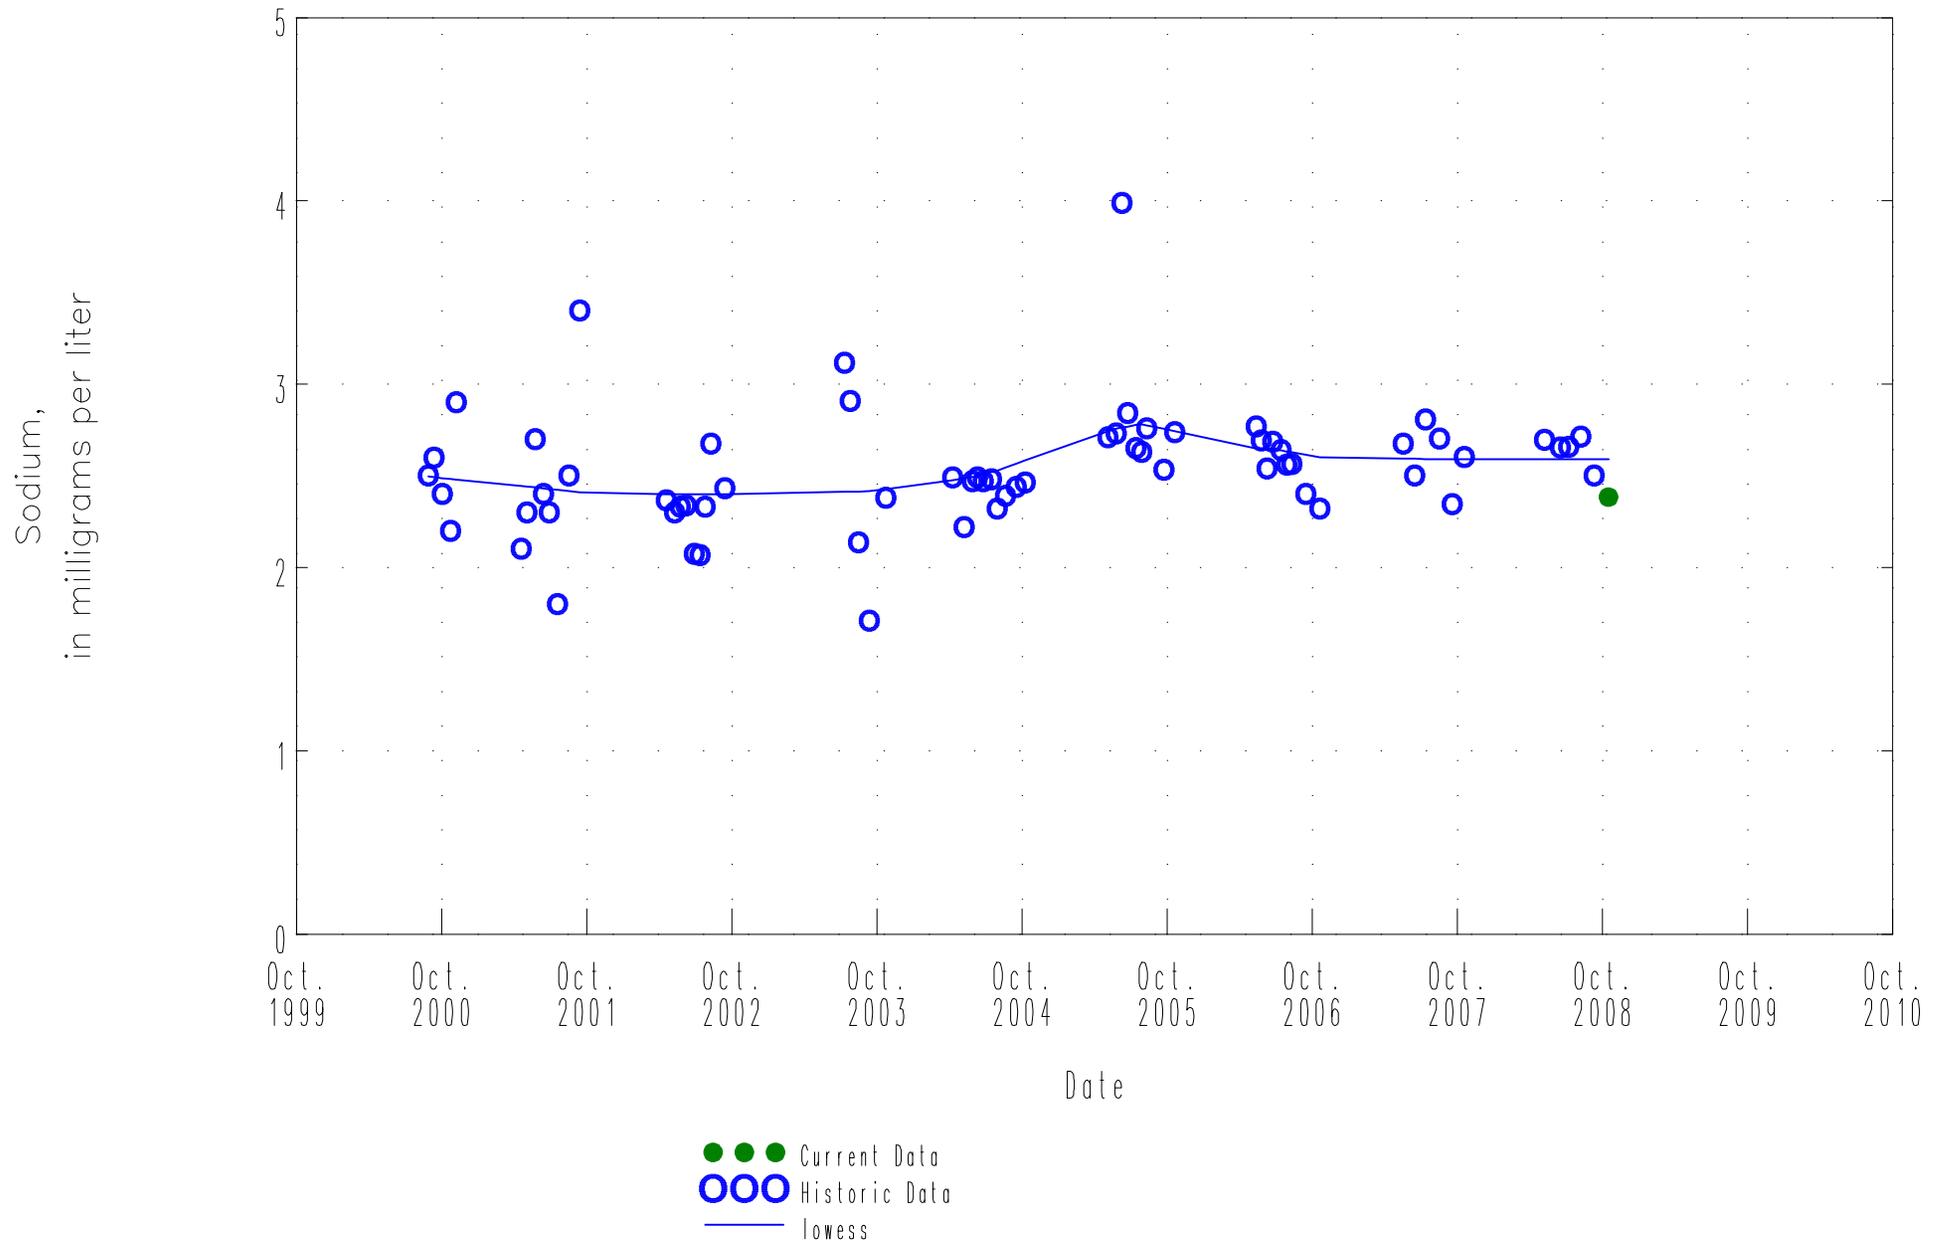


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

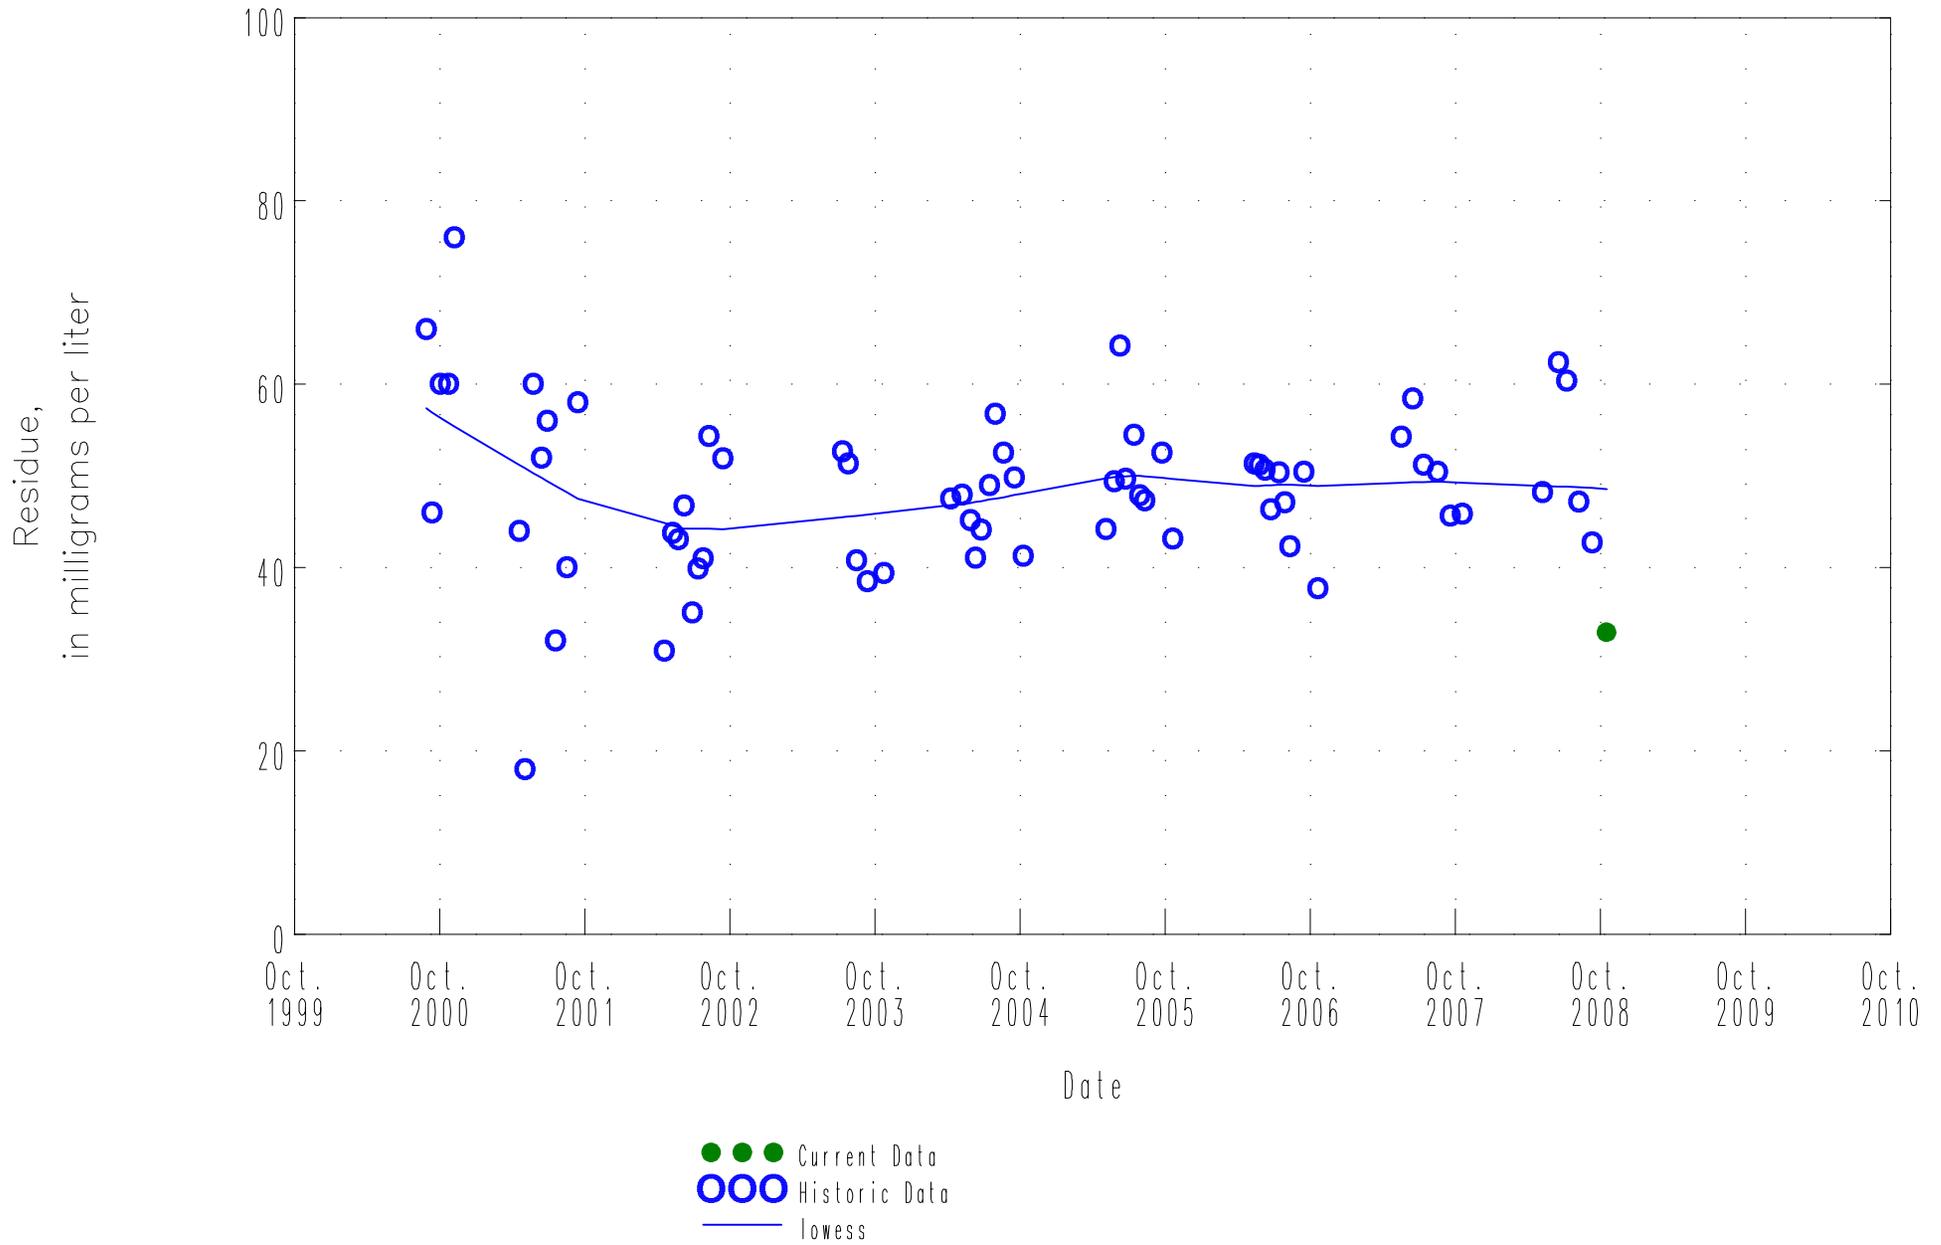


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

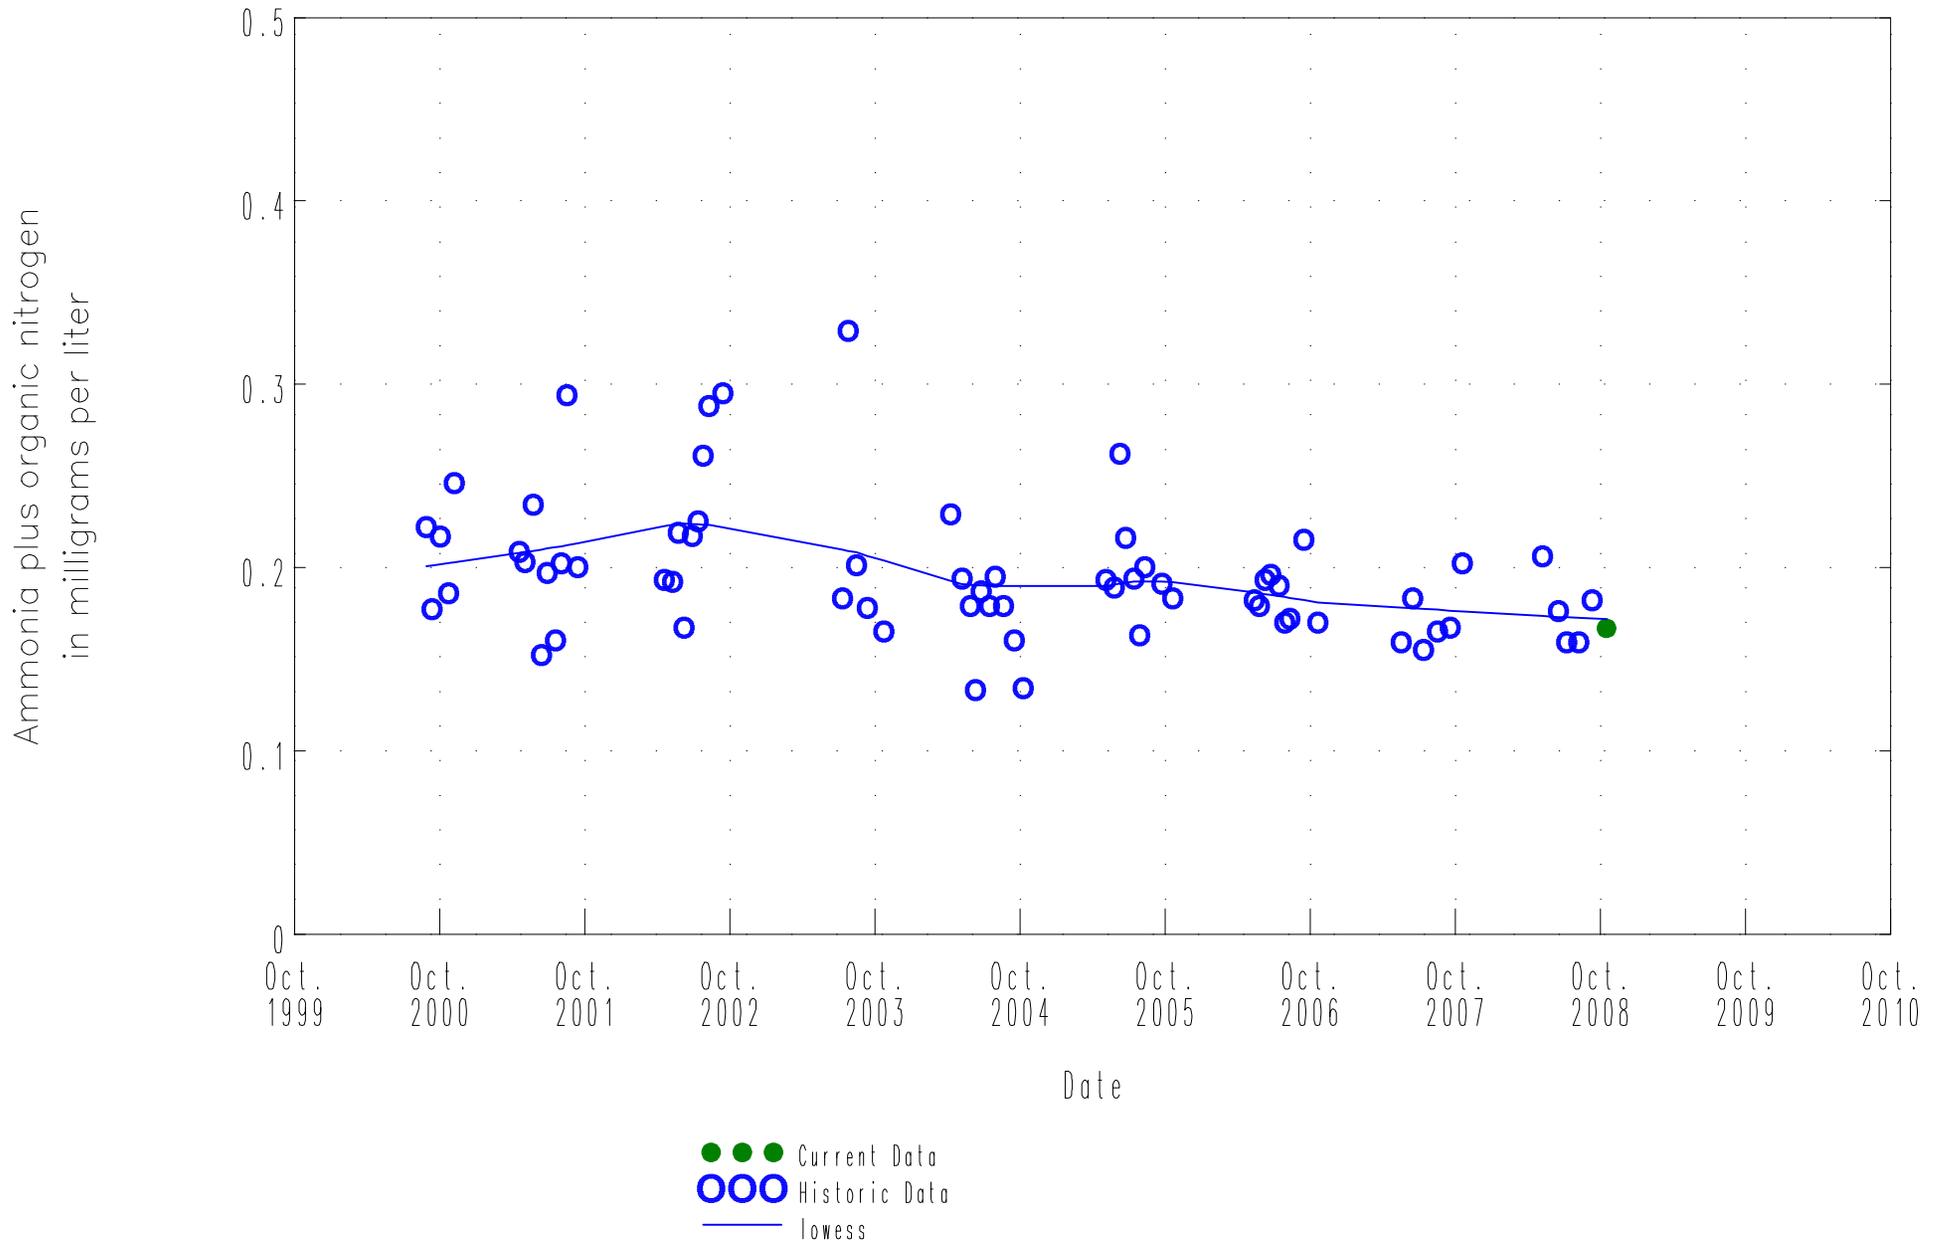


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

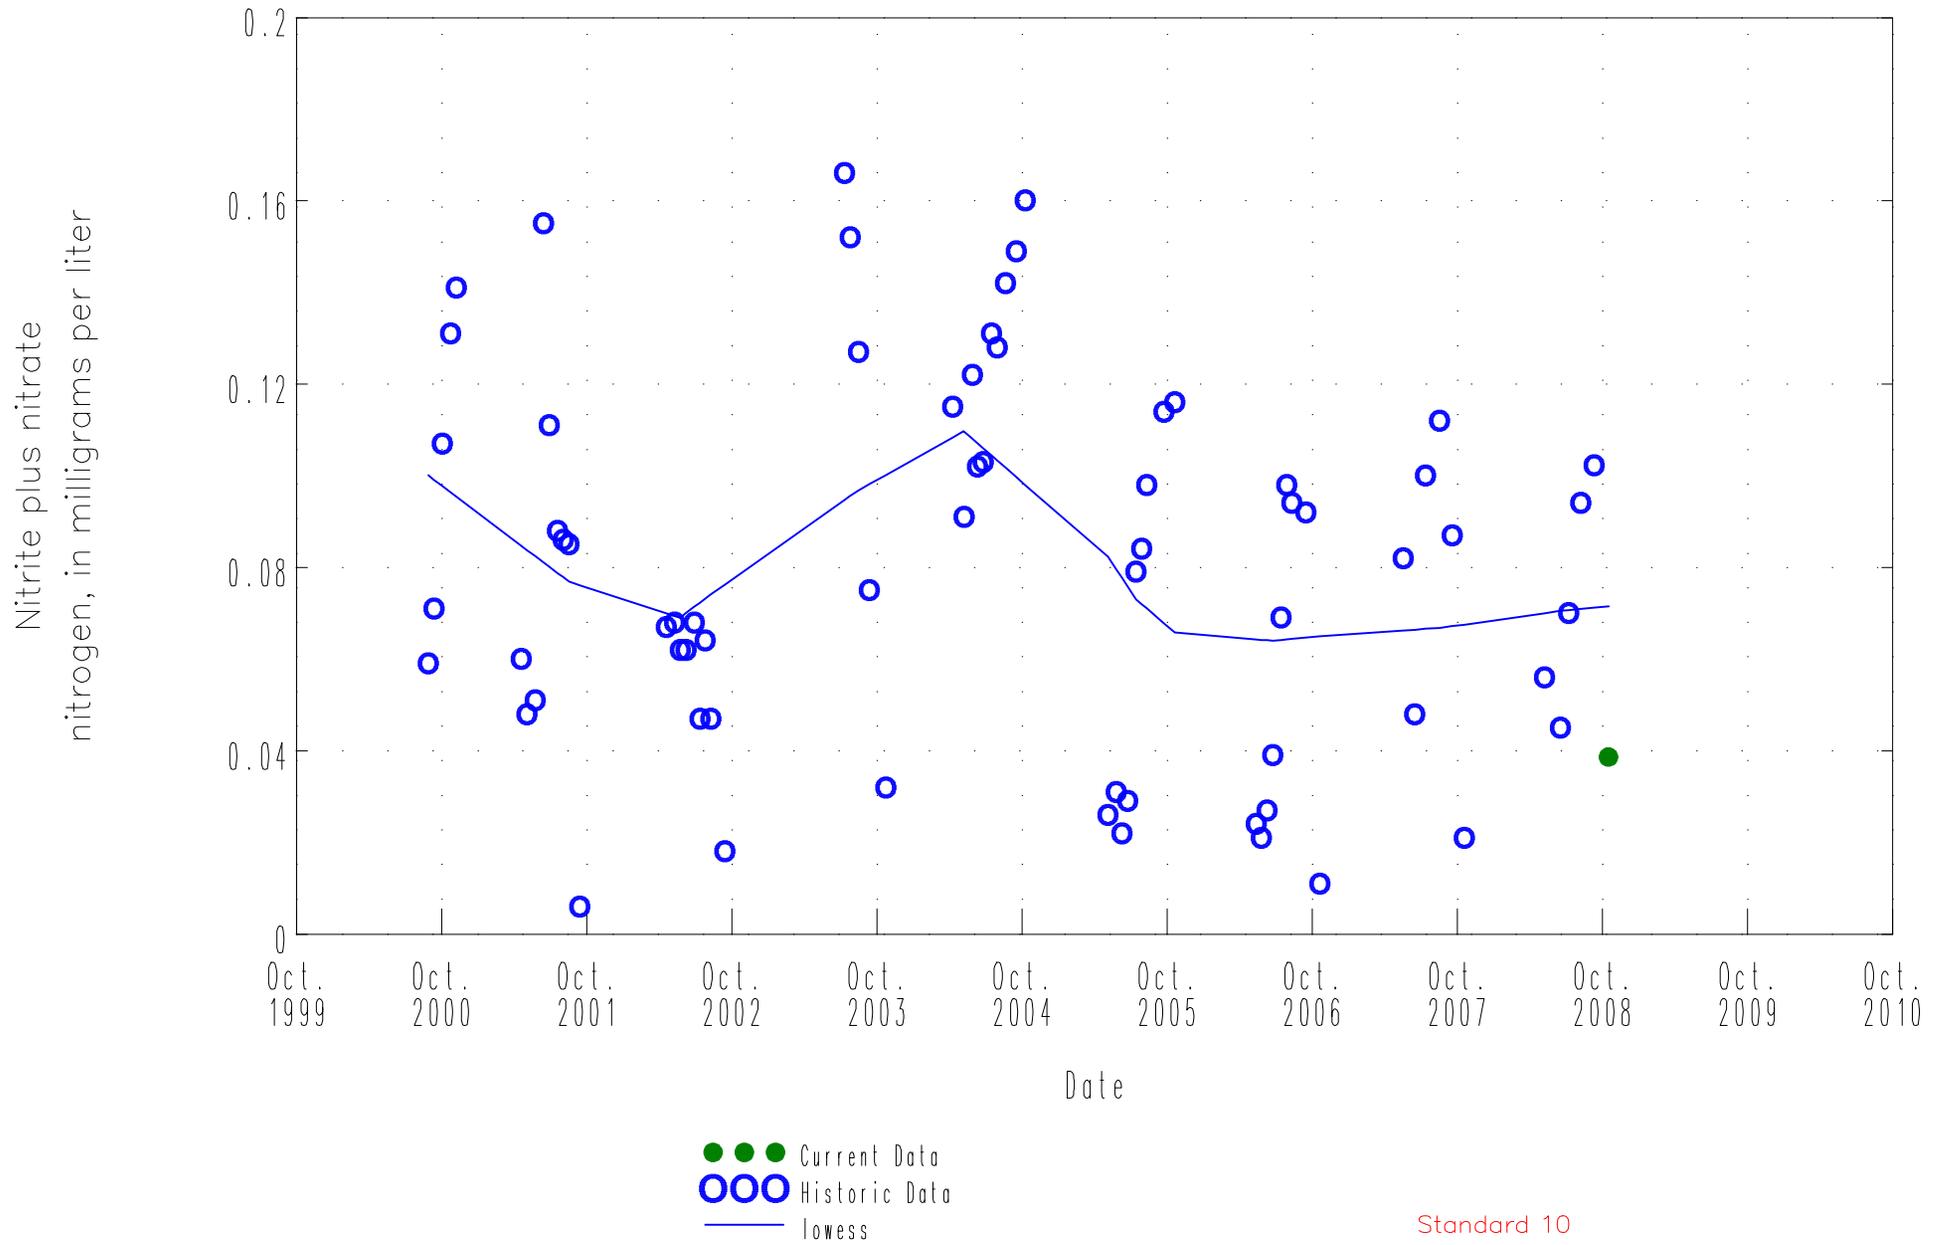


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

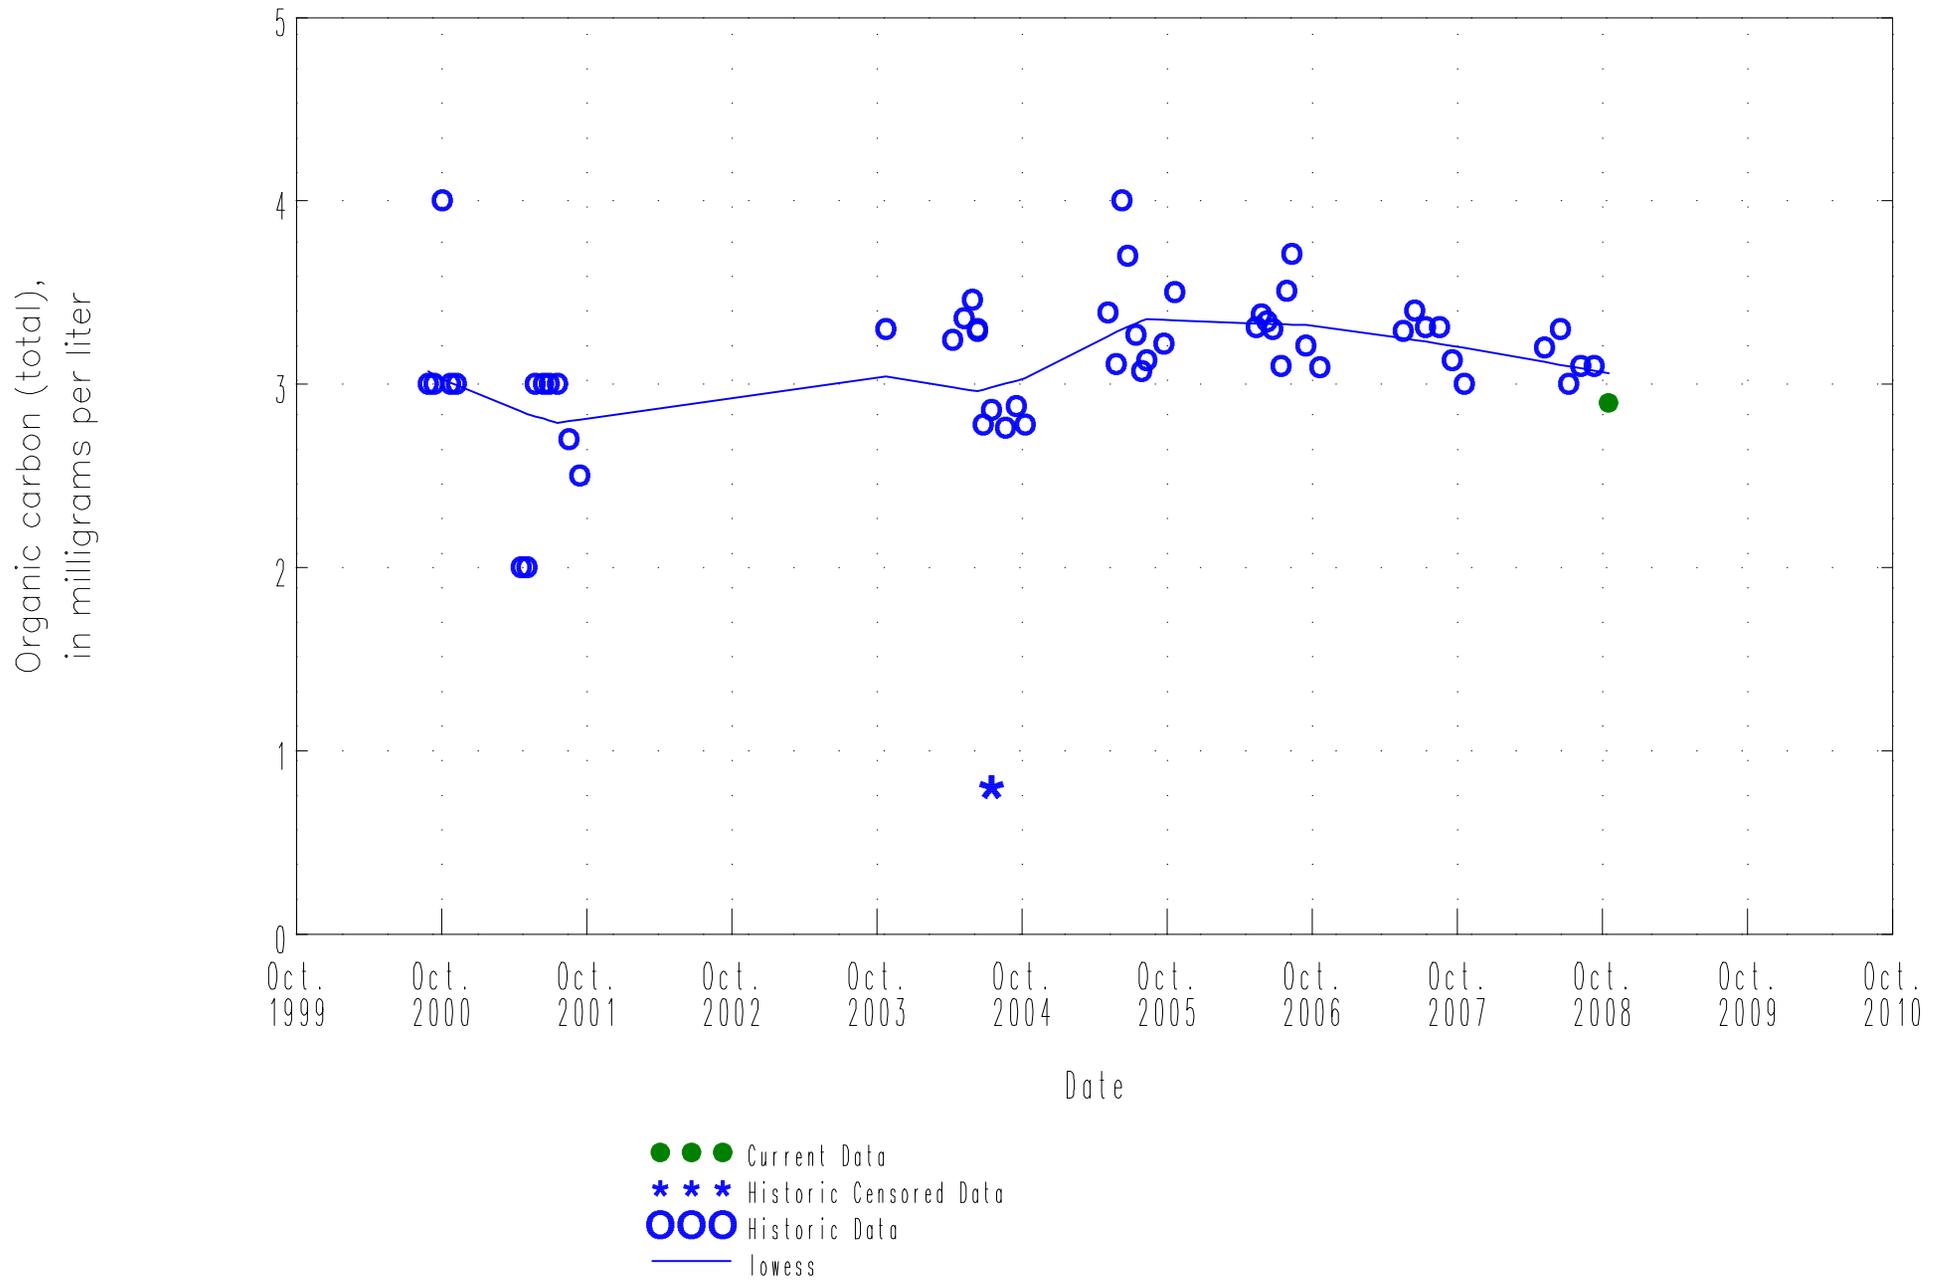


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

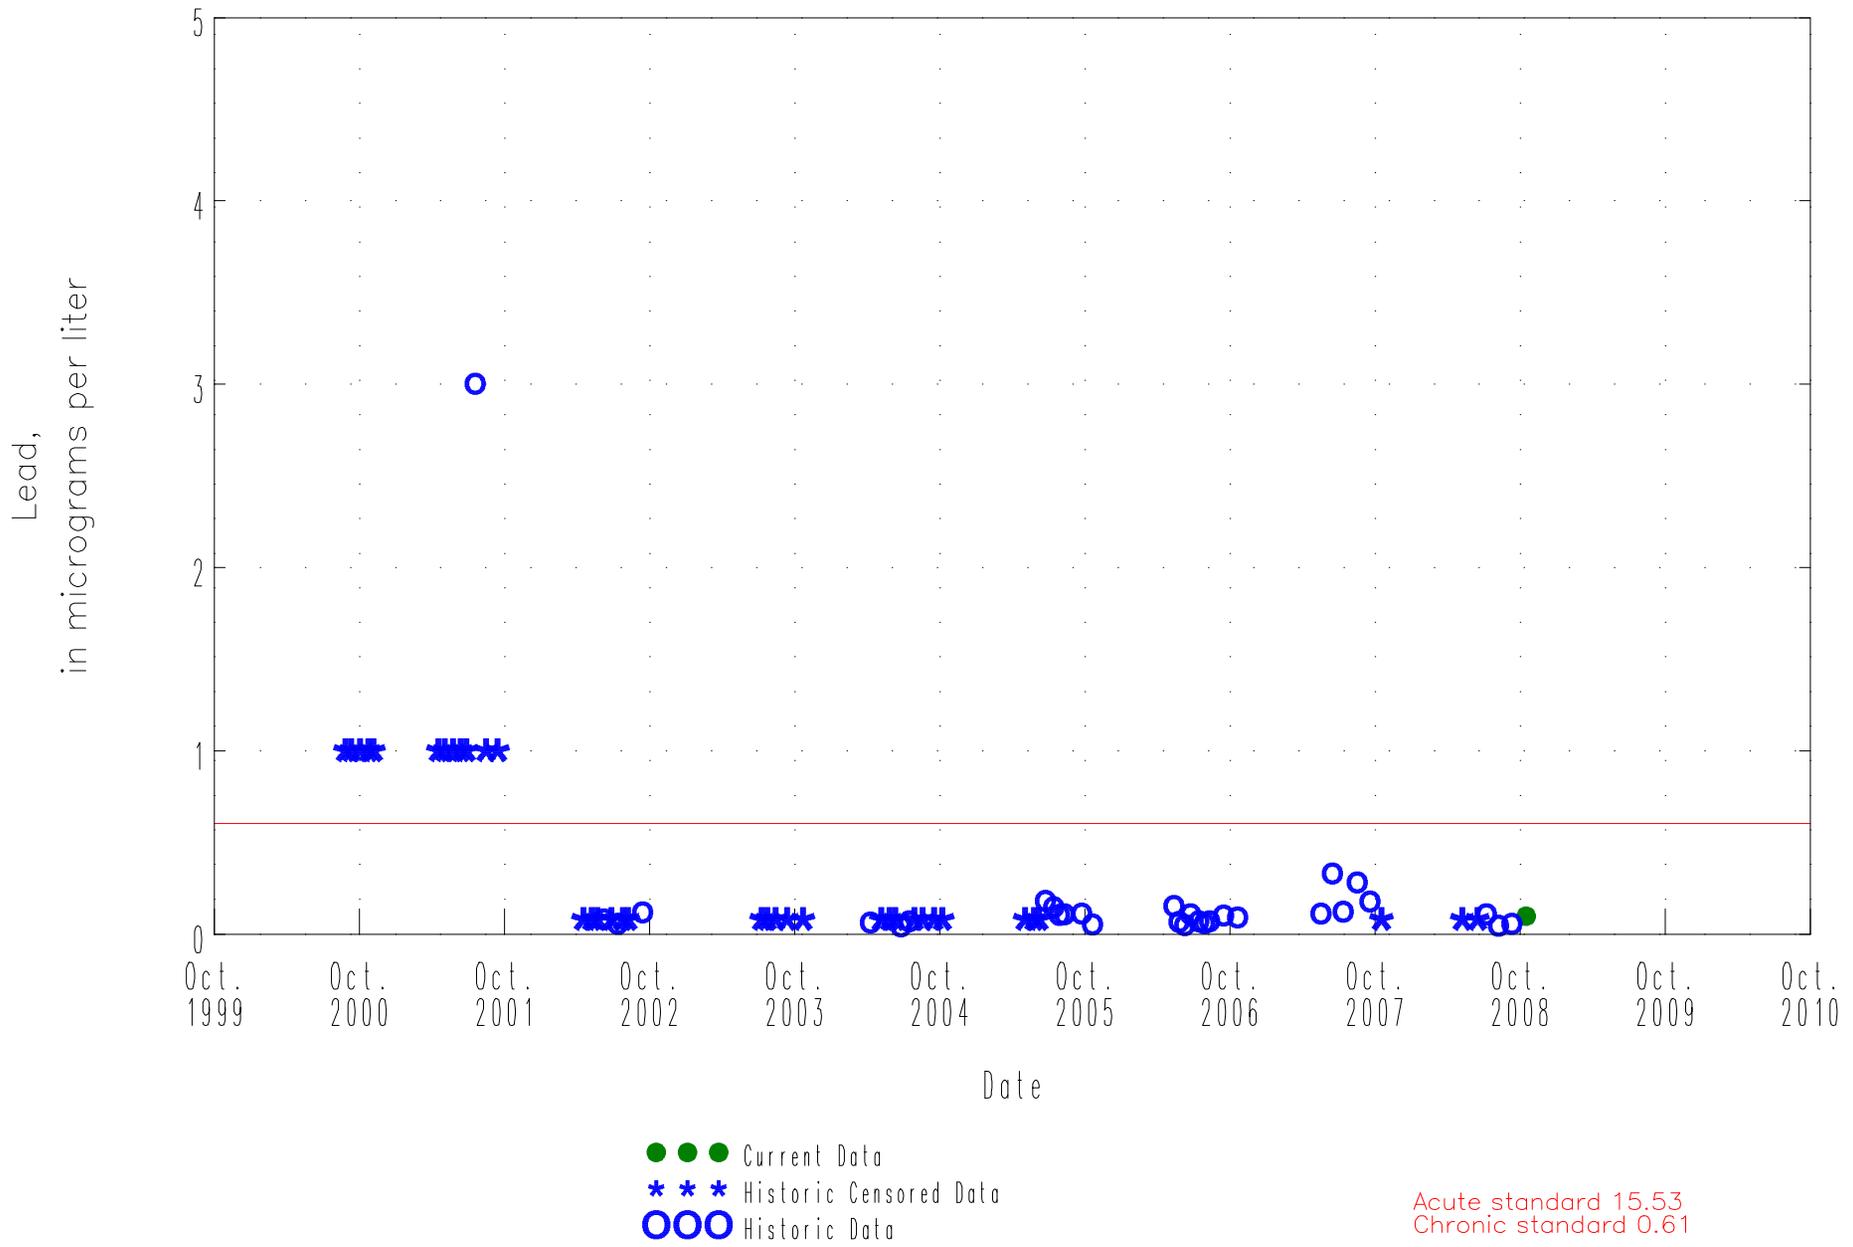


Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.


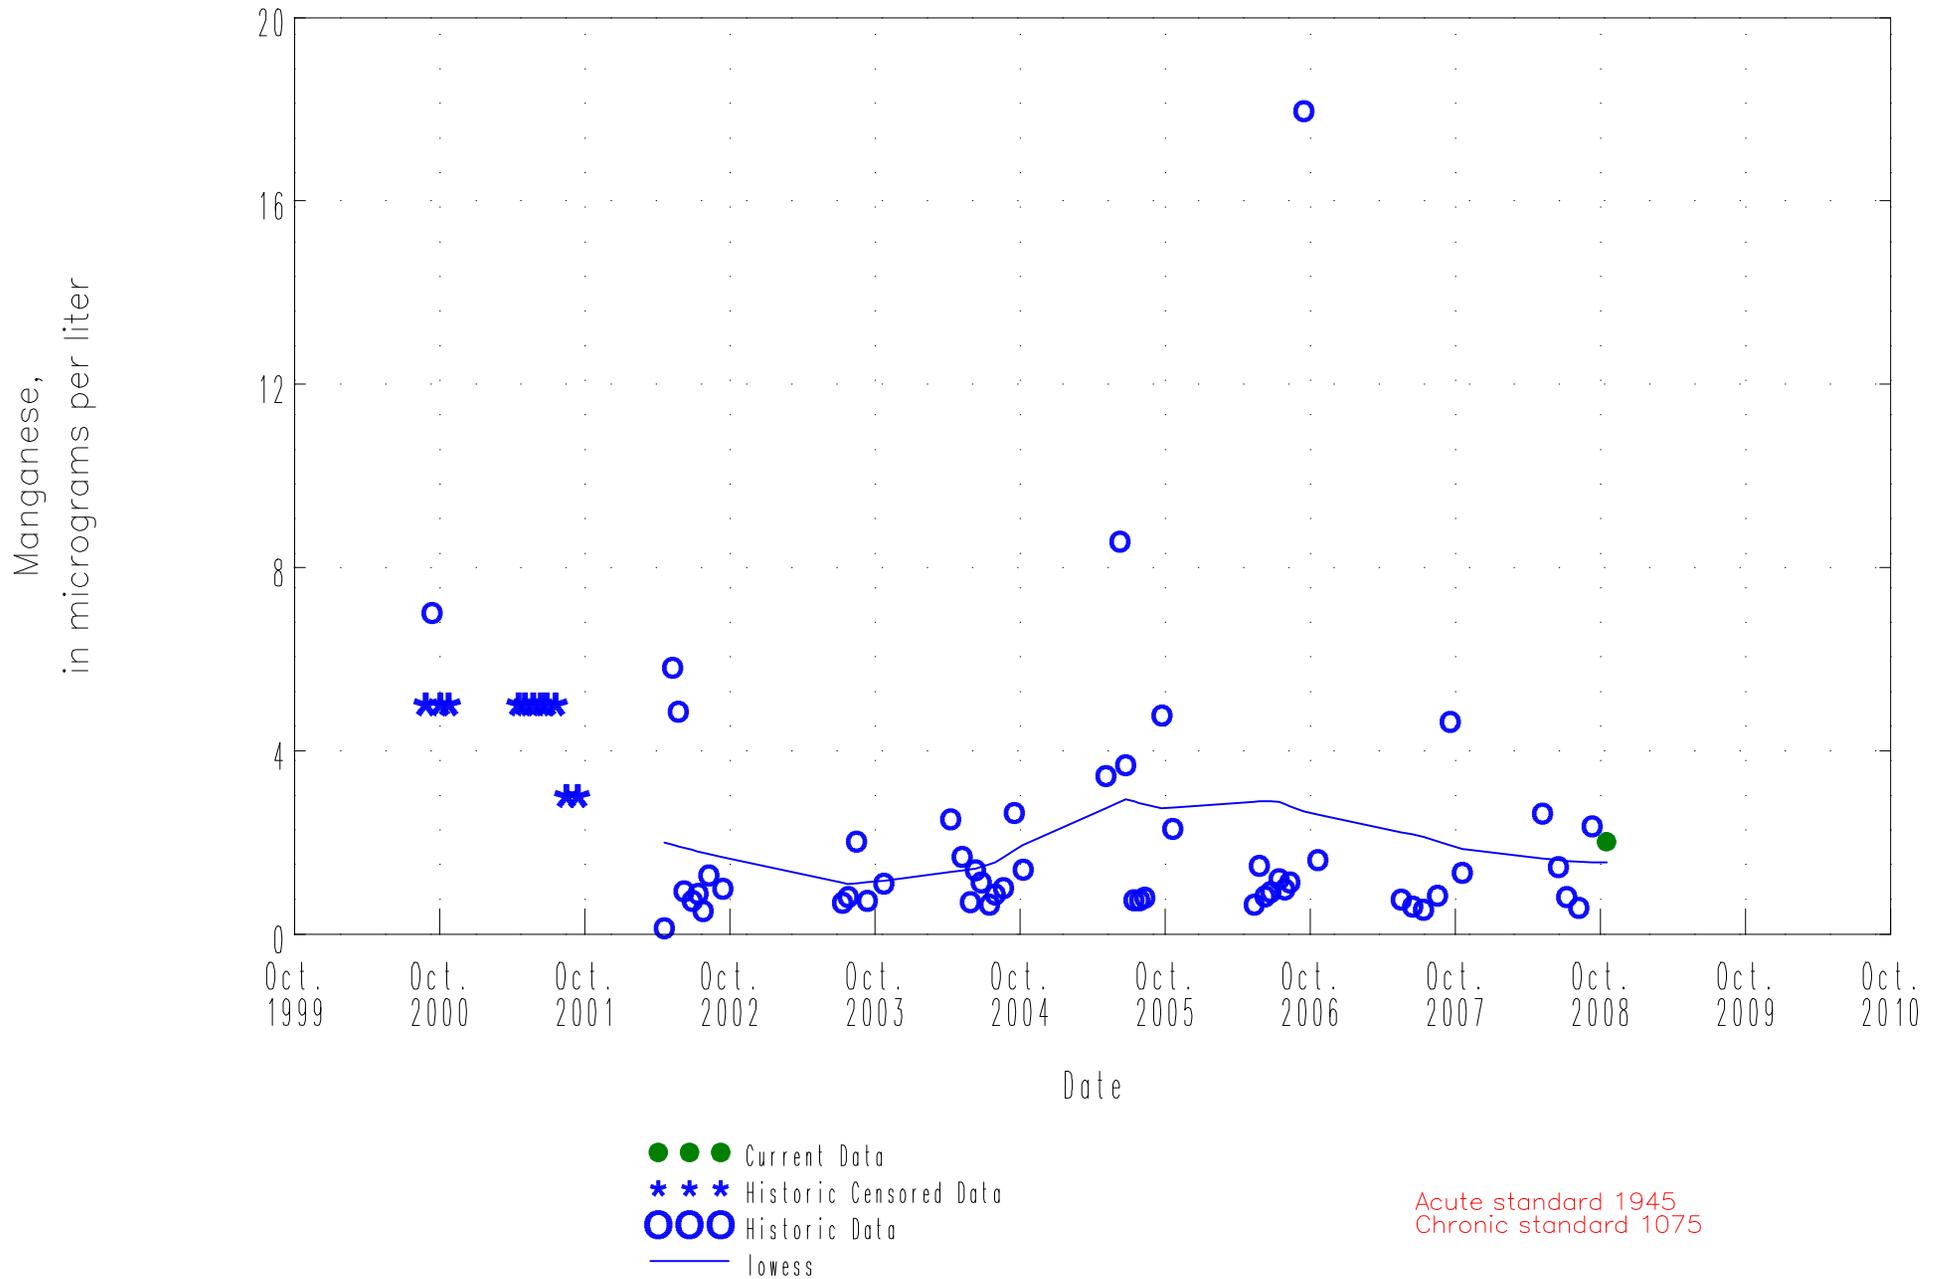


Figure 14. Distribution of selected water-quality constituents relative to time for


Hansen Canal above Greeley Filtration Plant, station 403814105111800.

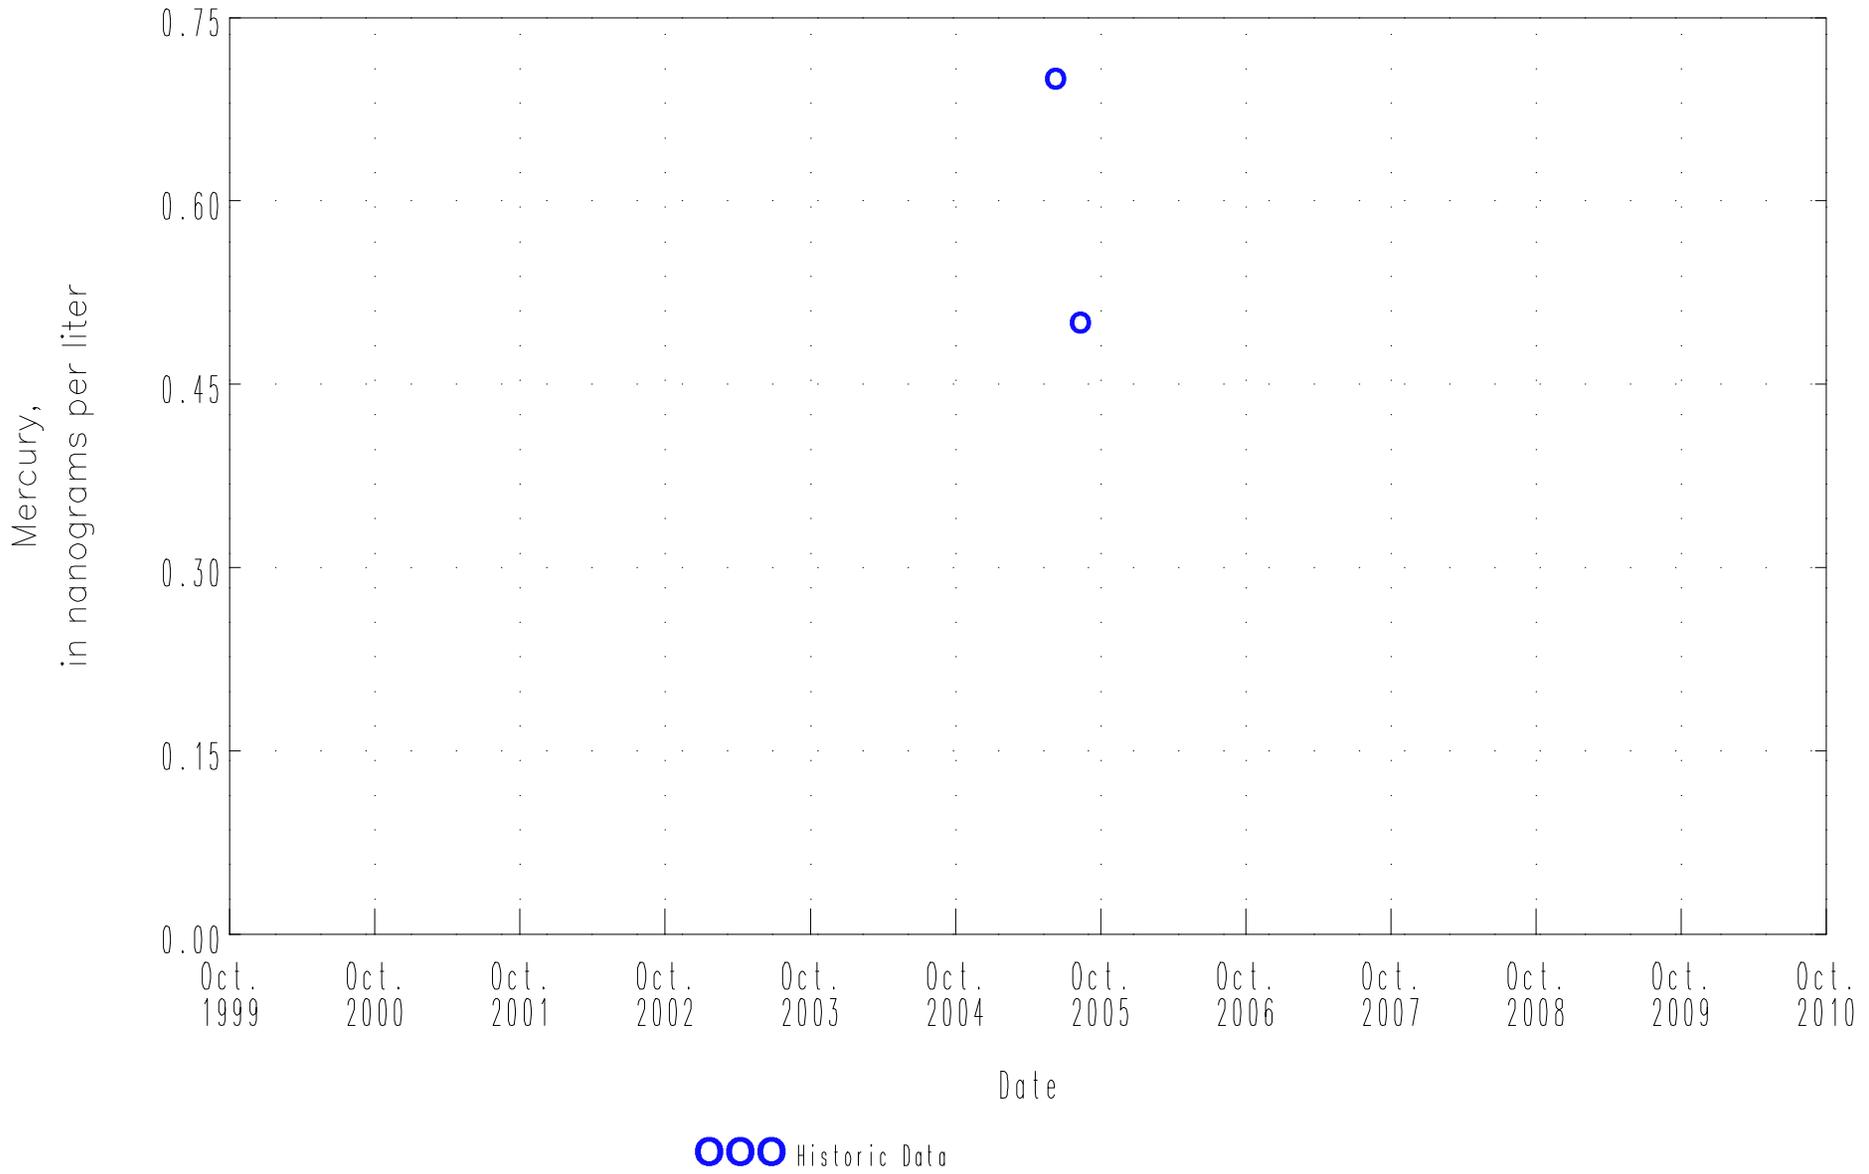

Chronic standard 10

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

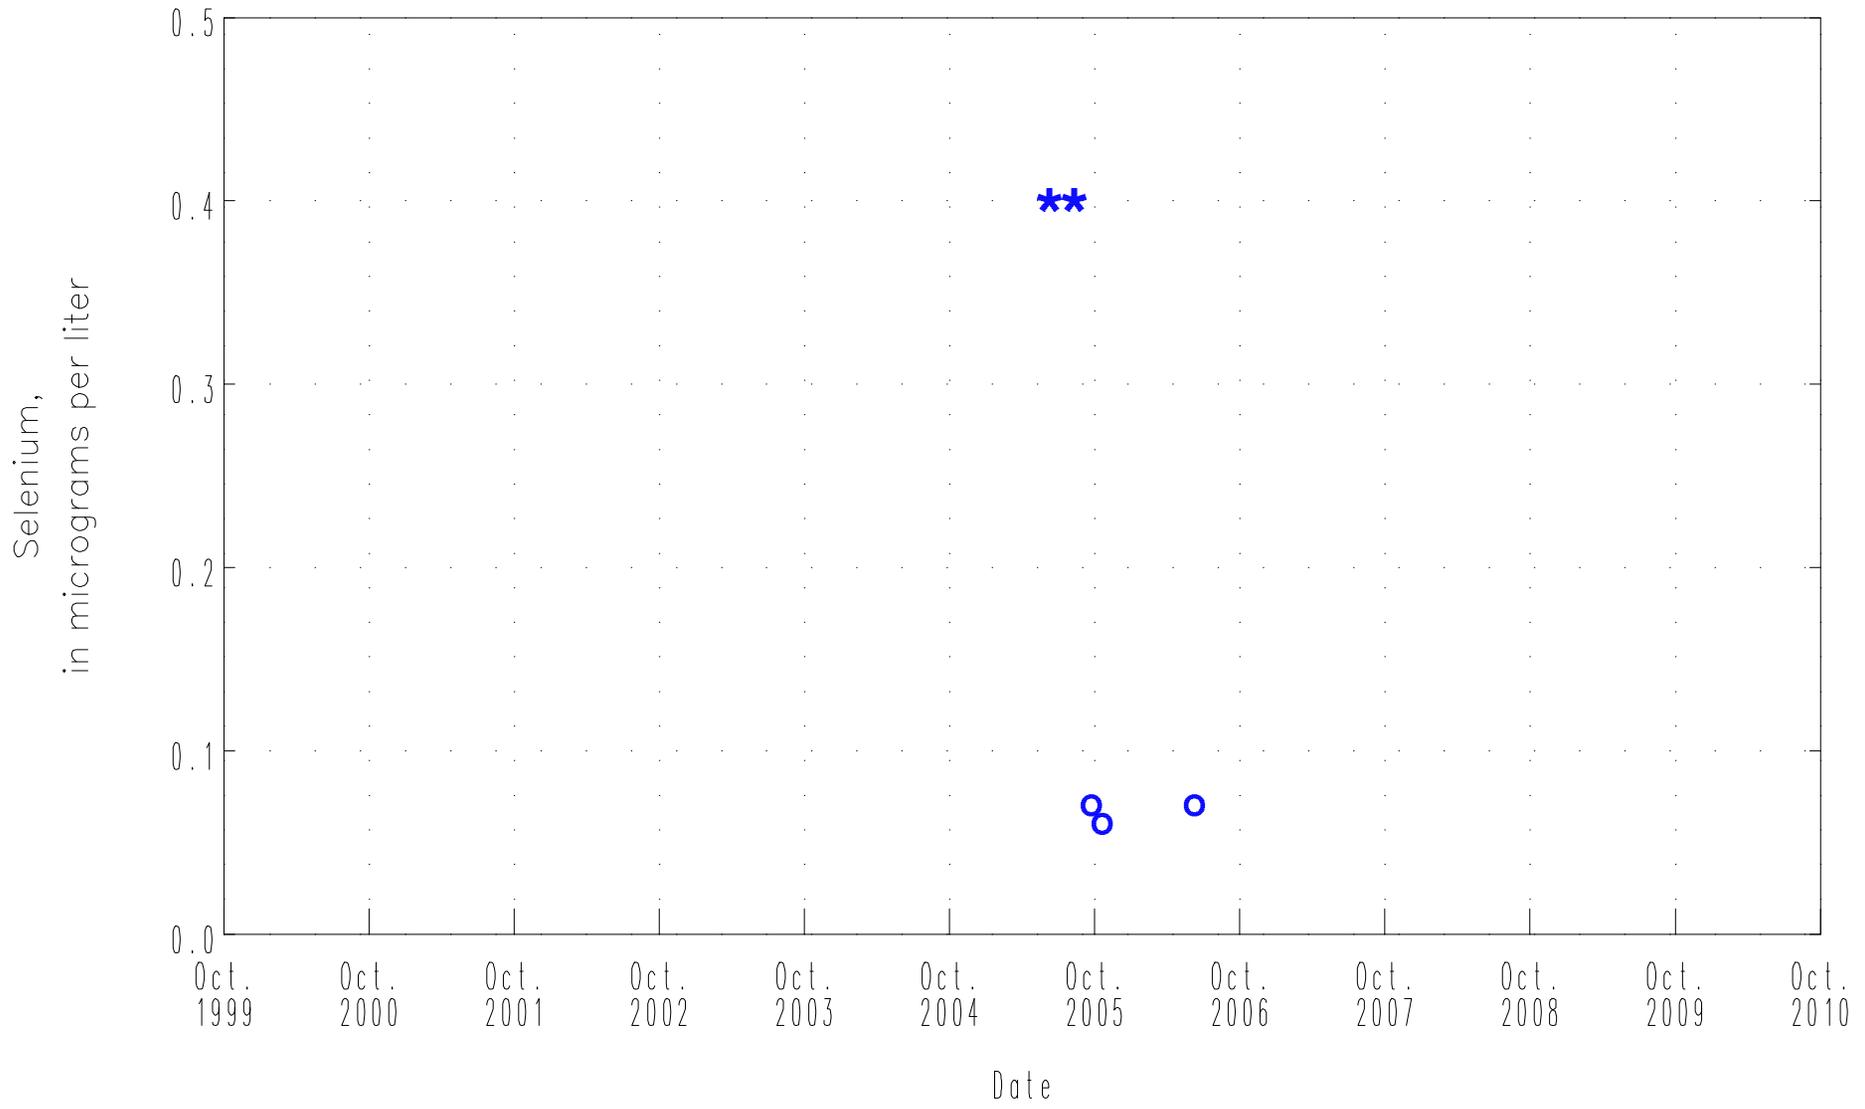

*** Historic Censored Data
OOO Historic Data

Acute standard 18.4
Chronic standard 4.6

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.


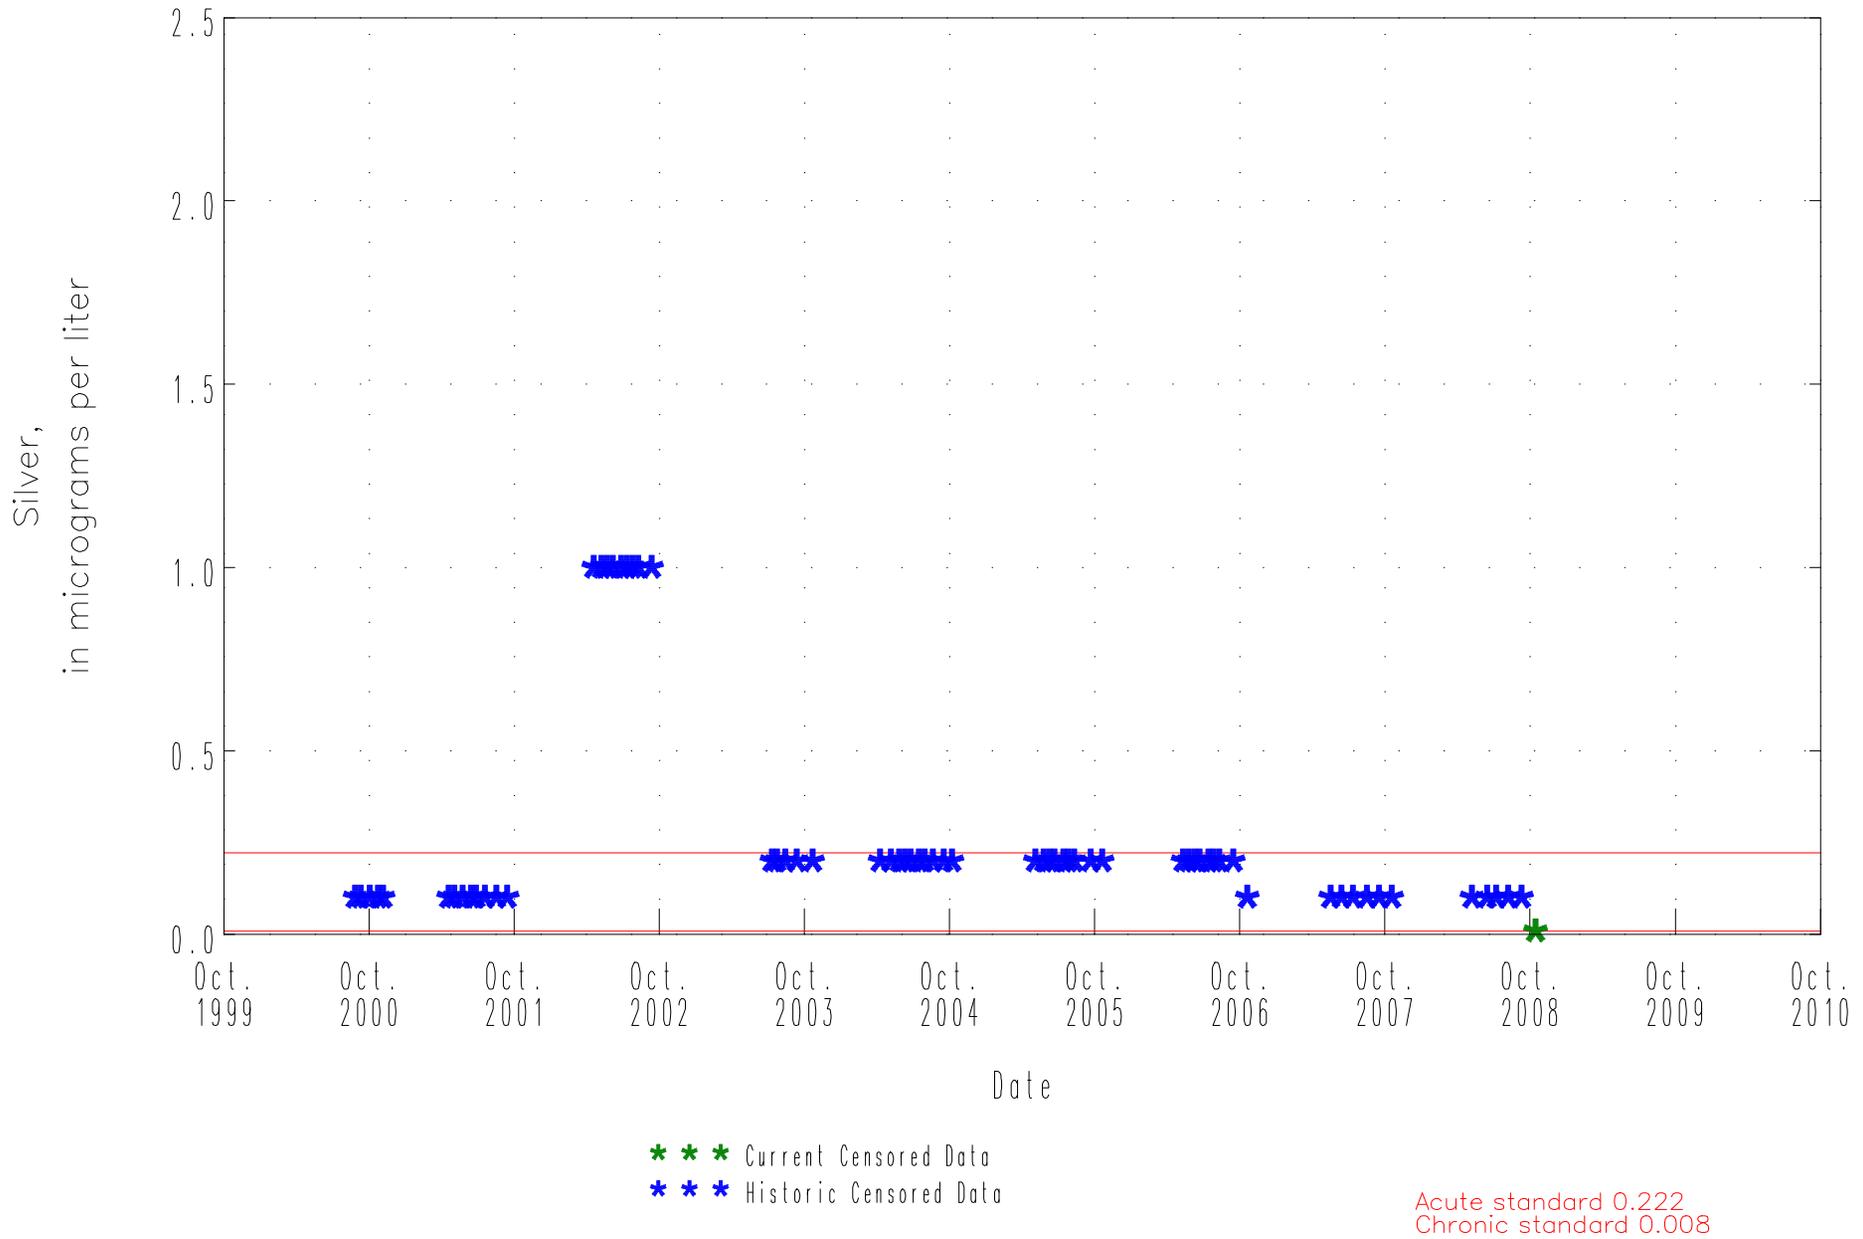


Figure 14. Distribution of selected water-quality constituents relative to time for


Hansen Canal above Greeley Filtration Plant, station 403814105111800.

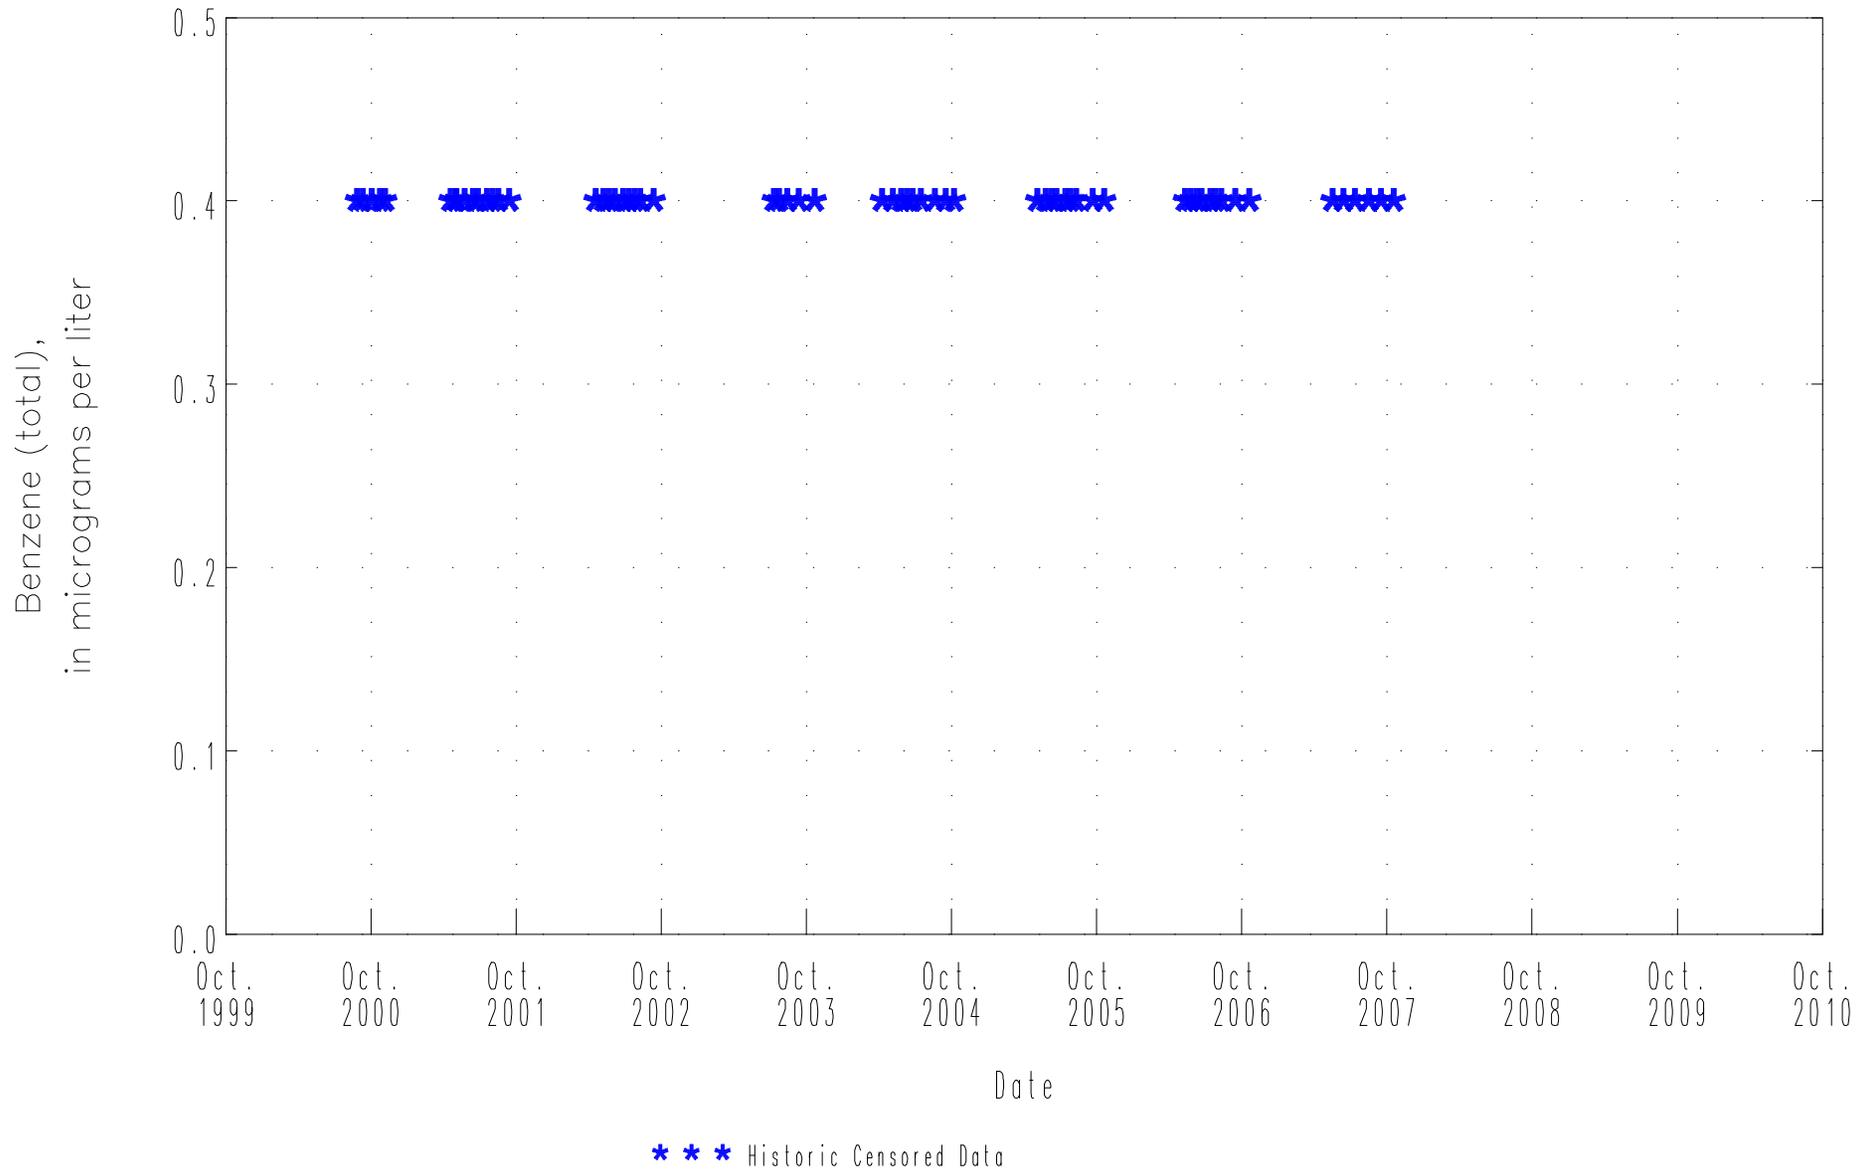

Standard 2.2

Figure 14. Distribution of selected water-quality constituents relative to time for


Hansen Canal above Greeley Filtration Plant, station 403814105111800.

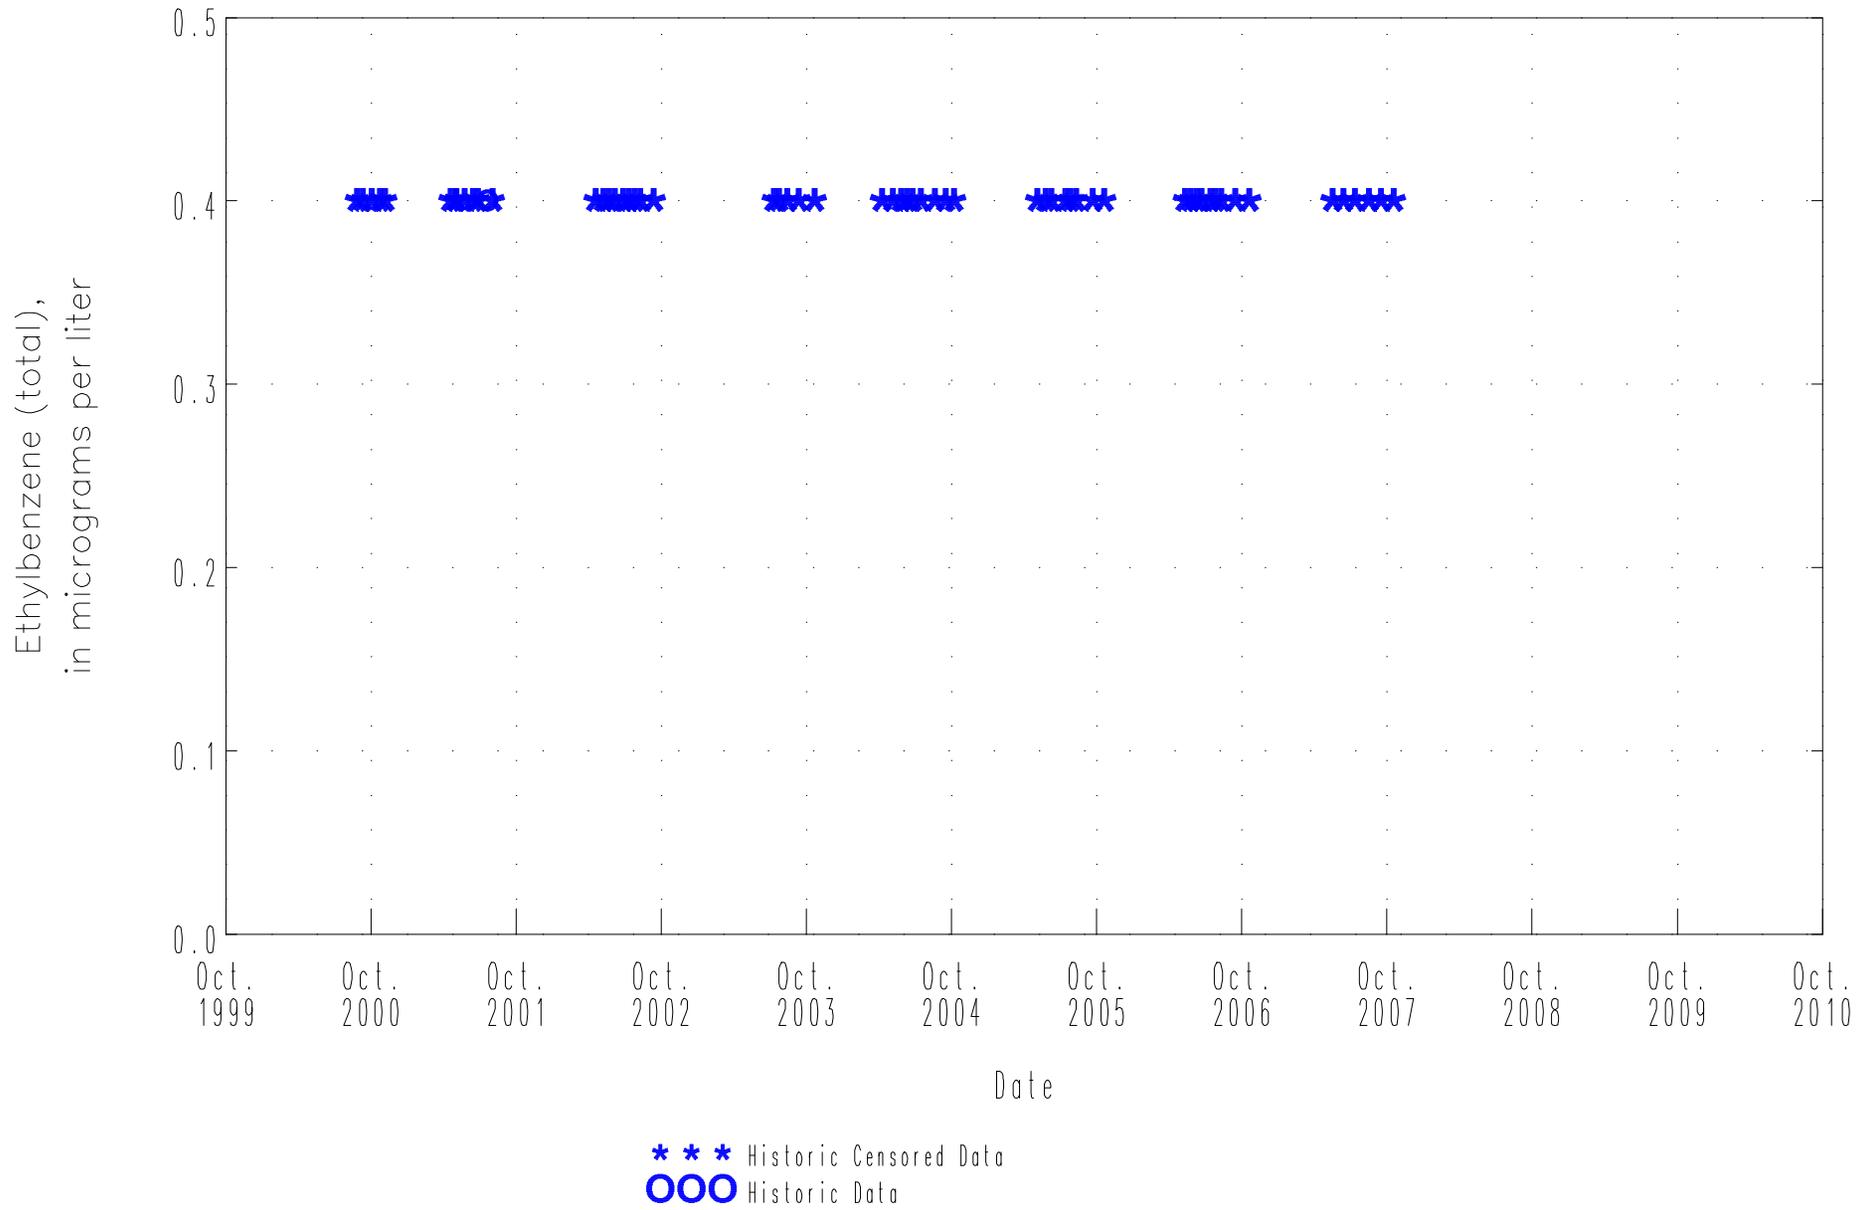

Standard 530

Figure 14. Distribution of selected water-quality constituents relative to time for


Hansen Canal above Greeley Filtration Plant, station 403814105111800.

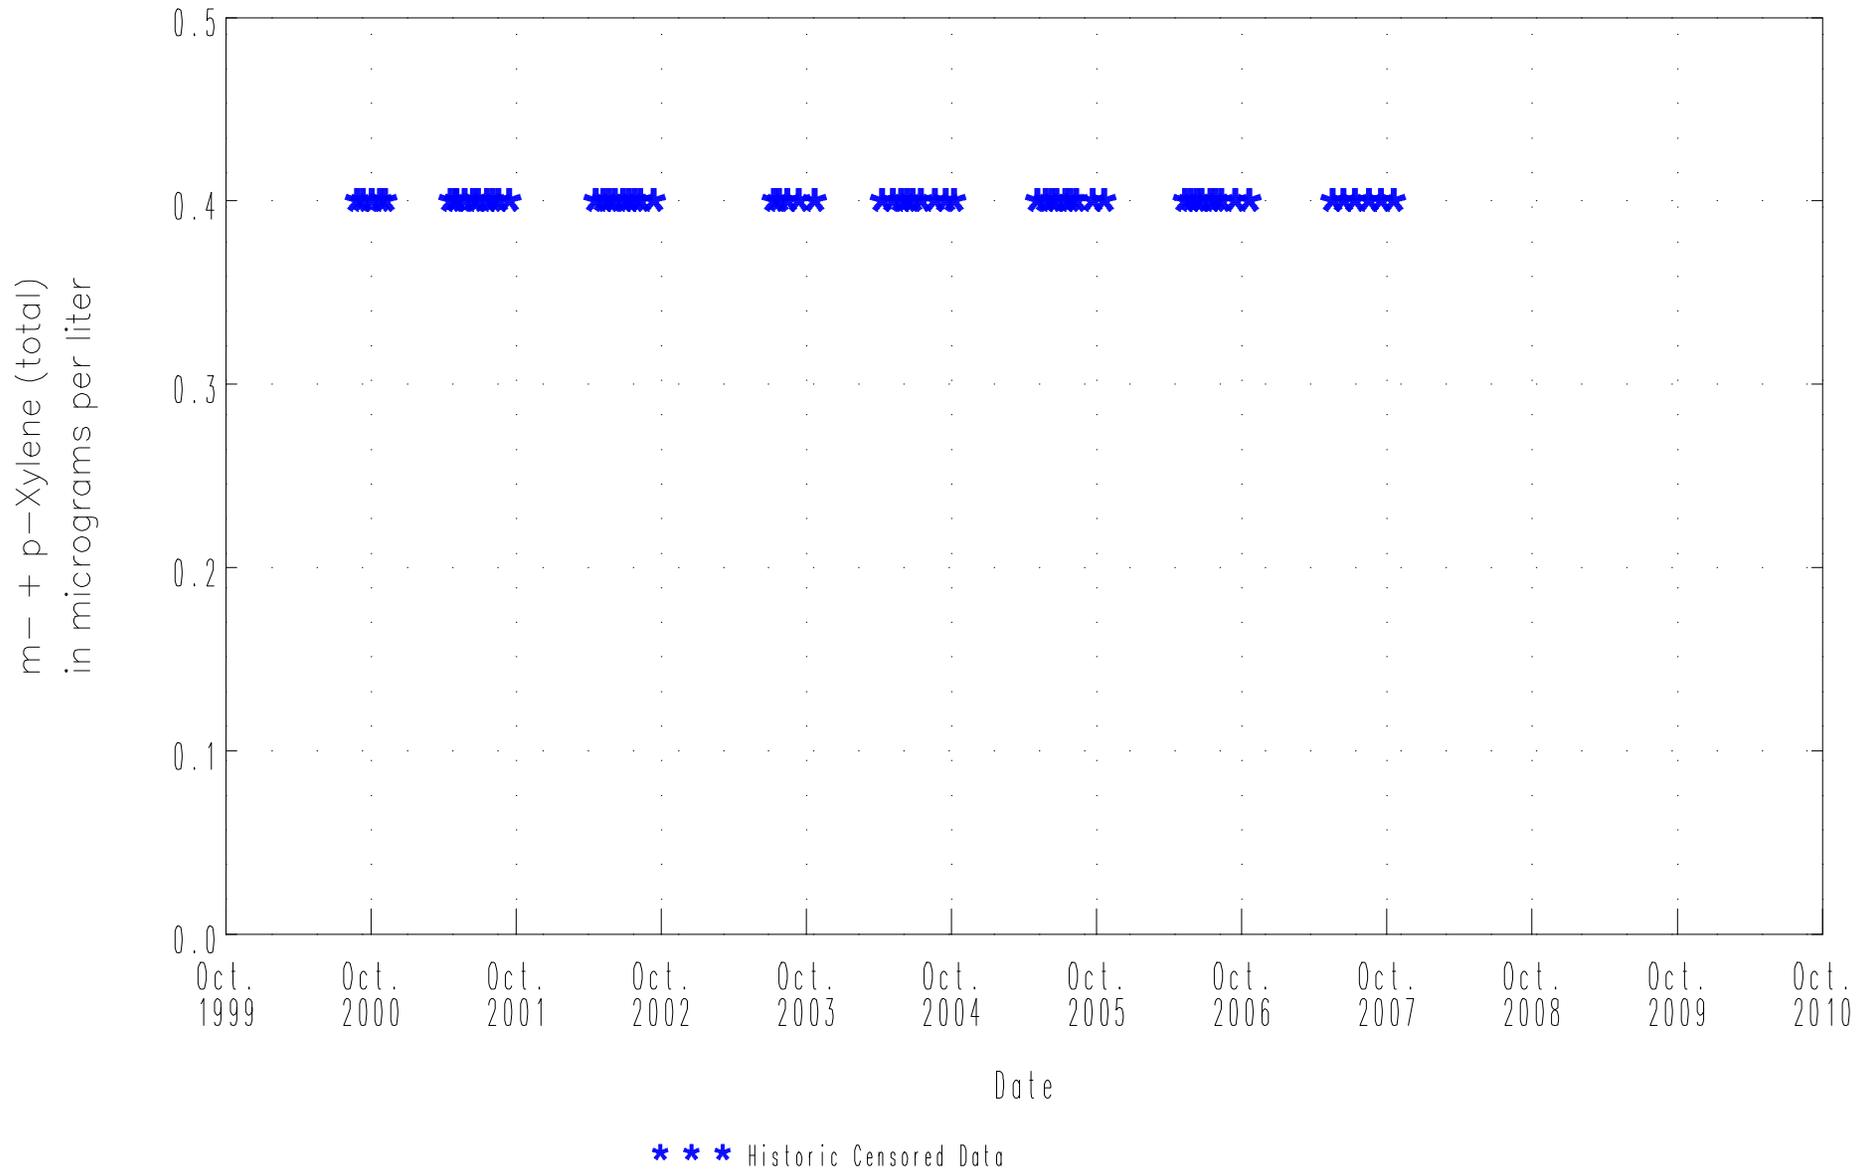

Standard 1400

Figure 14. Distribution of selected water-quality constituents relative to time for


Hansen Canal above Greeley Filtration Plant, station 403814105111800.

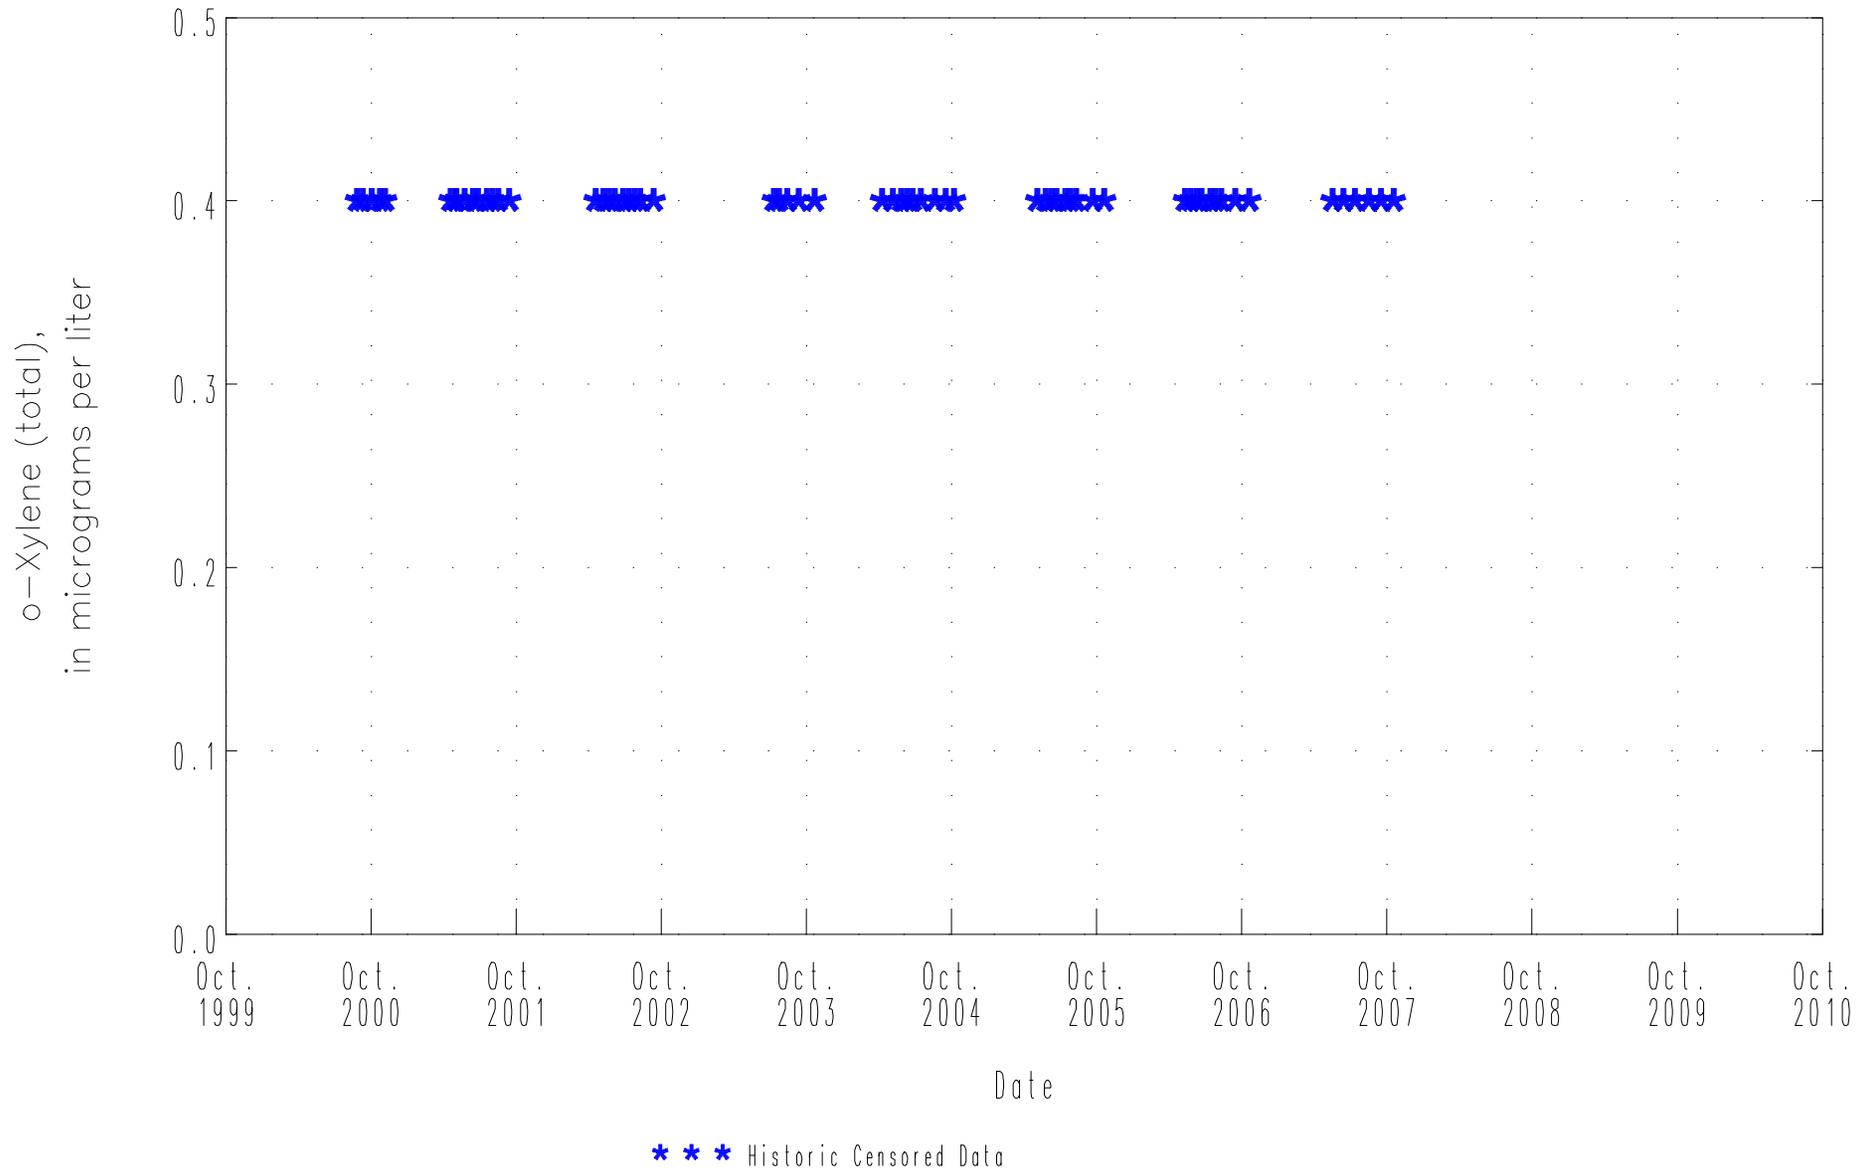

Standard 1400

Figure 14. Distribution of selected water-quality constituents relative to time for

Hansen Canal above Greeley Filtration Plant, station 403814105111800.

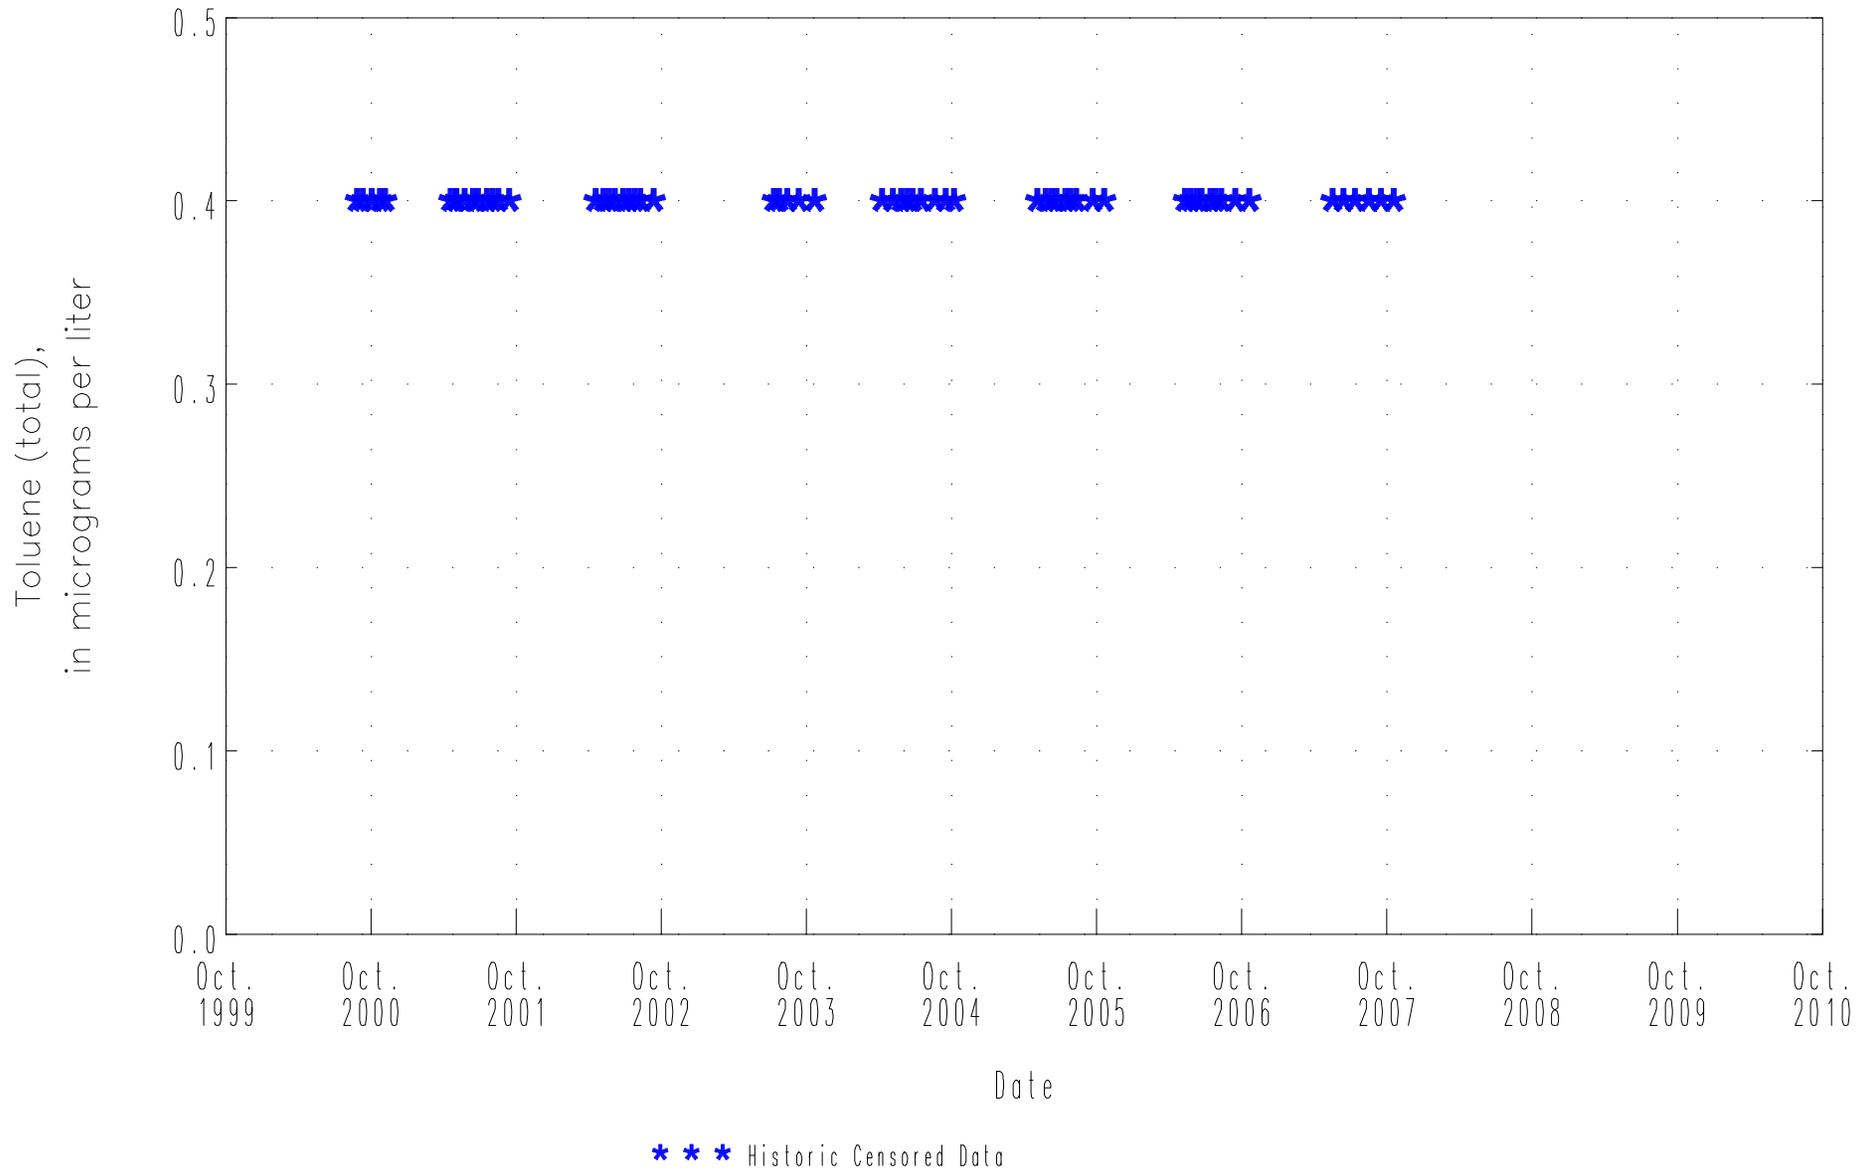

Standard 510