

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.


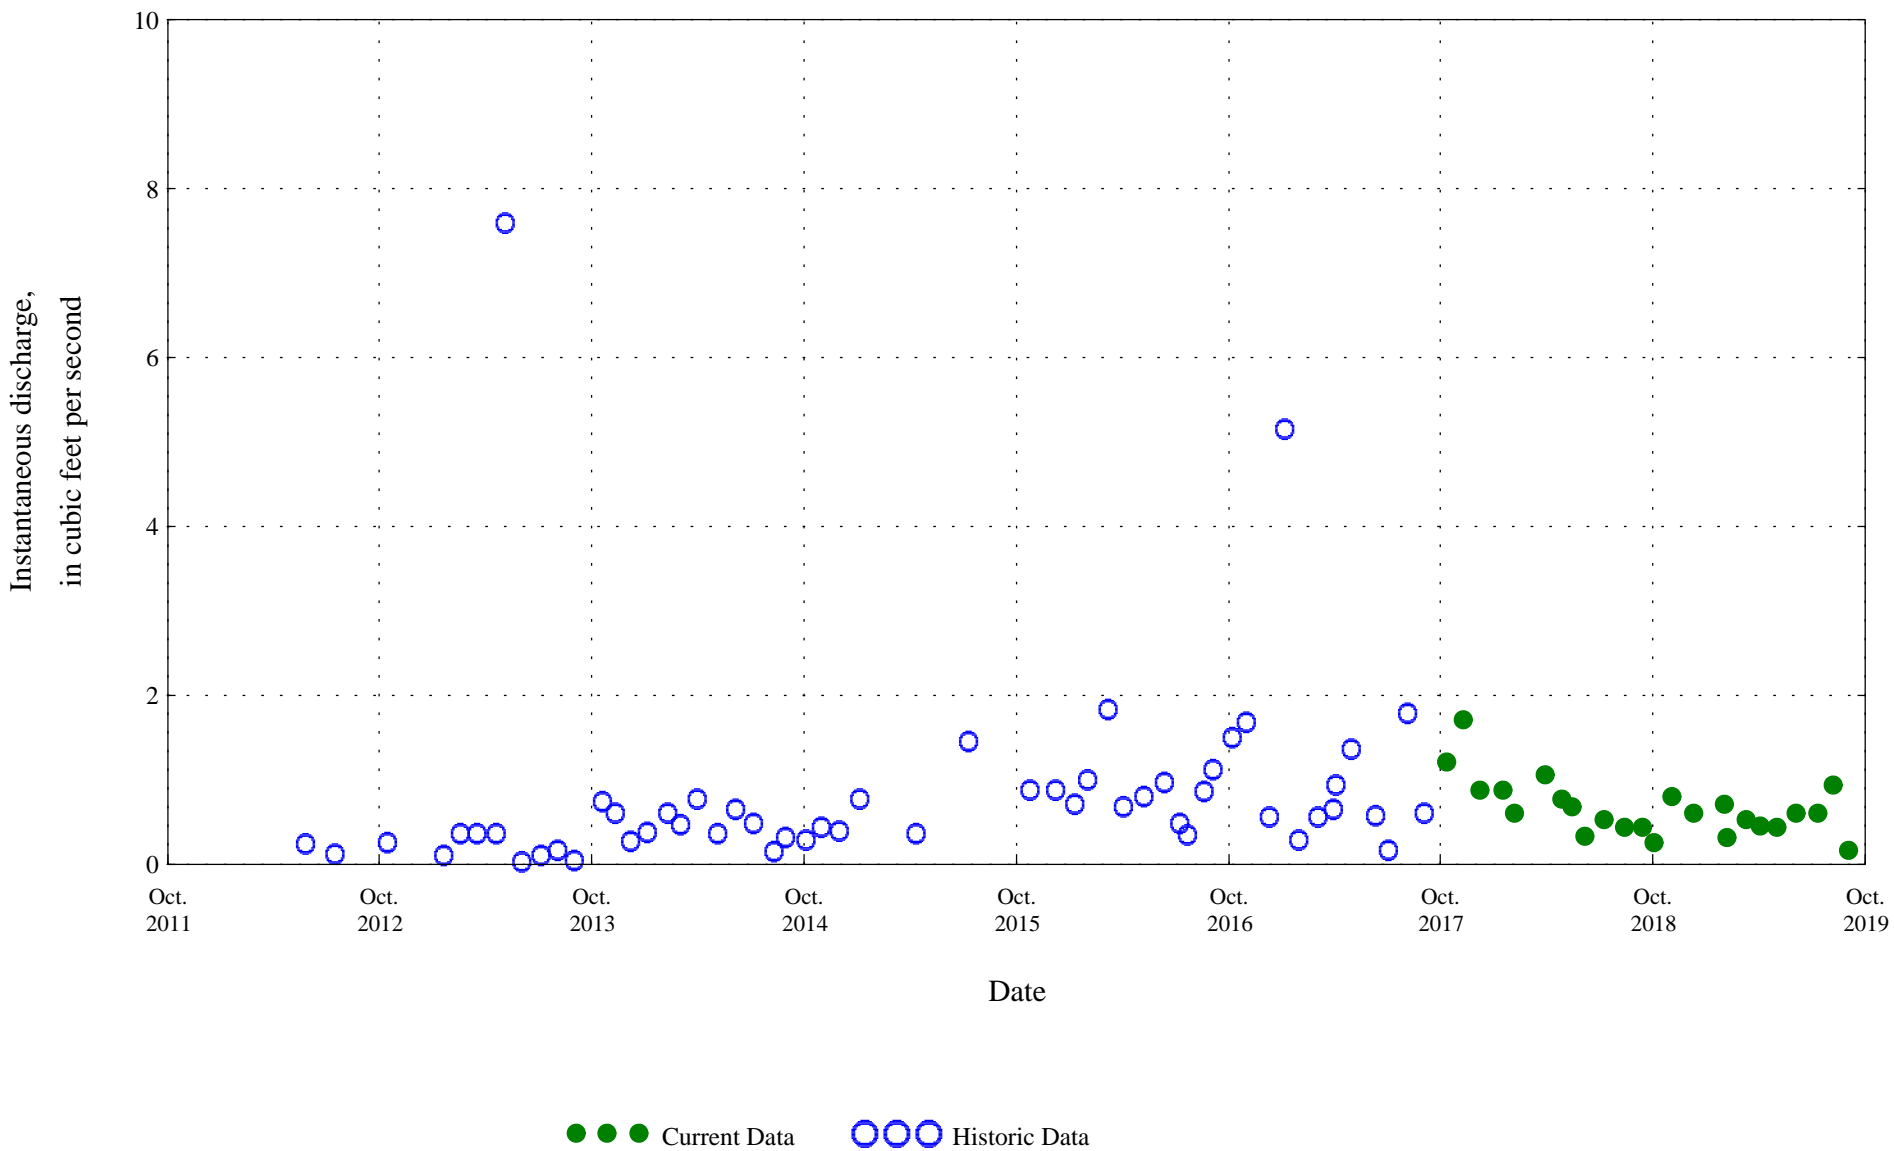


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.




Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

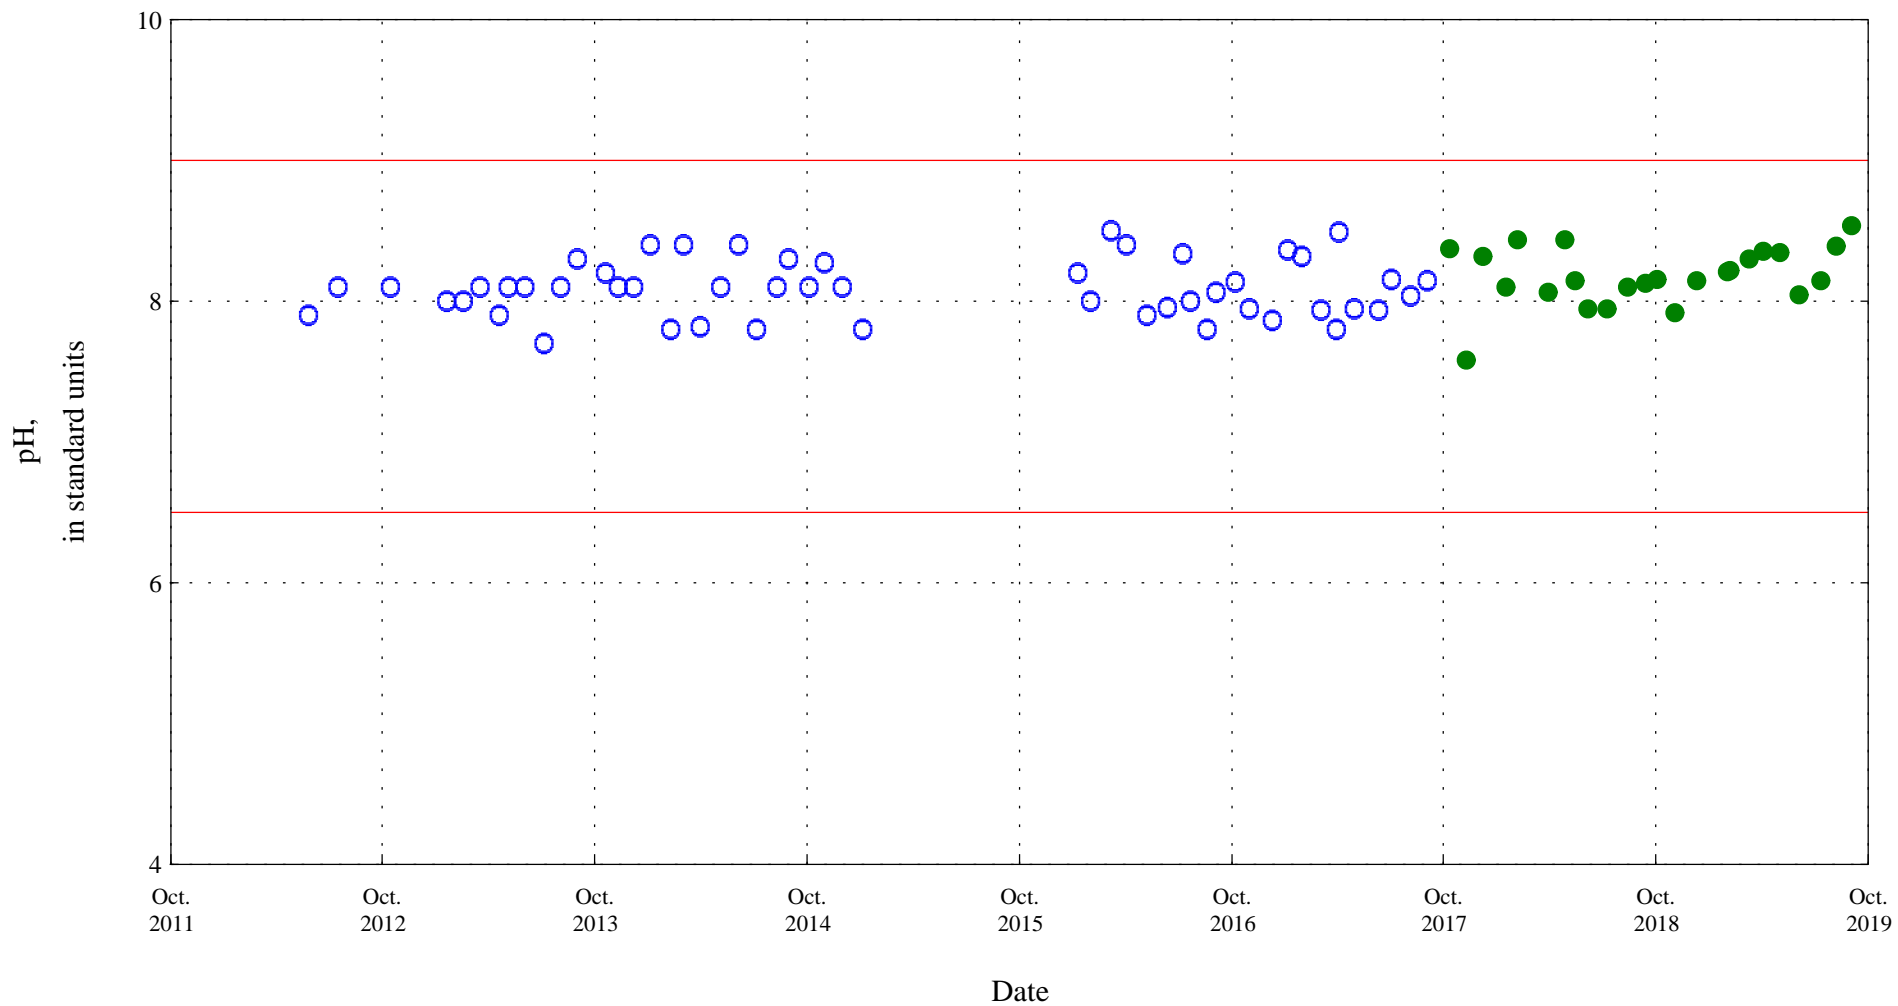

●●● Current Data ○○○ Historic Data

Aquatic Life Standard 6.5 to 9.0

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

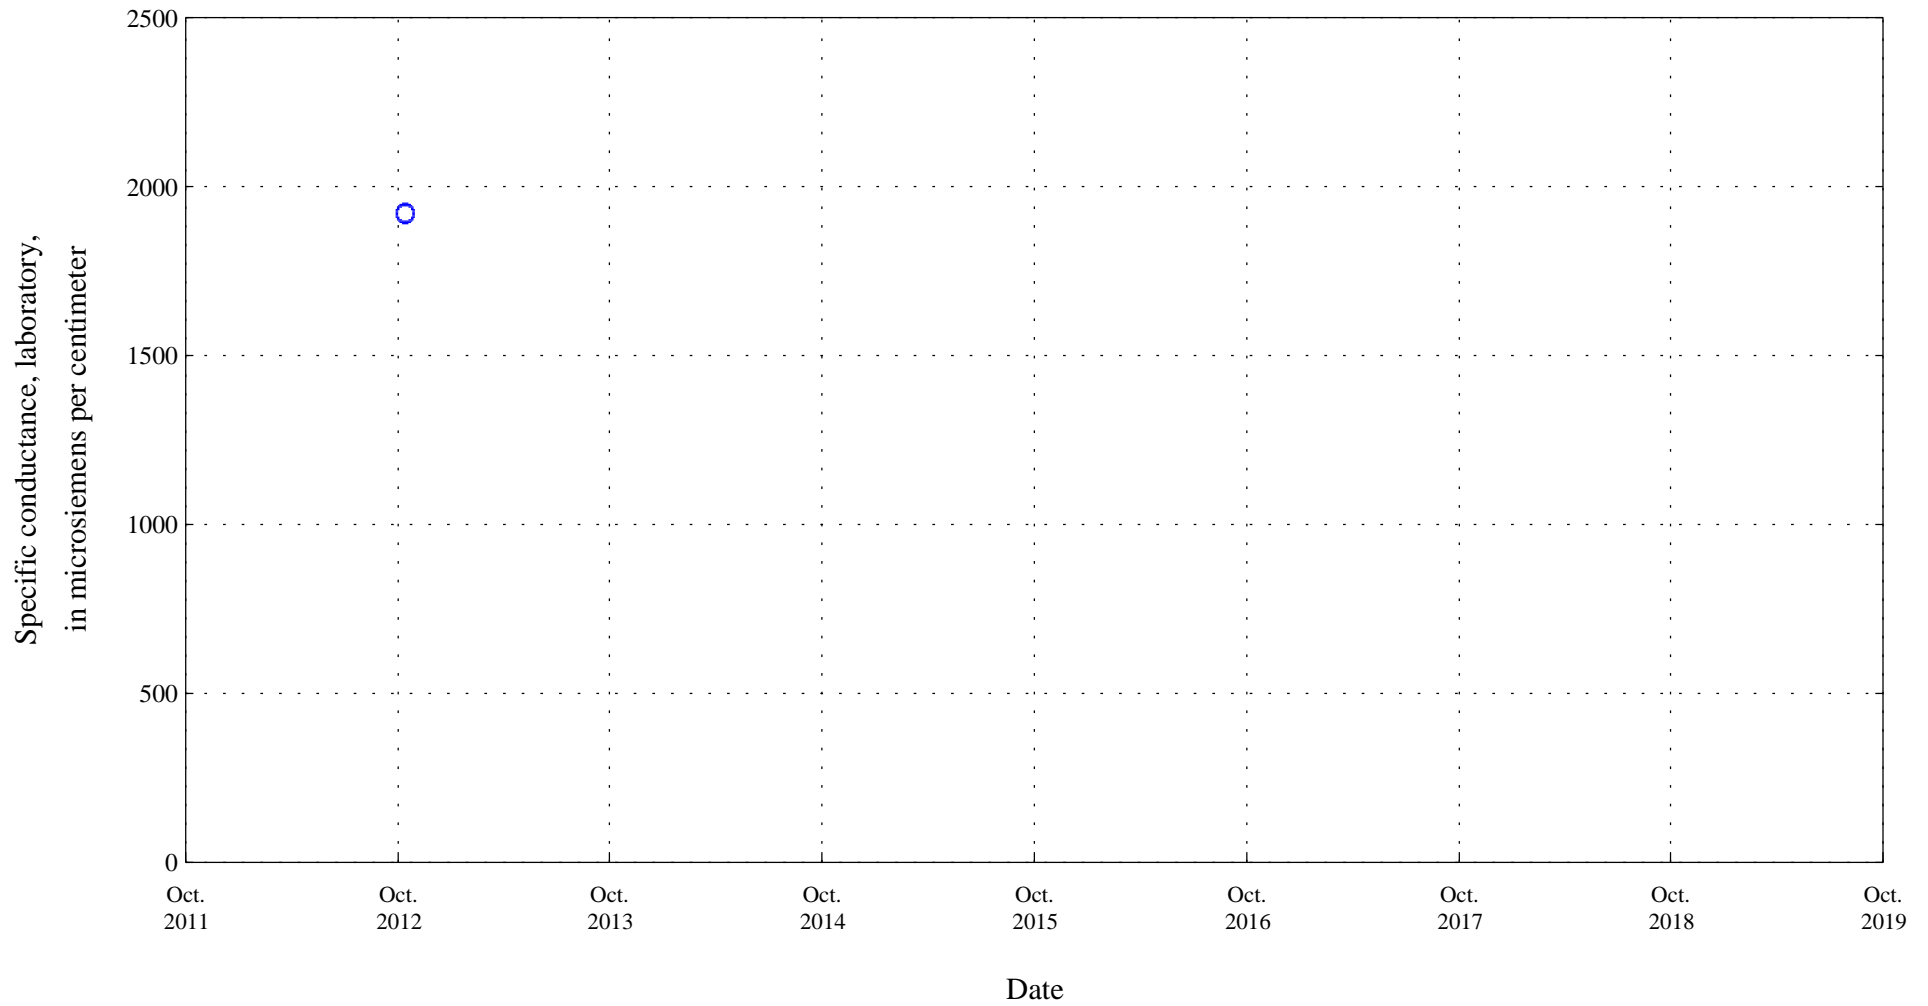

○ ○ ○ Historic Data

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.


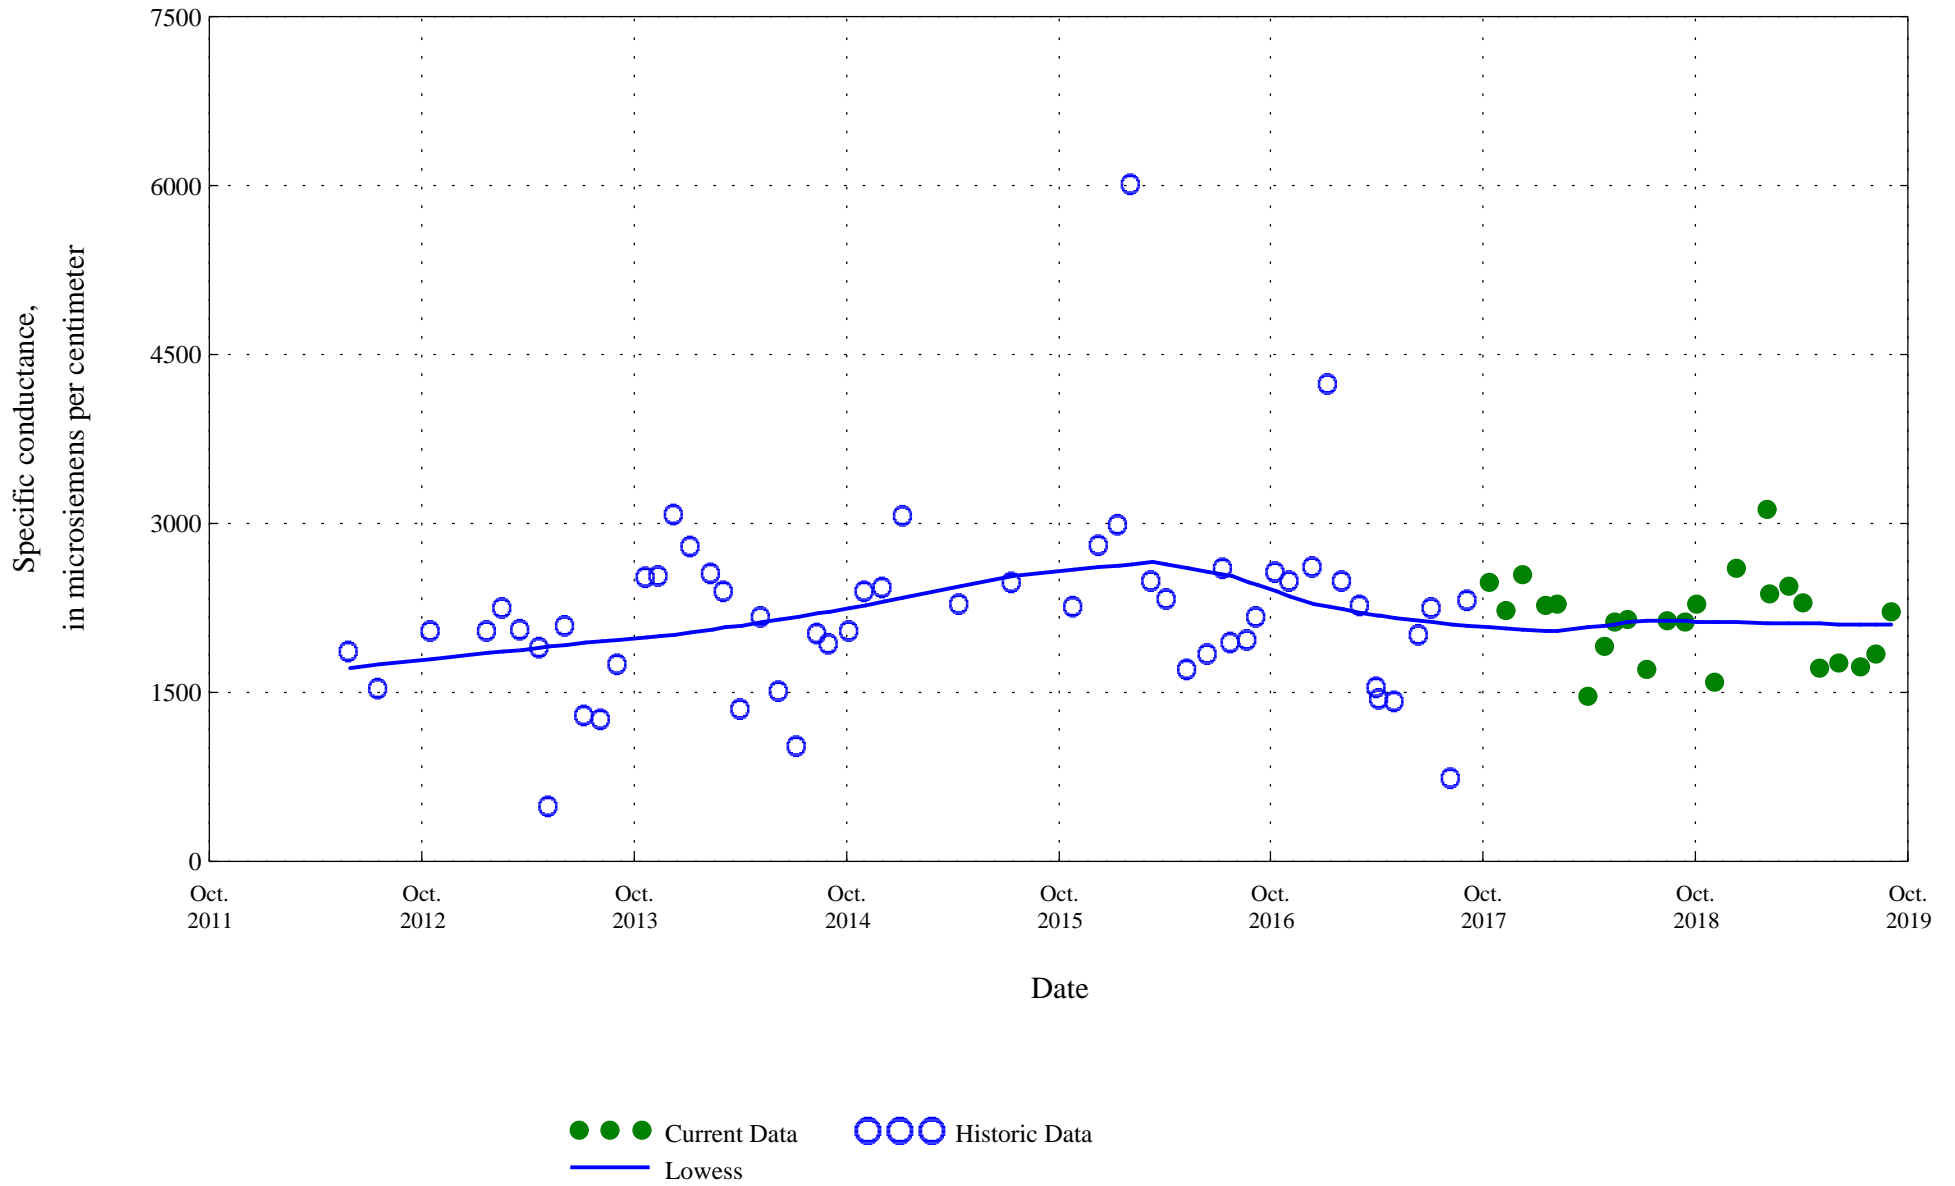



Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

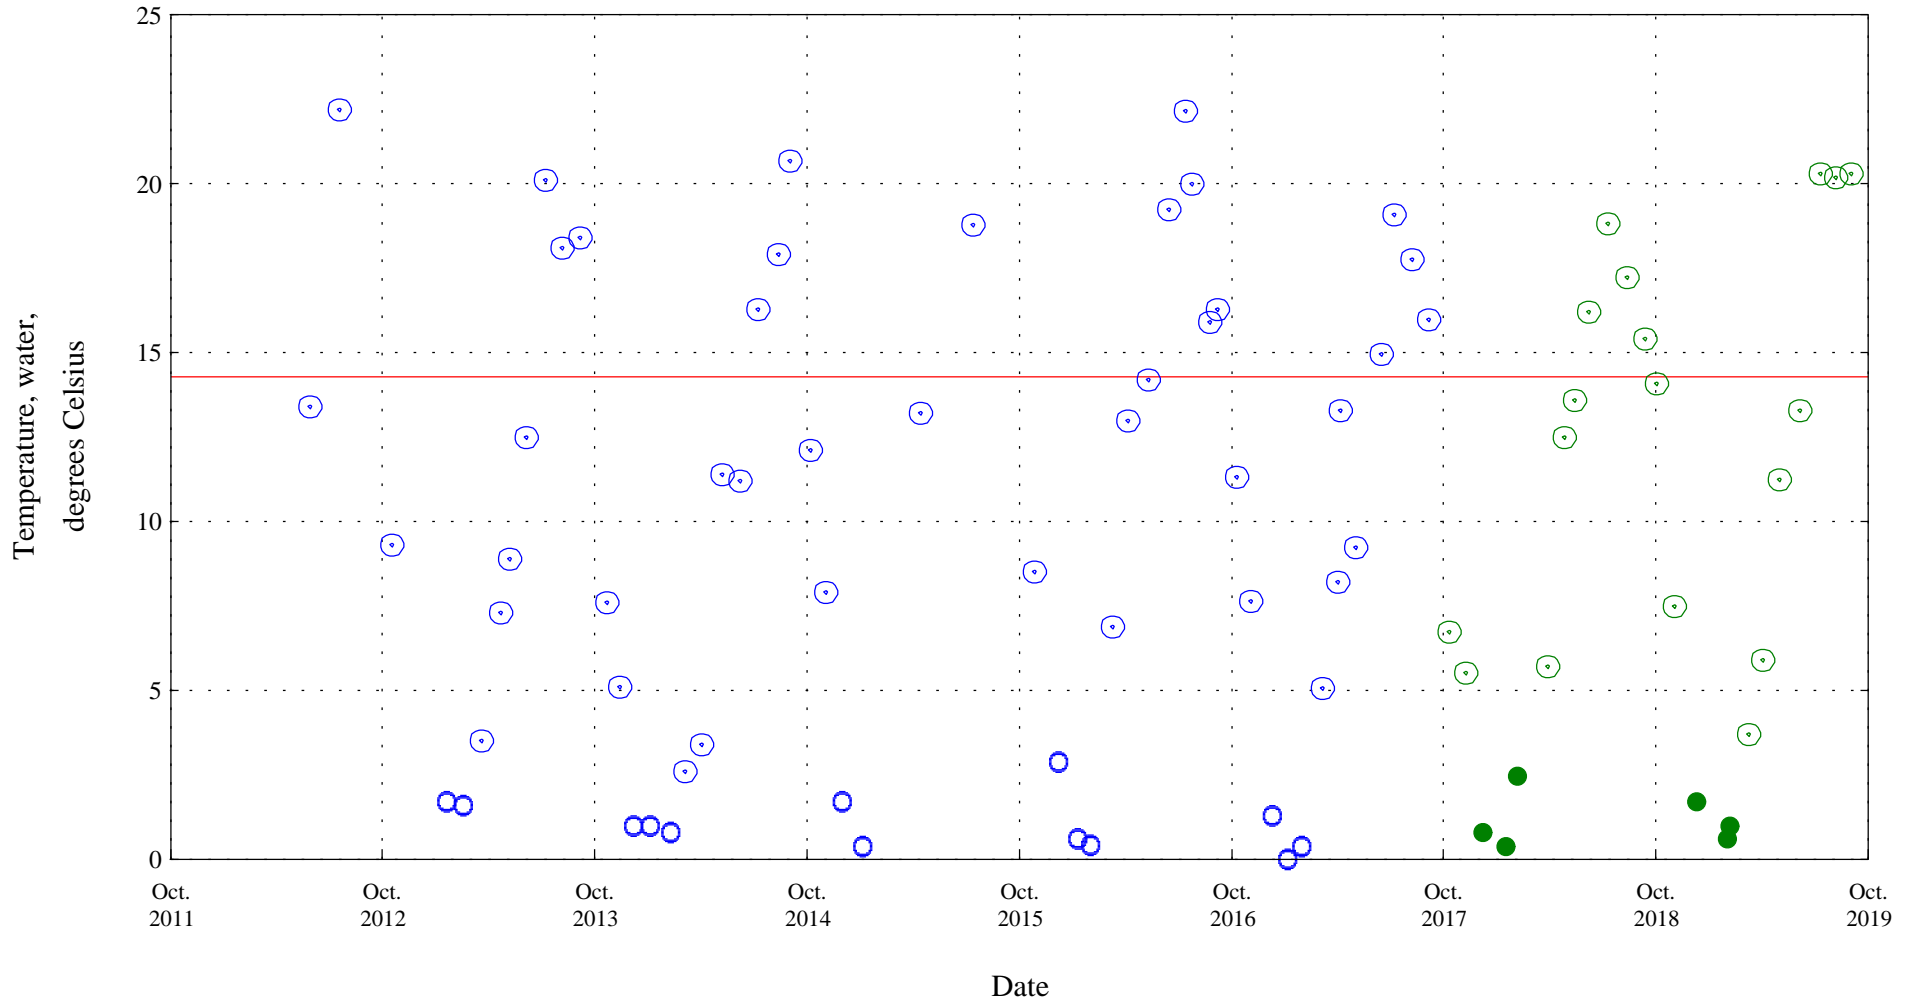

- ● ● Current Data, Cool Season Std
- ○ ○ Historic Data, Cool Season Std
- ○ ○ Current Data, Warm Season Std
- ○ ○ Historic Data, Warm Season Std


Aquatic Life Dec - Feb, Cool Season Std 14.3  
 Aquatic Life Mar - Nov, Warm Season Std 28.6

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

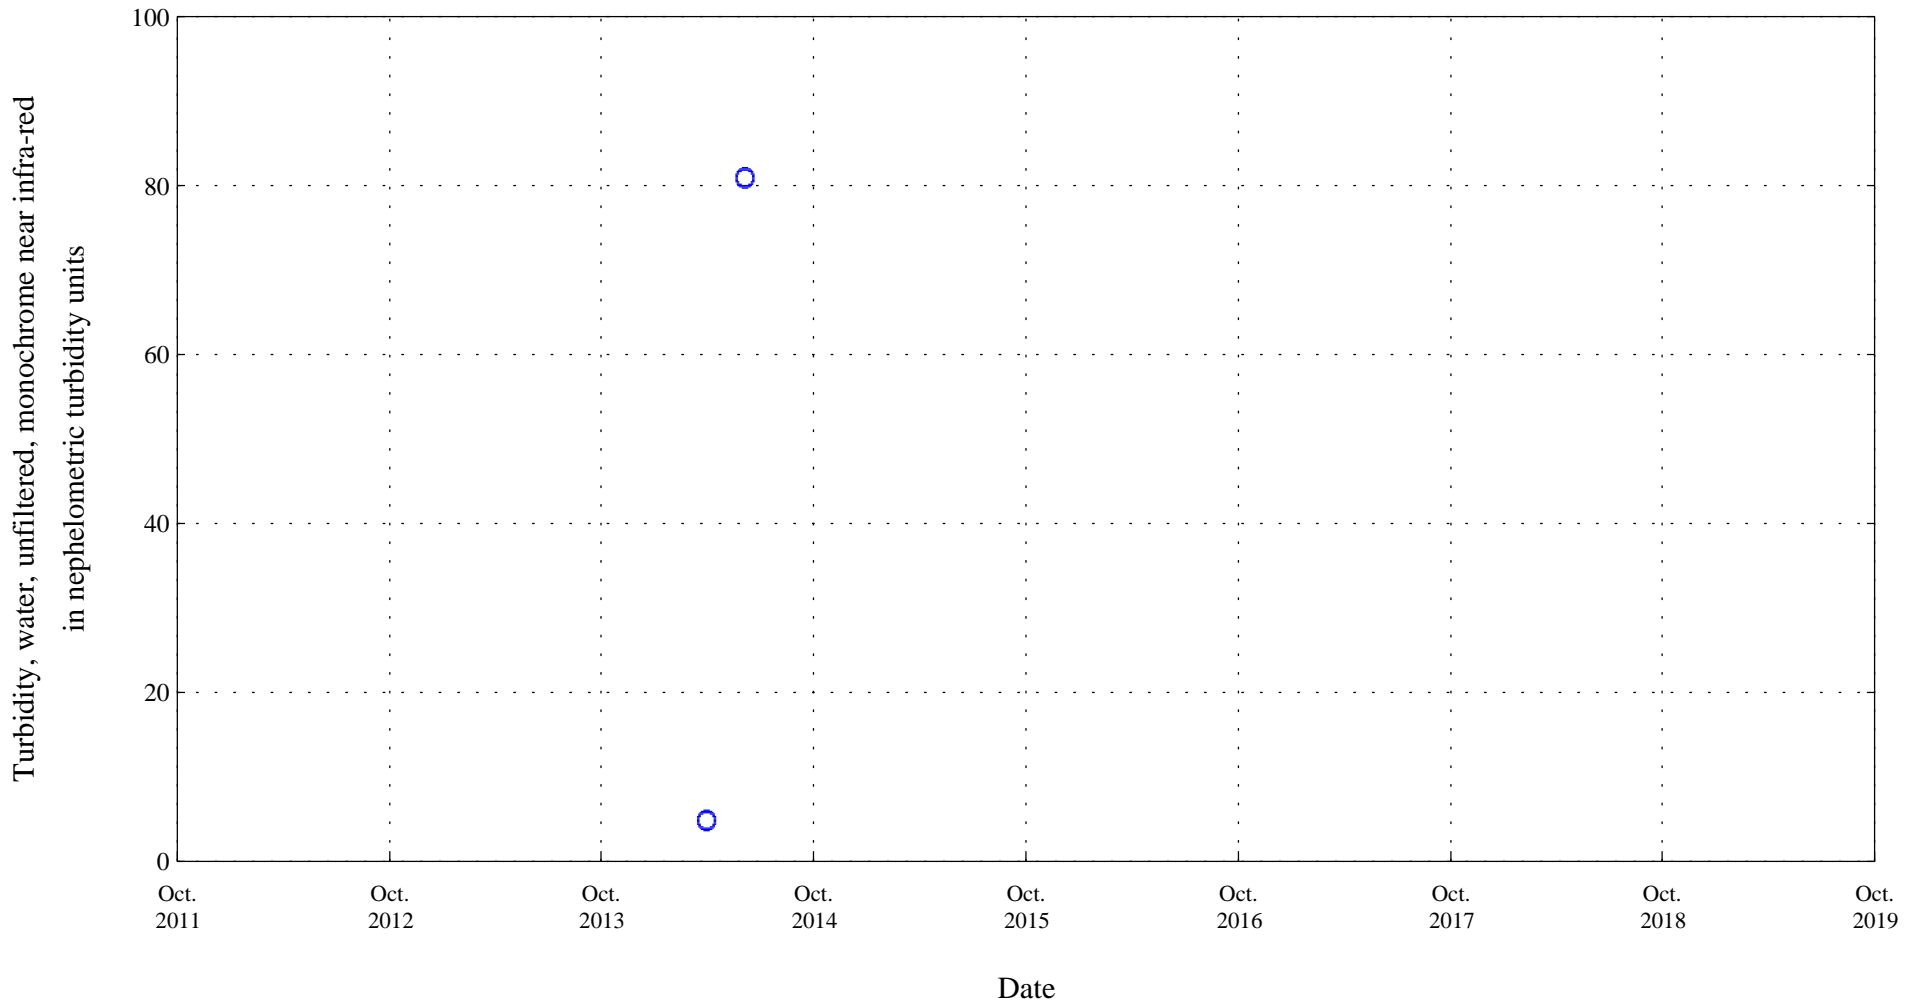

○ ○ ○ Historic Data

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

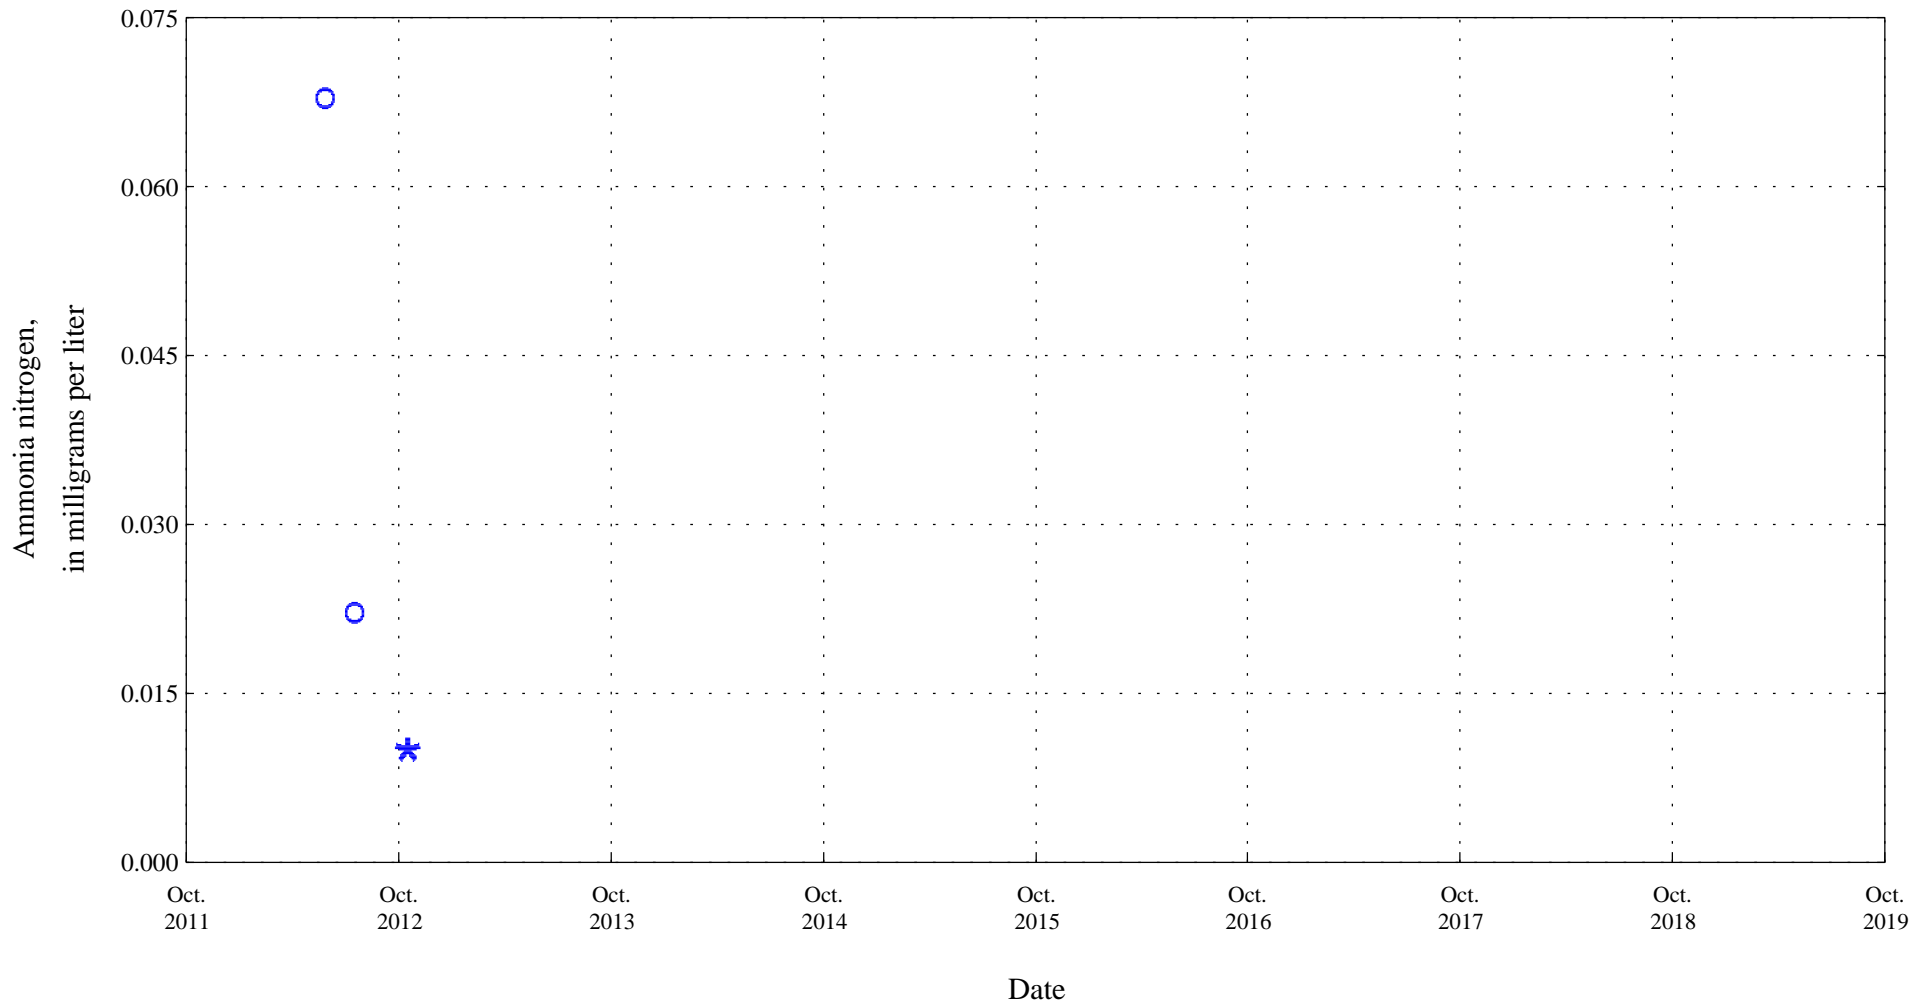


\* \* \* Historic Censored Data      ○ ○ ○ Historic Data

Aquatic Life Acute Standard 5.3  
Aquatic Life Chronic Standard 2.1




Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

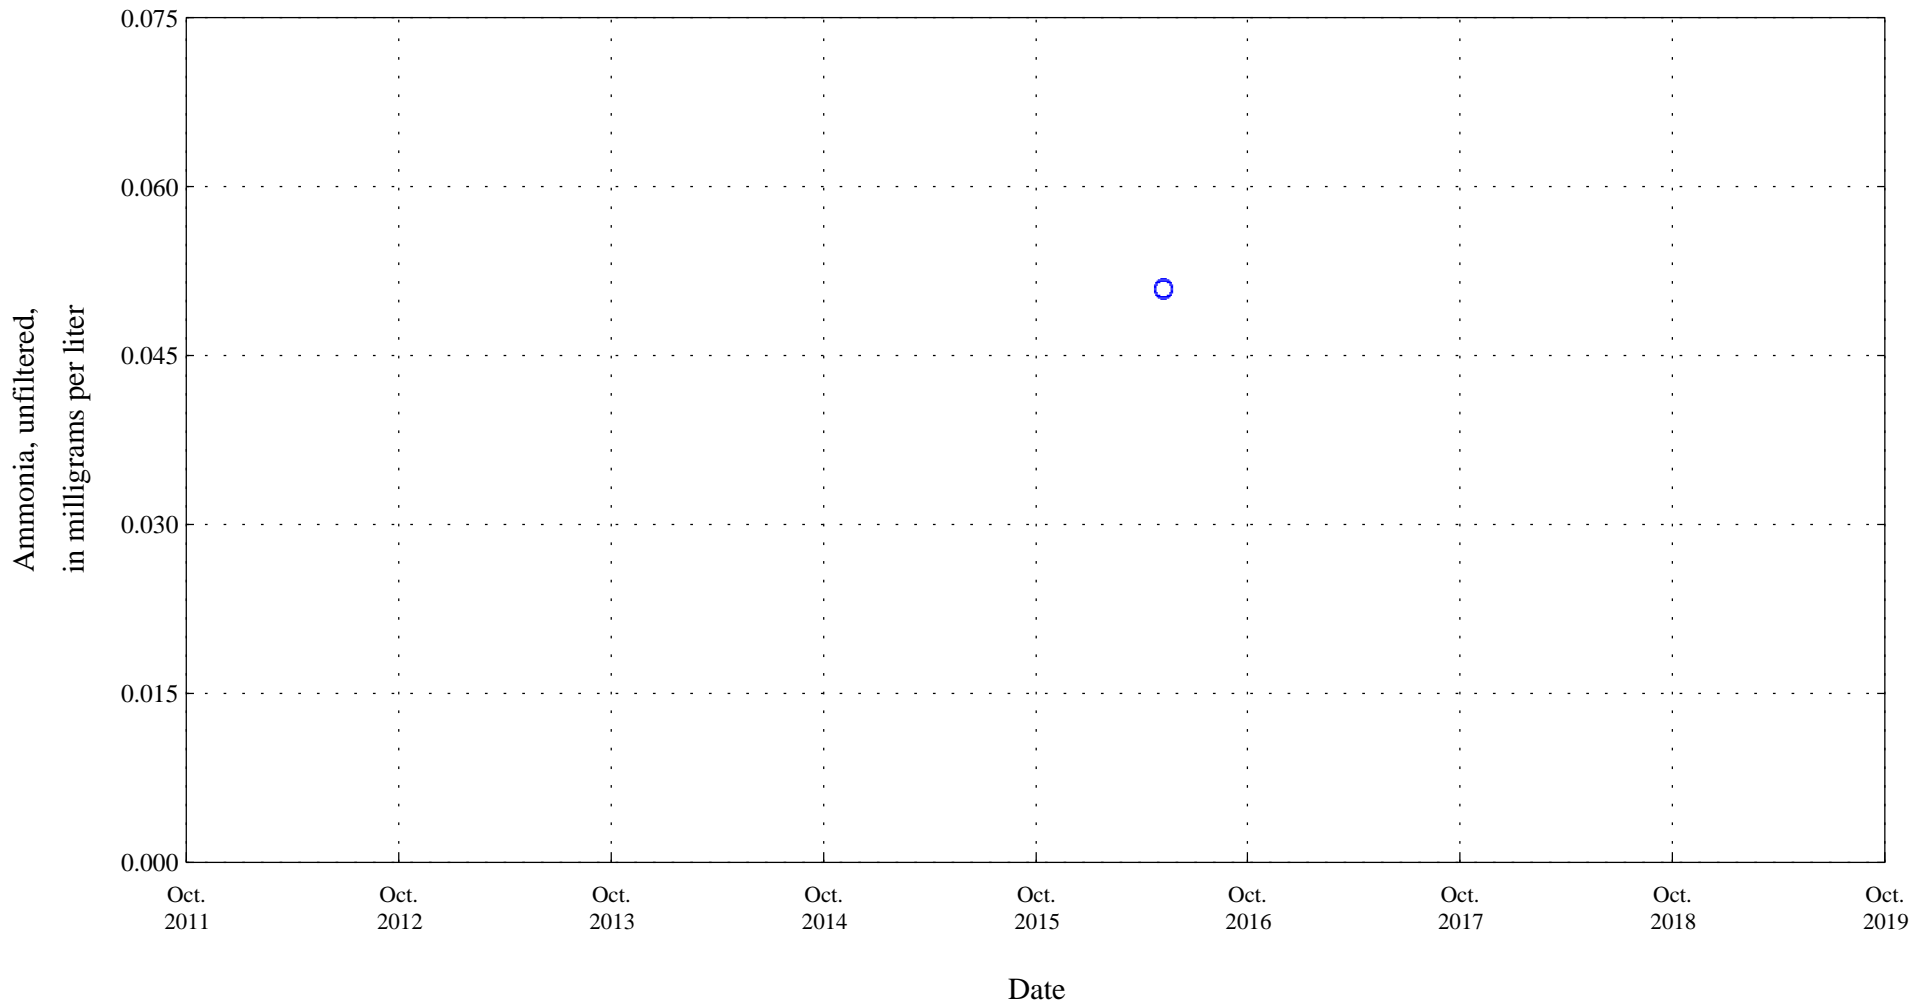

○ ○ ○ Historic Data


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

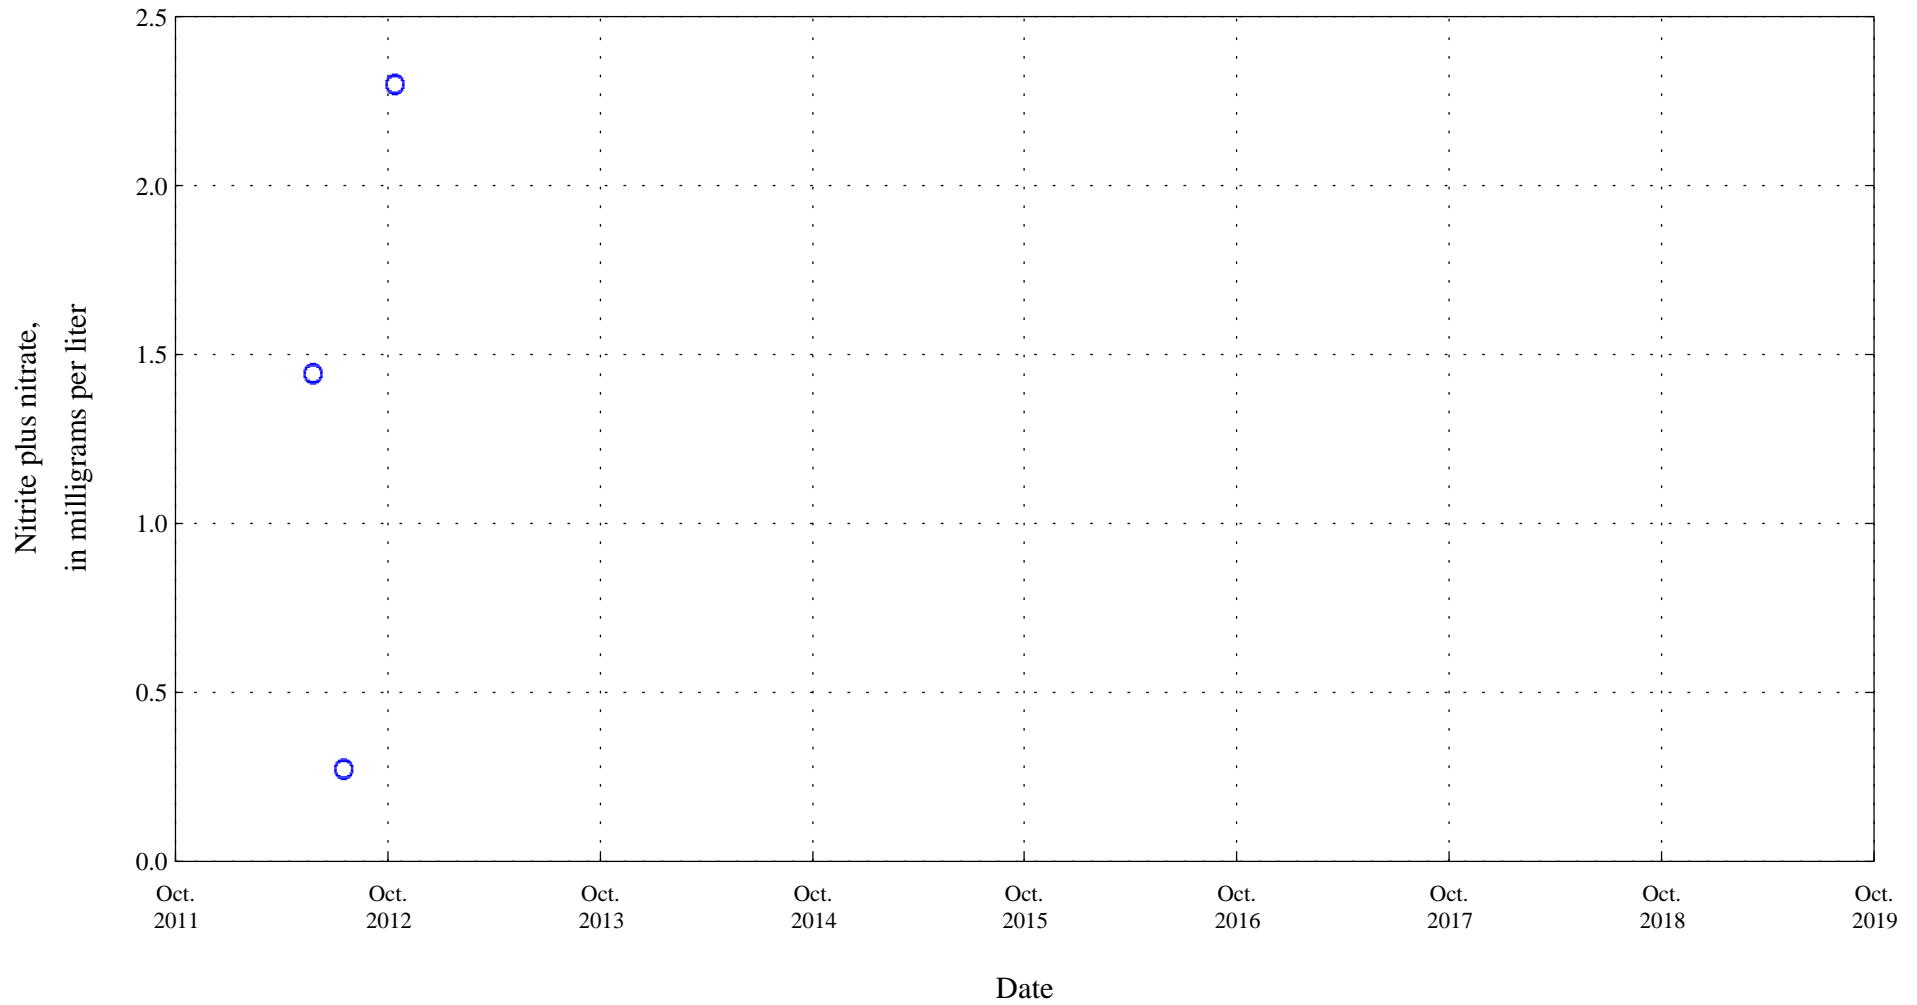

○ ○ ○ Historic Data

Human Health Based Water Supply Acute Standard 10.0

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

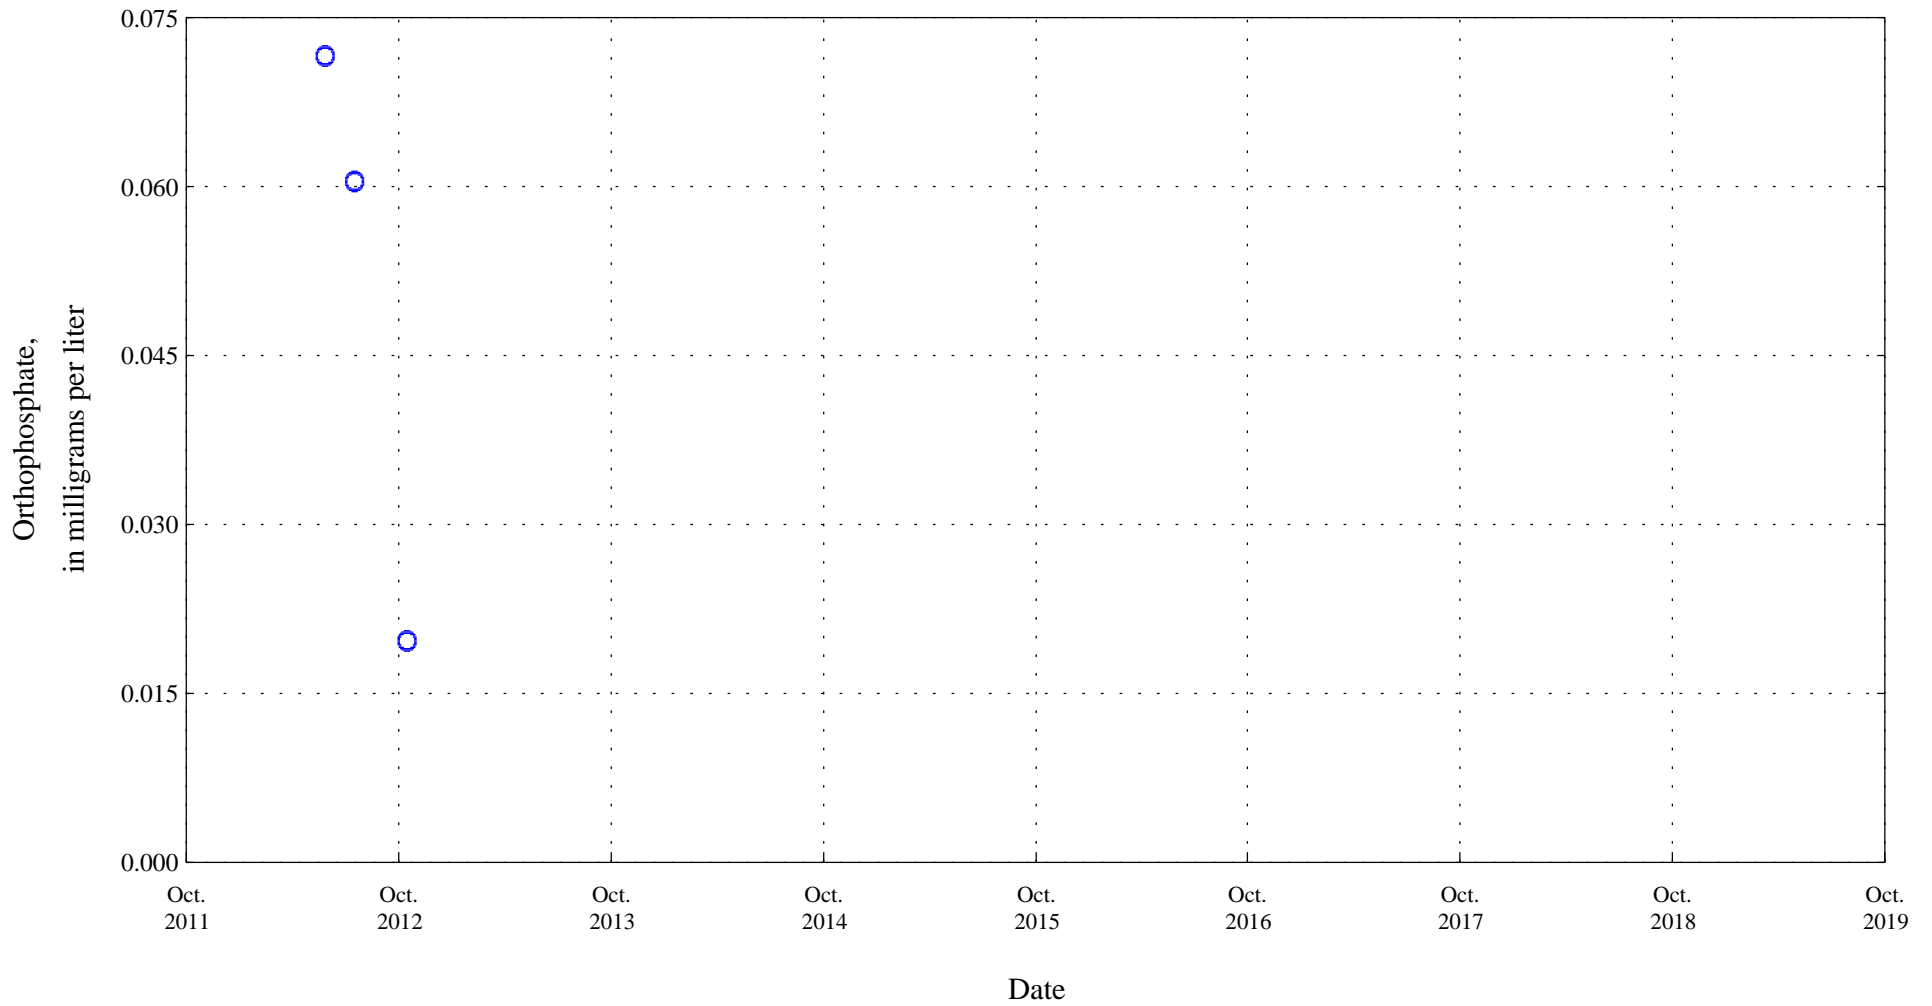

○ ○ ○ Historic Data

Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

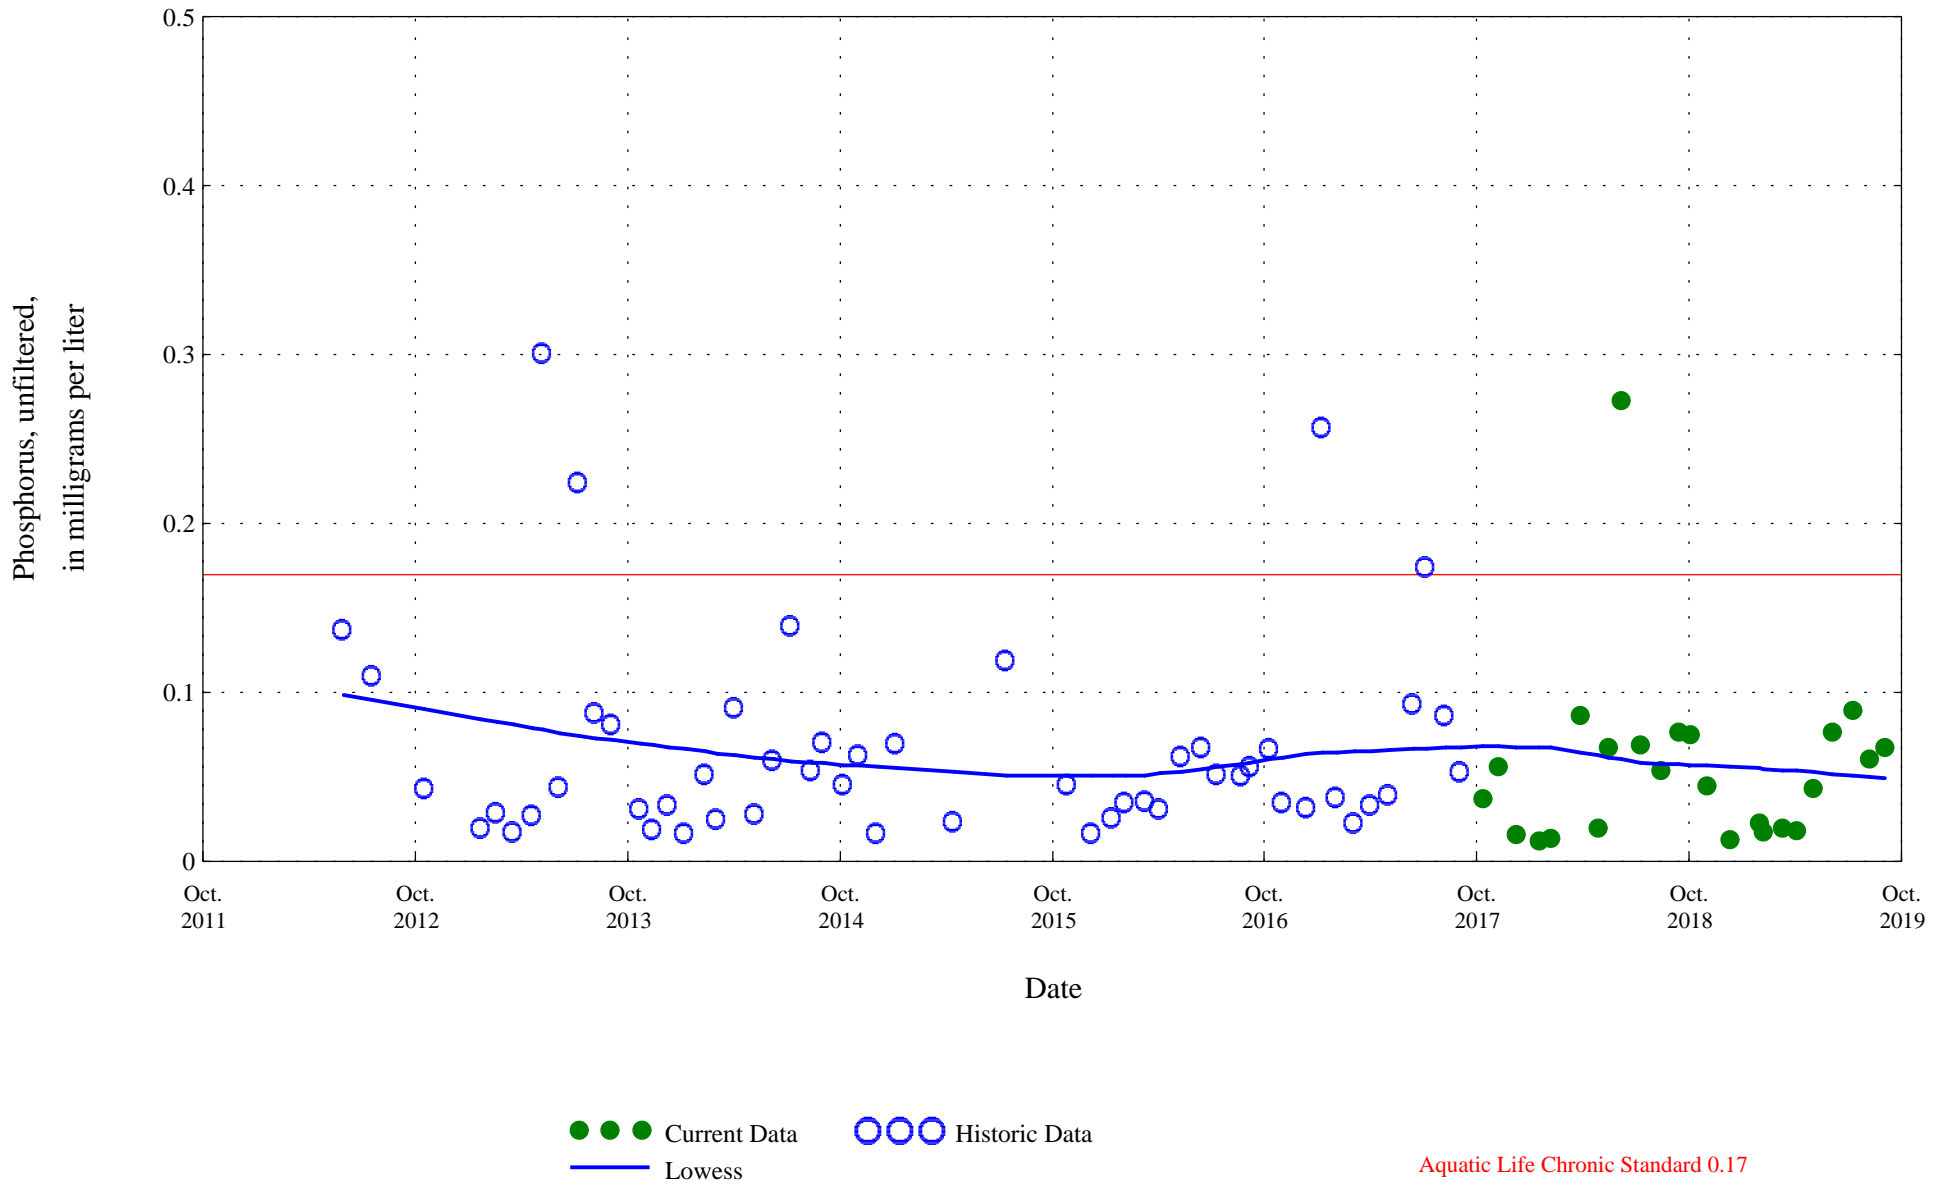


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

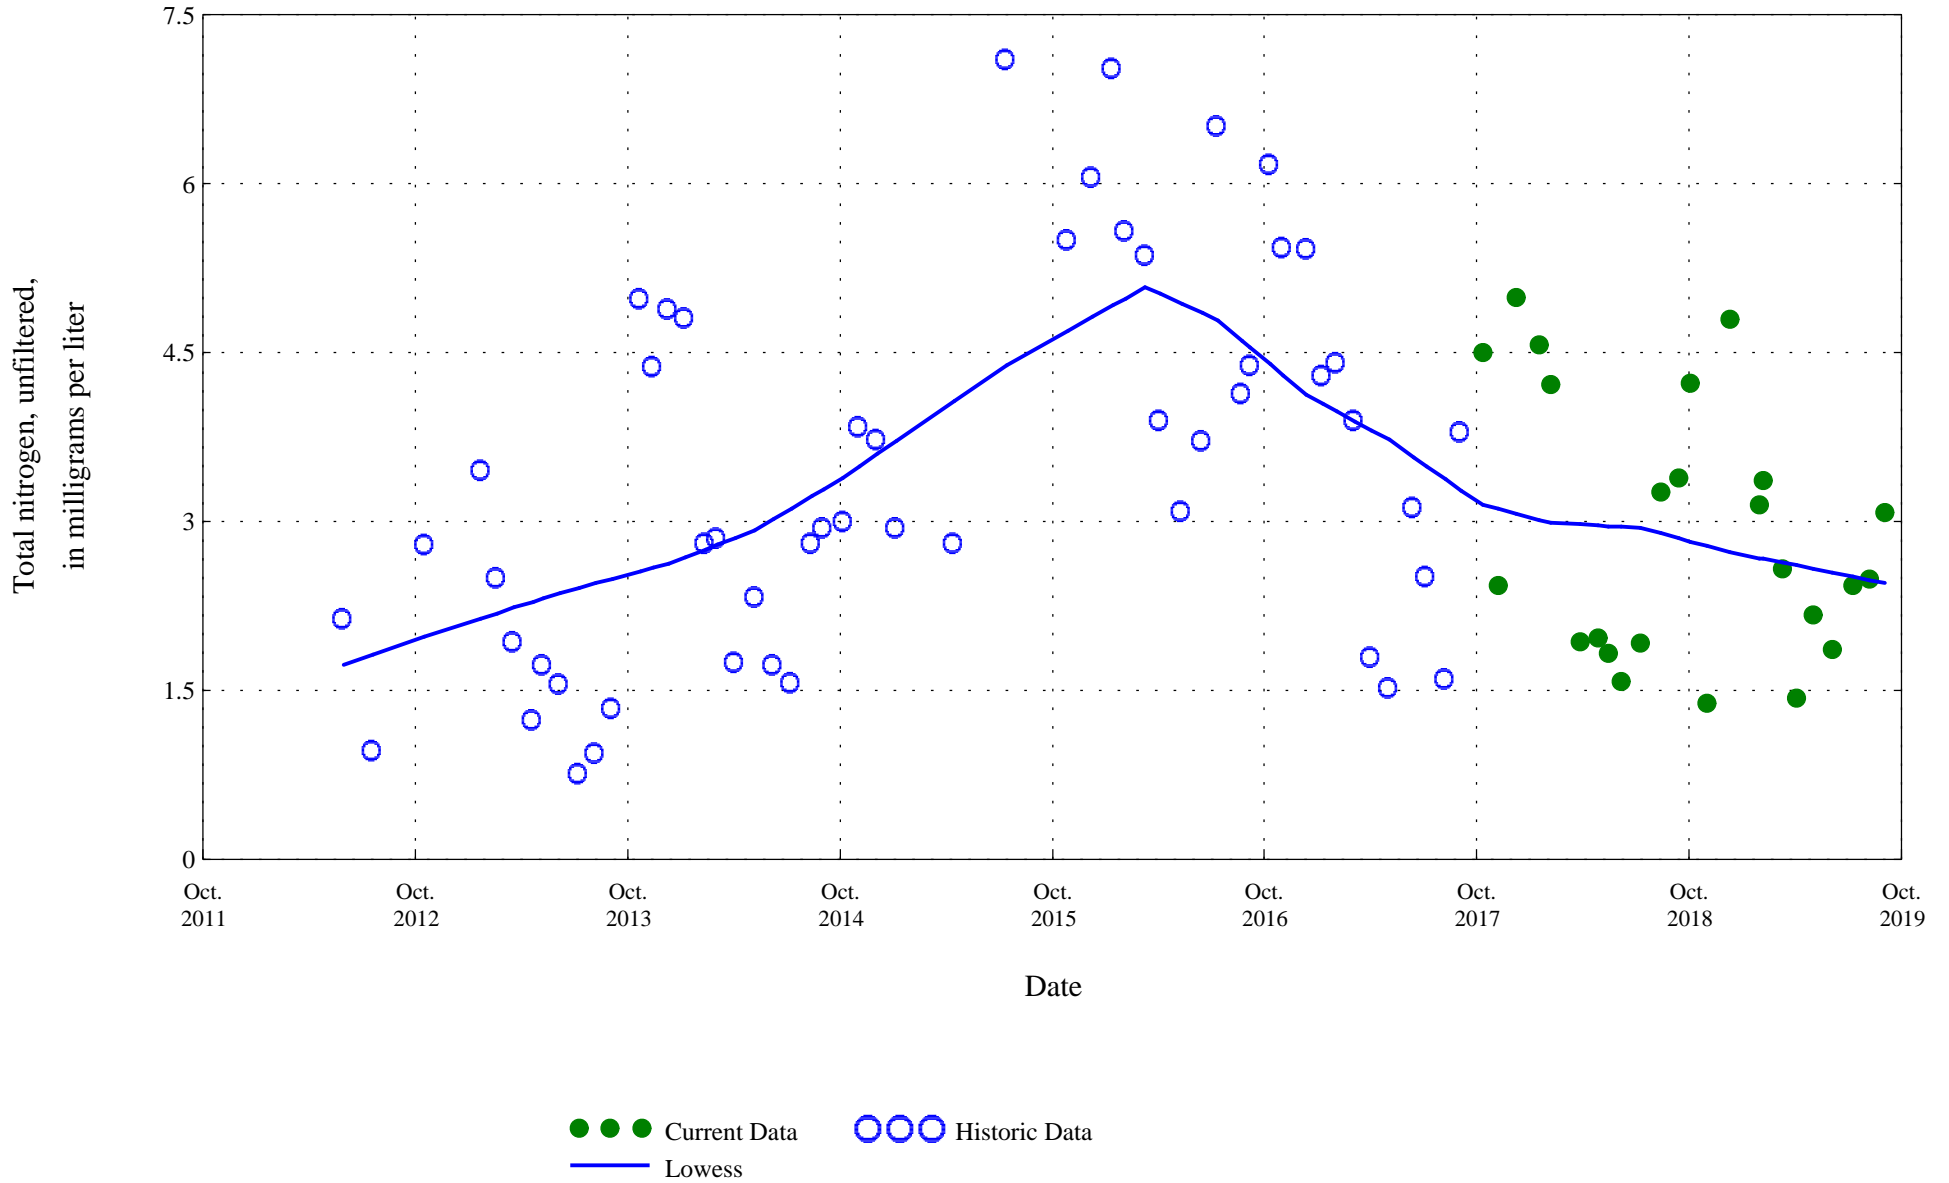


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

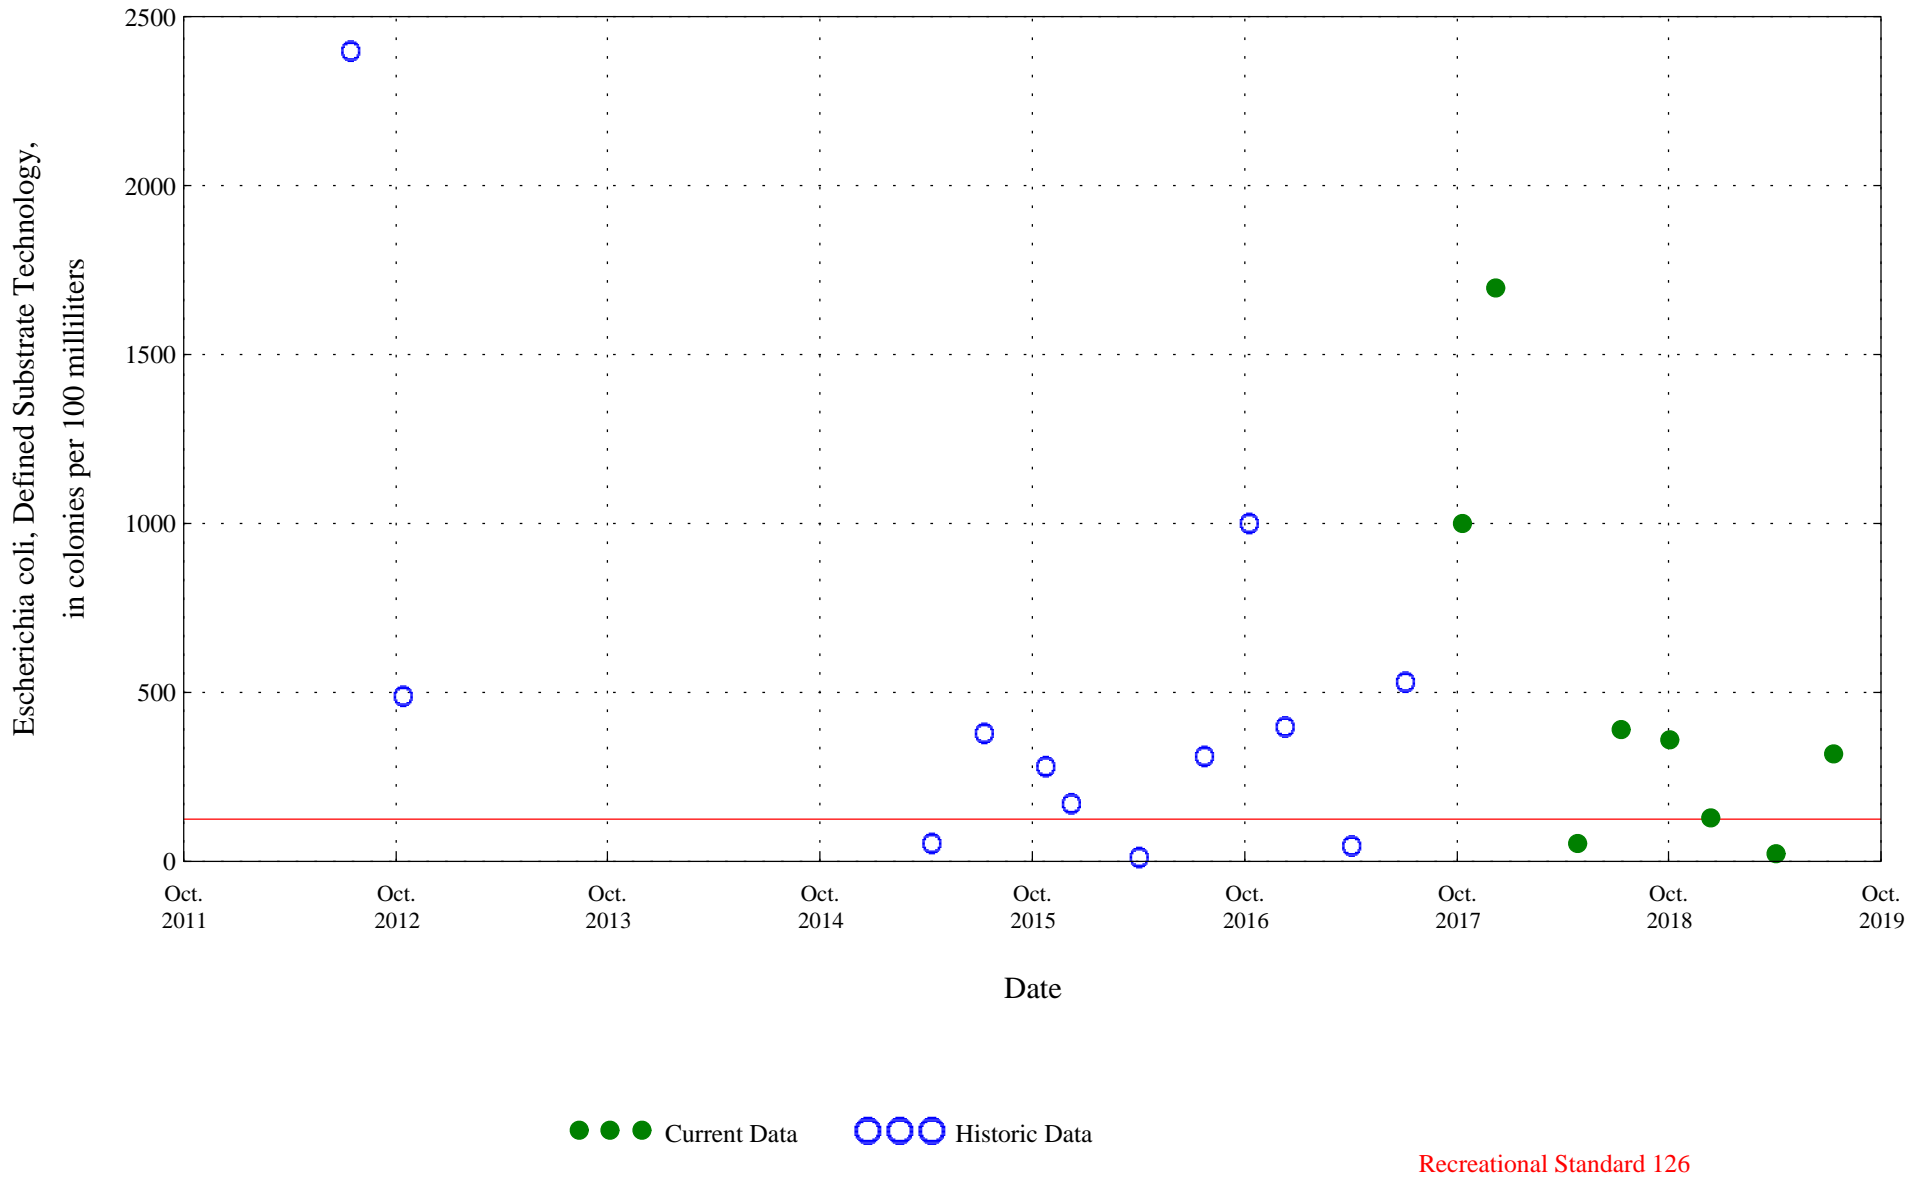


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.


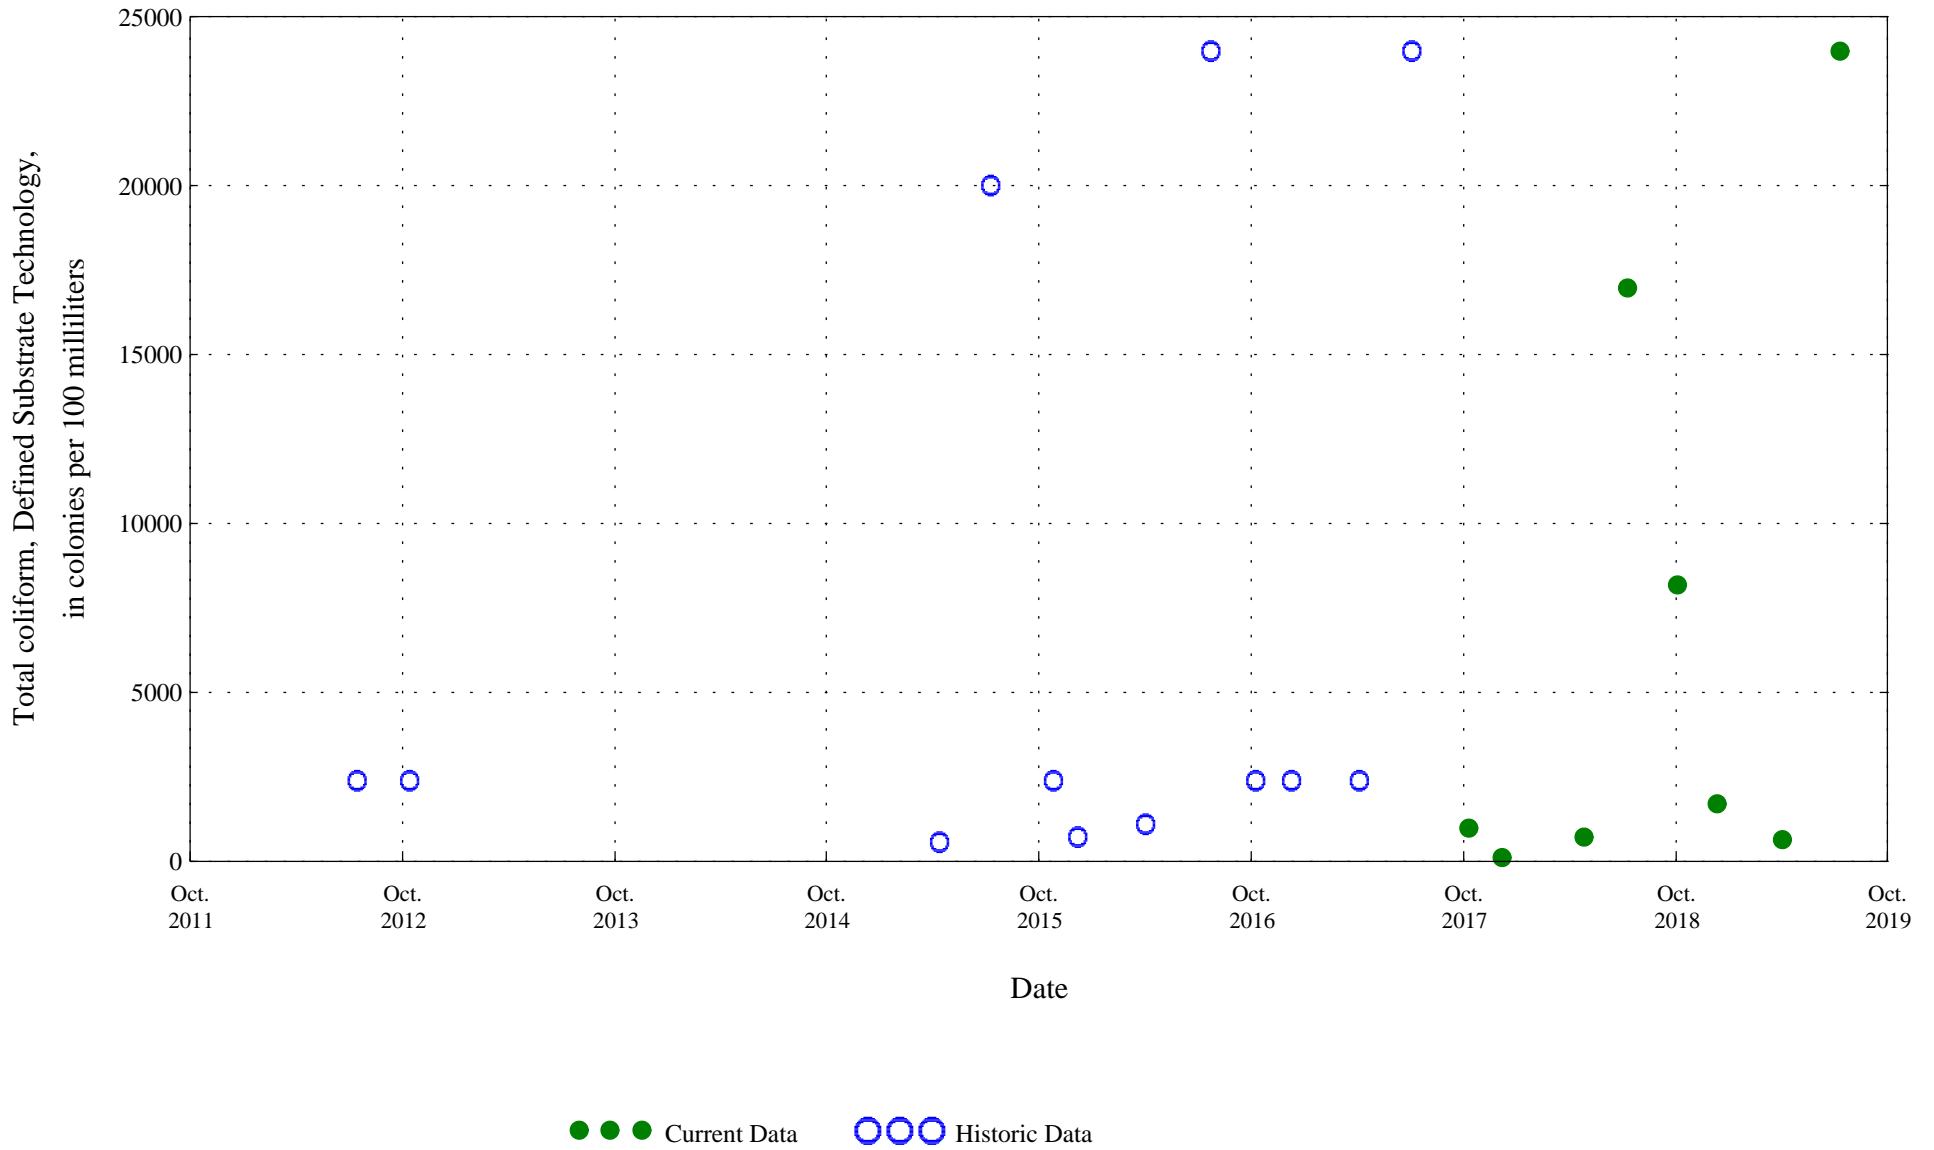


Figure 47. Distribution of selected water-quality constituents relative to time for Shooks Run at Las Vegas Street at Colorado Springs, Co., station 384905104485901.

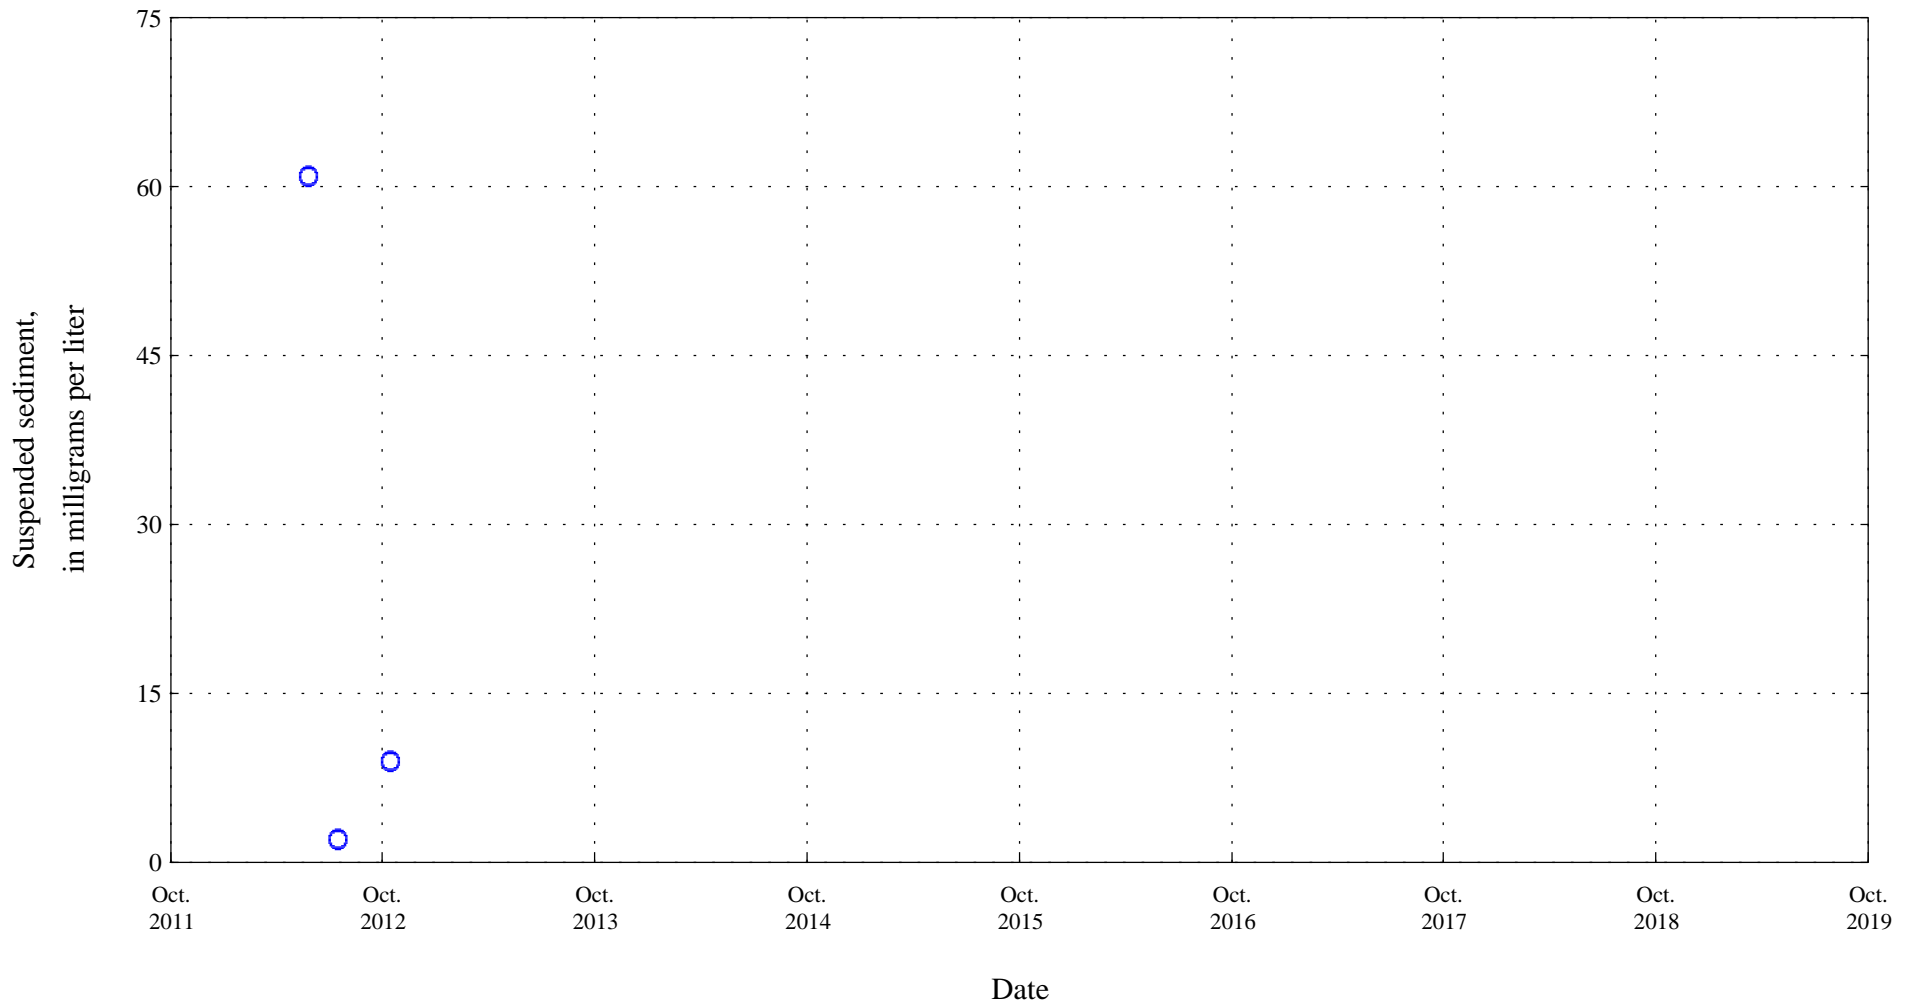

○ ○ ○ Historic Data