

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.


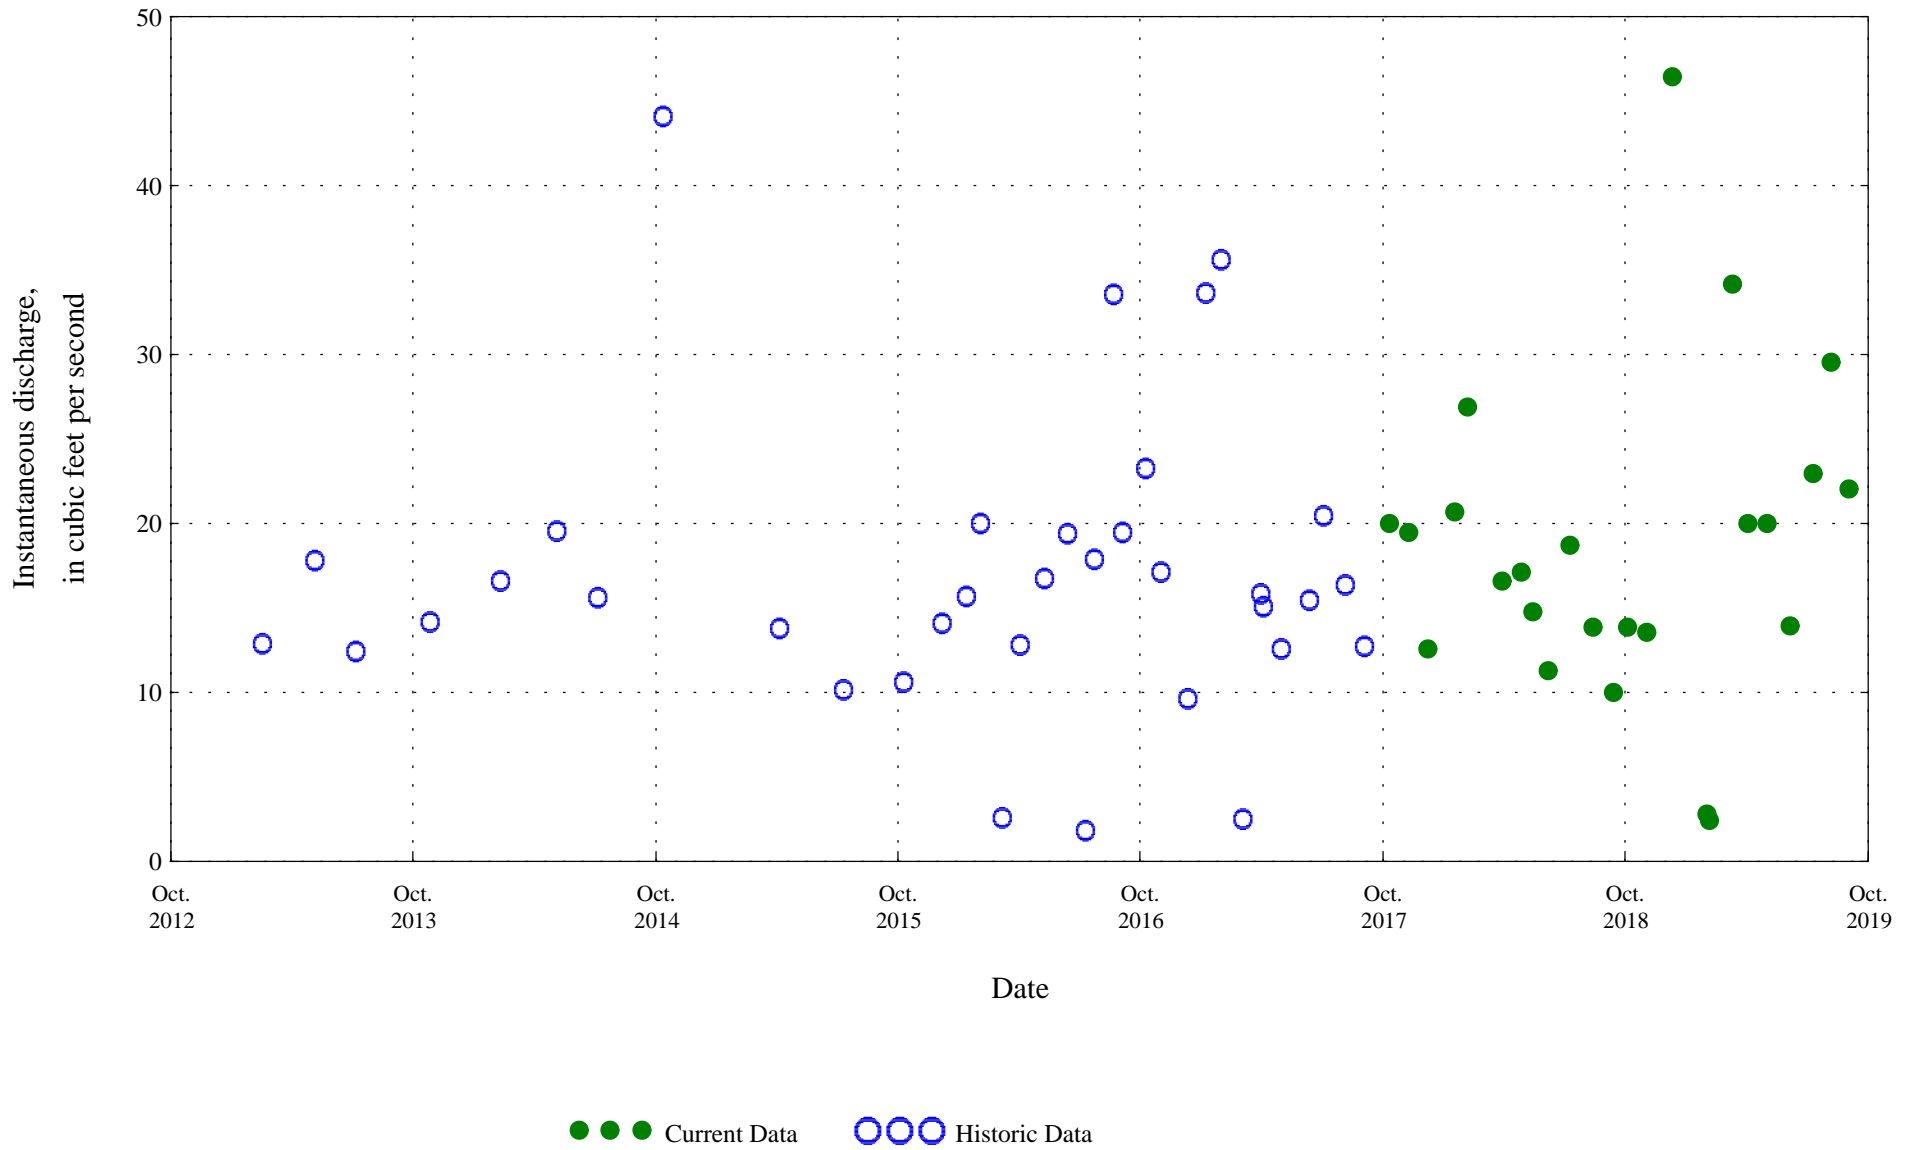







Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

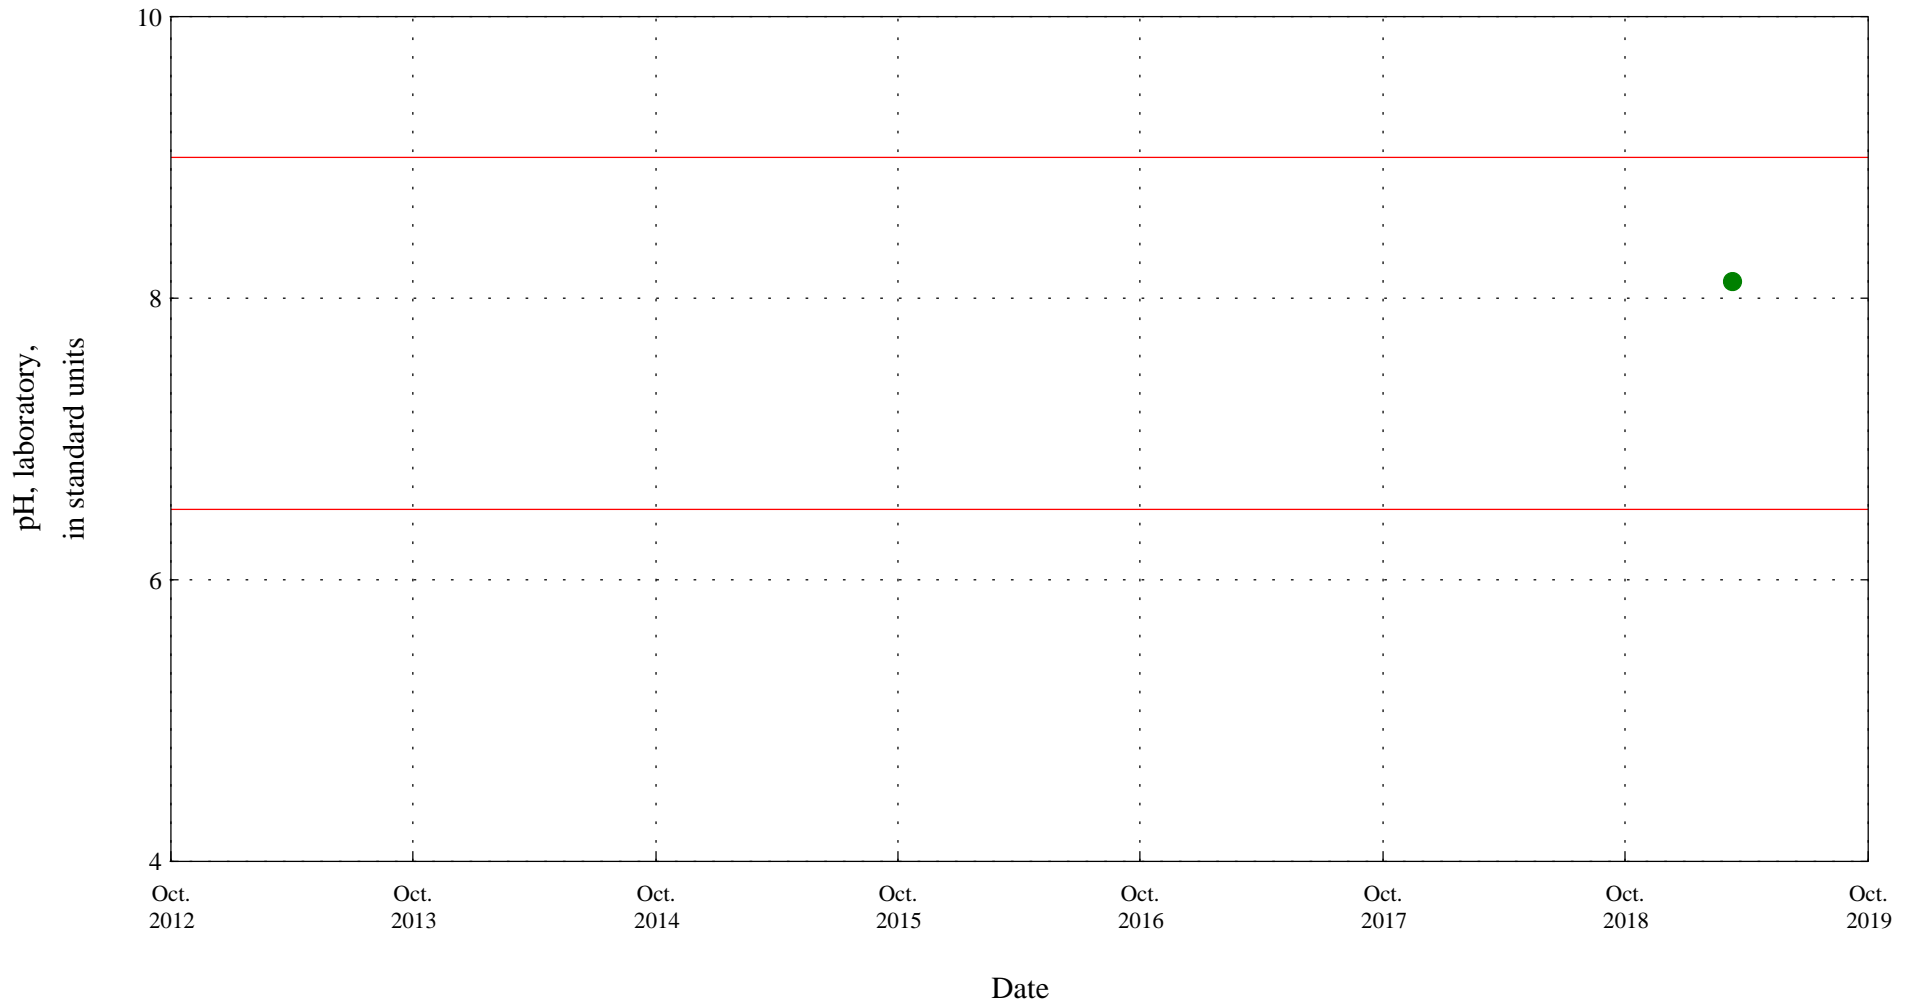

● ● ● Current Data

Aquatic Life Standard 6.5 to 9.0

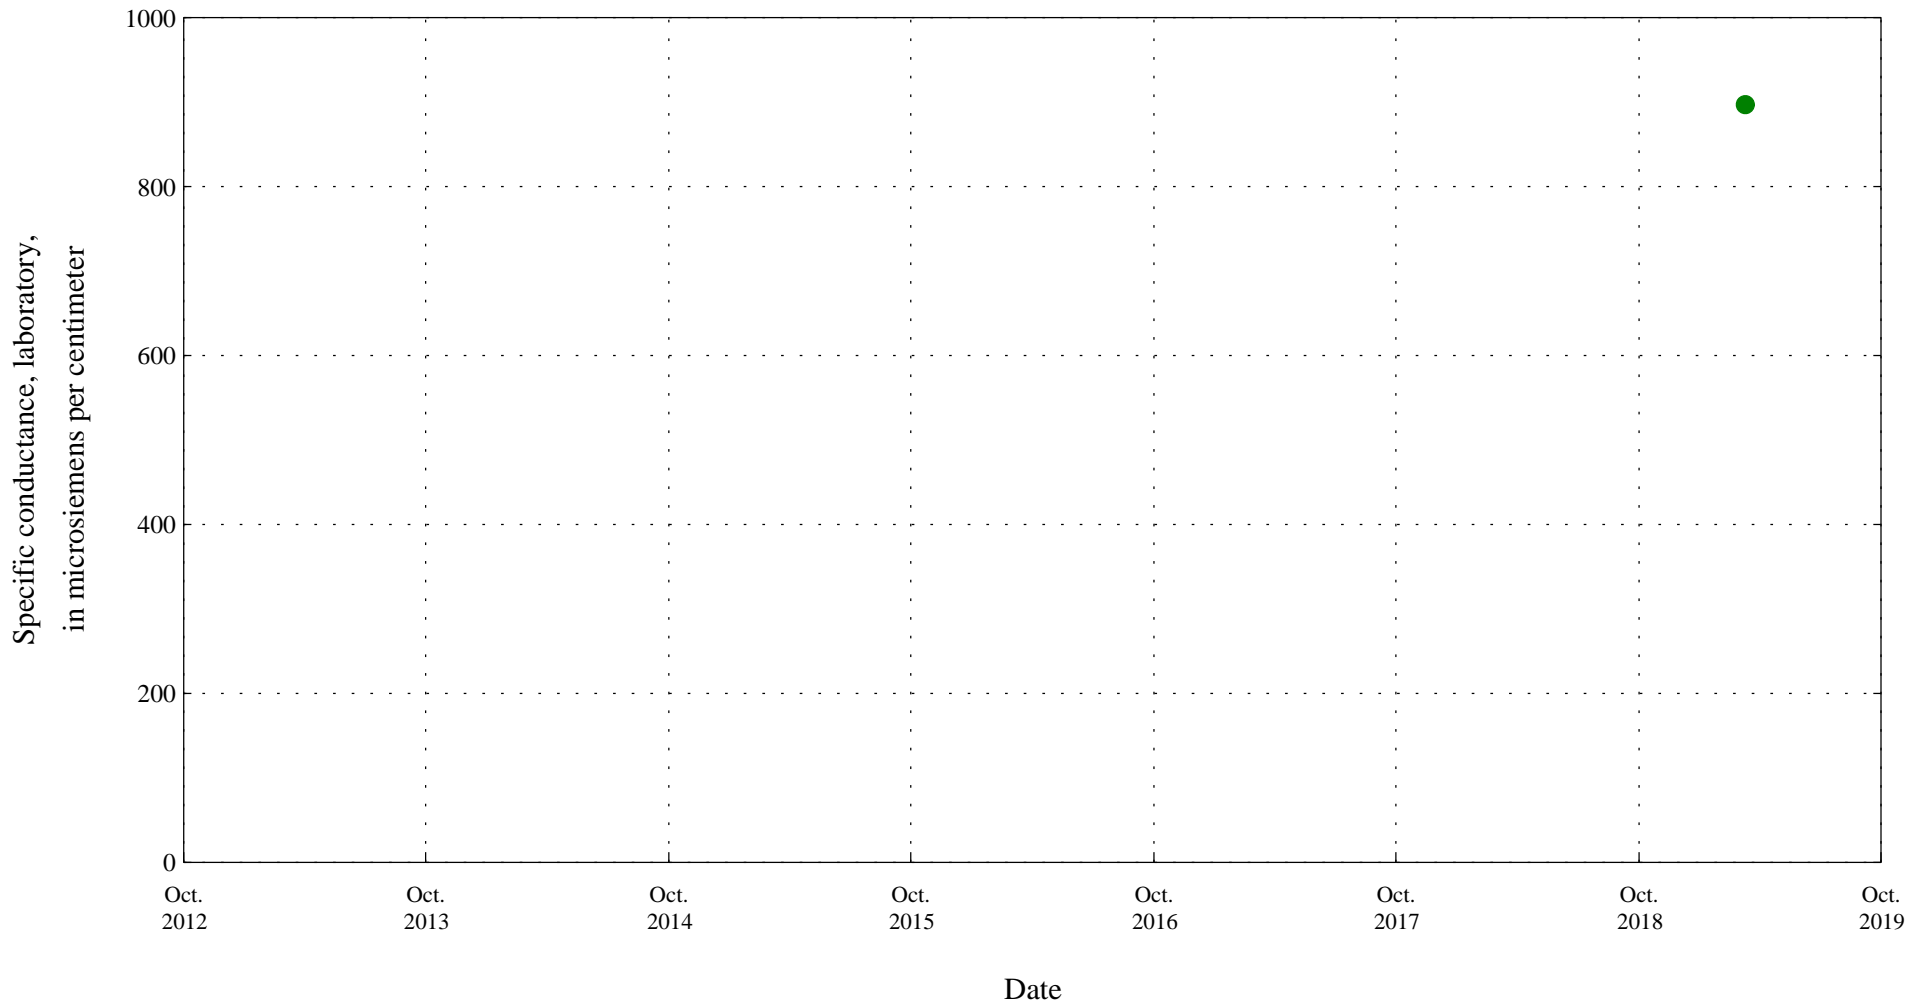Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.


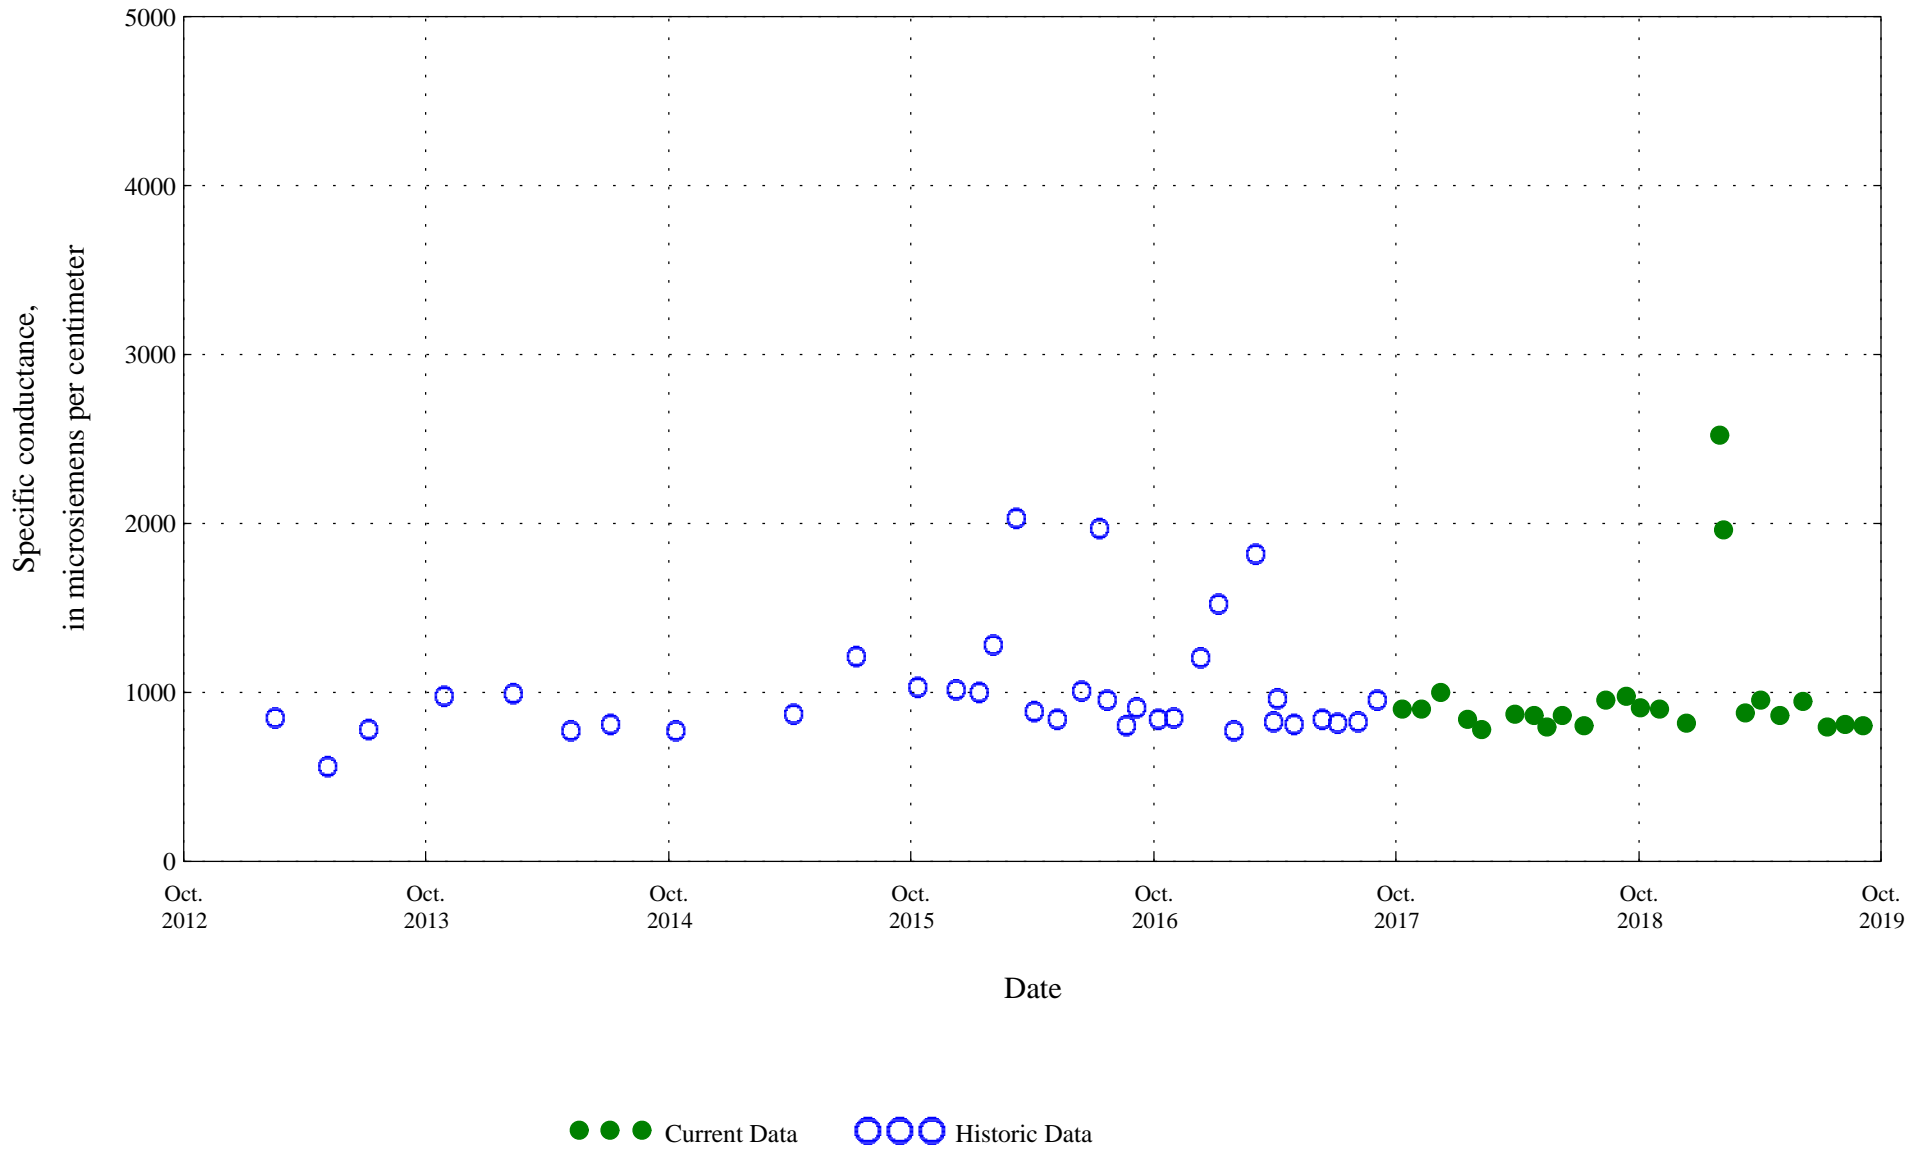


Figure 48. Distribution of selected water-quality constituents relative to time for  
 Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

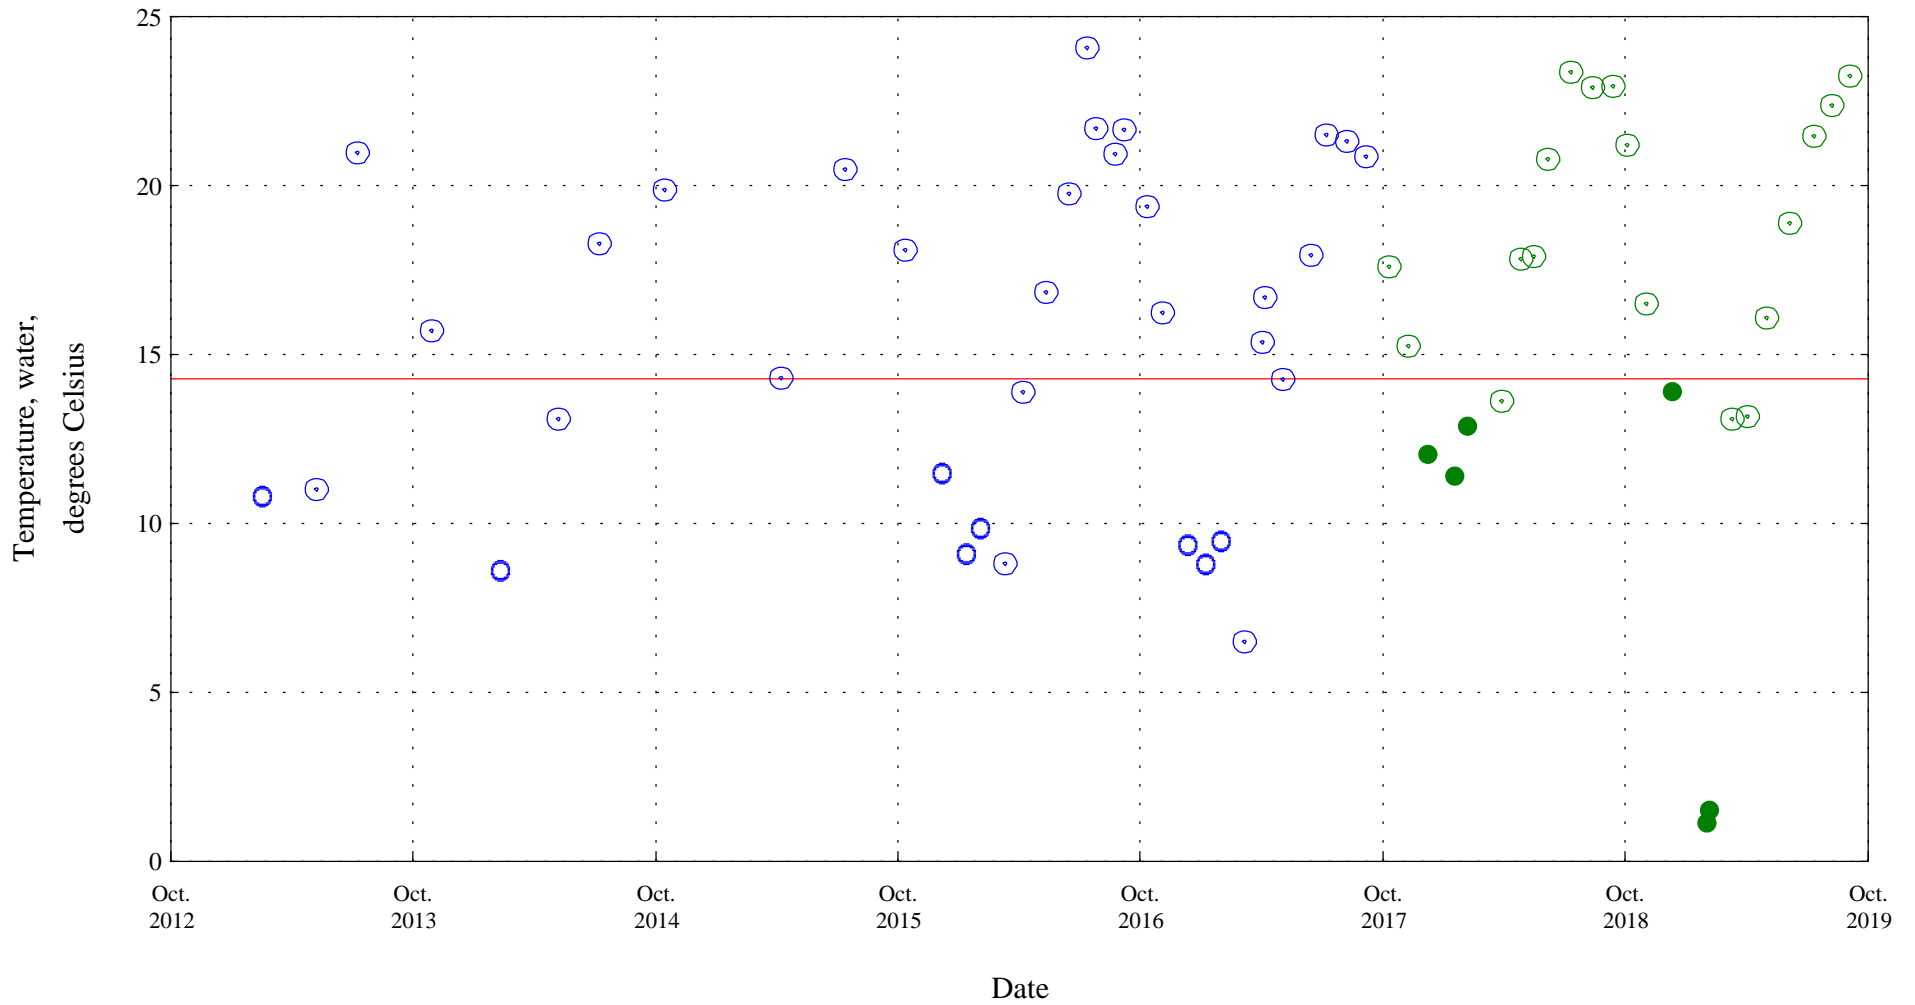

● ● ● Current Data, Cool Season Std      ○ ○ ○ Current Data, Warm Season Std  
○ ○ ○ Historic Data, Cool Season Std      ○ ○ ○ Historic Data, Warm Season Std

Aquatic Life Dec - Feb, Cool Season Std 14.3  
 Aquatic Life Mar - Nov, Warm Season Std 28.6

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

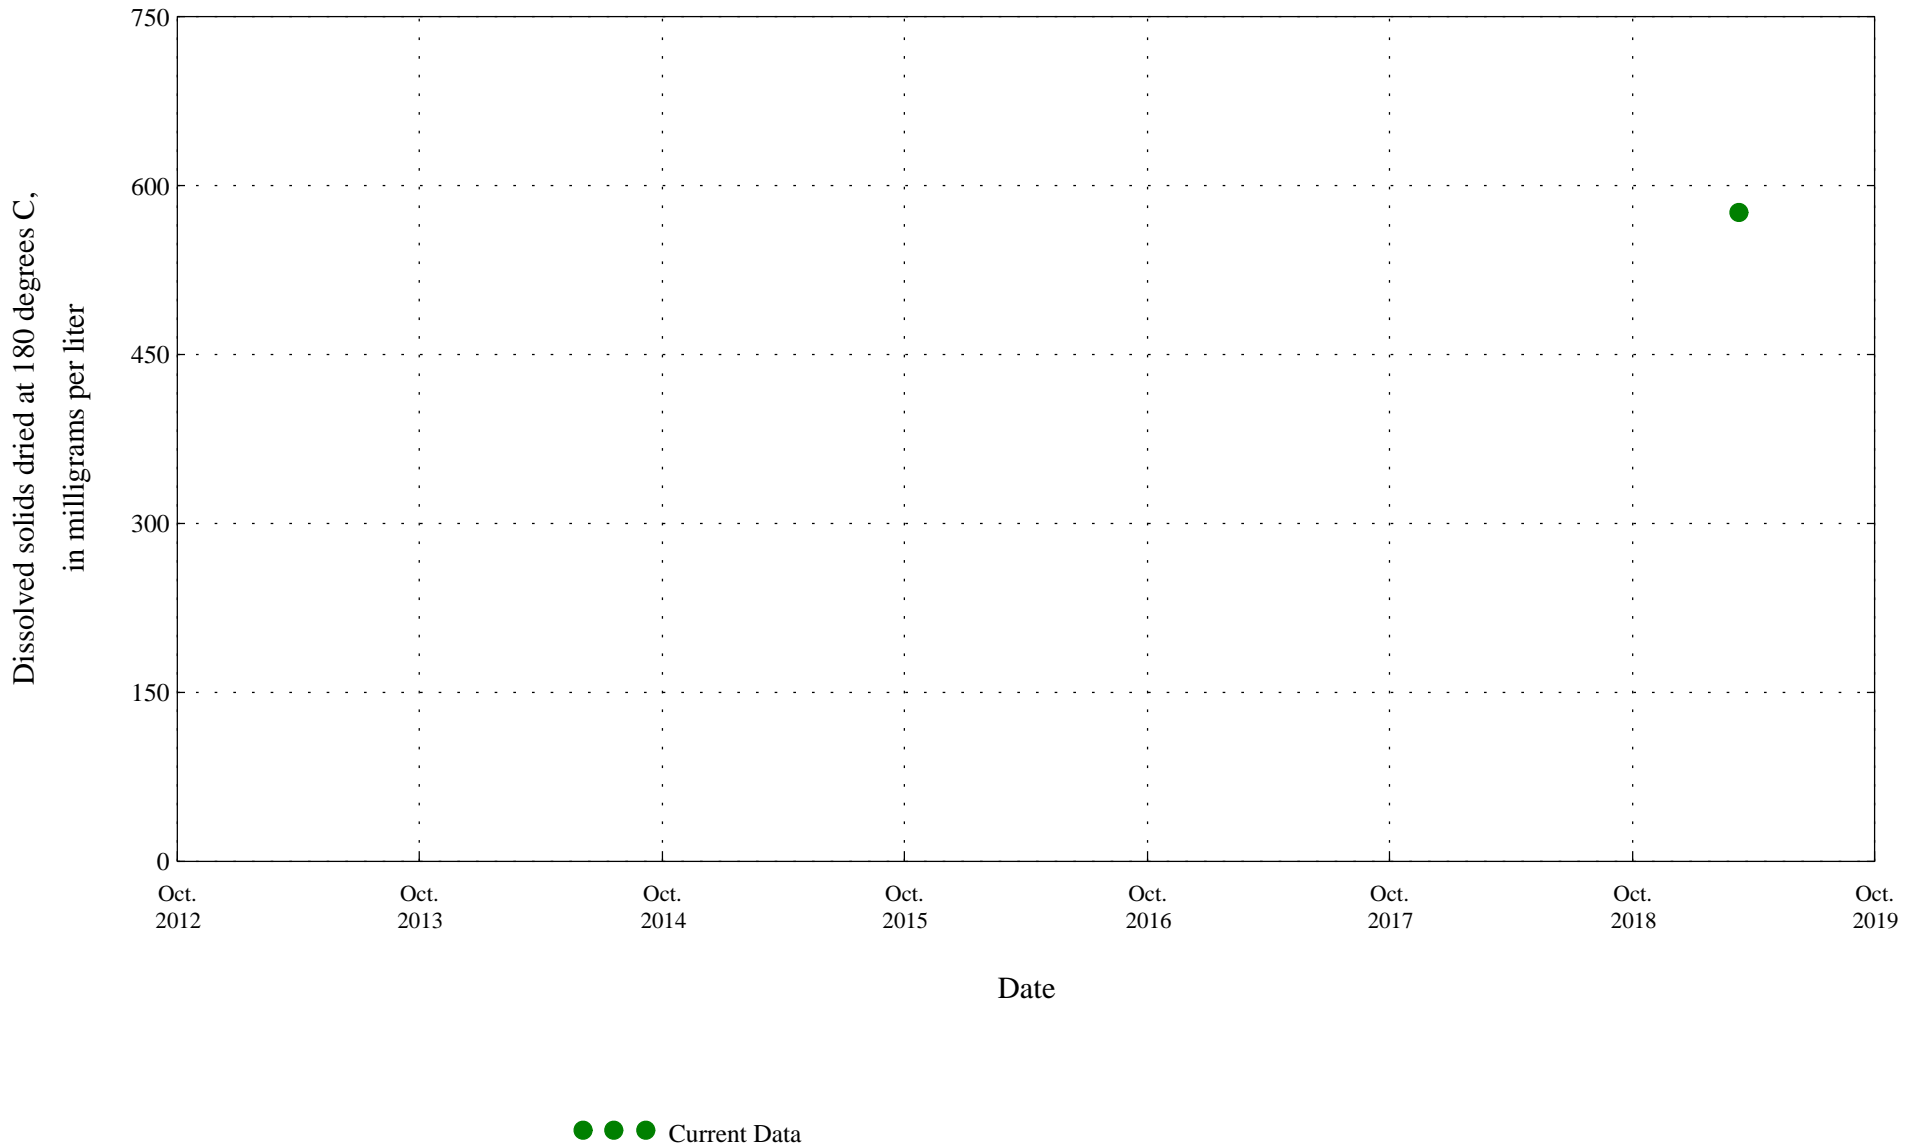
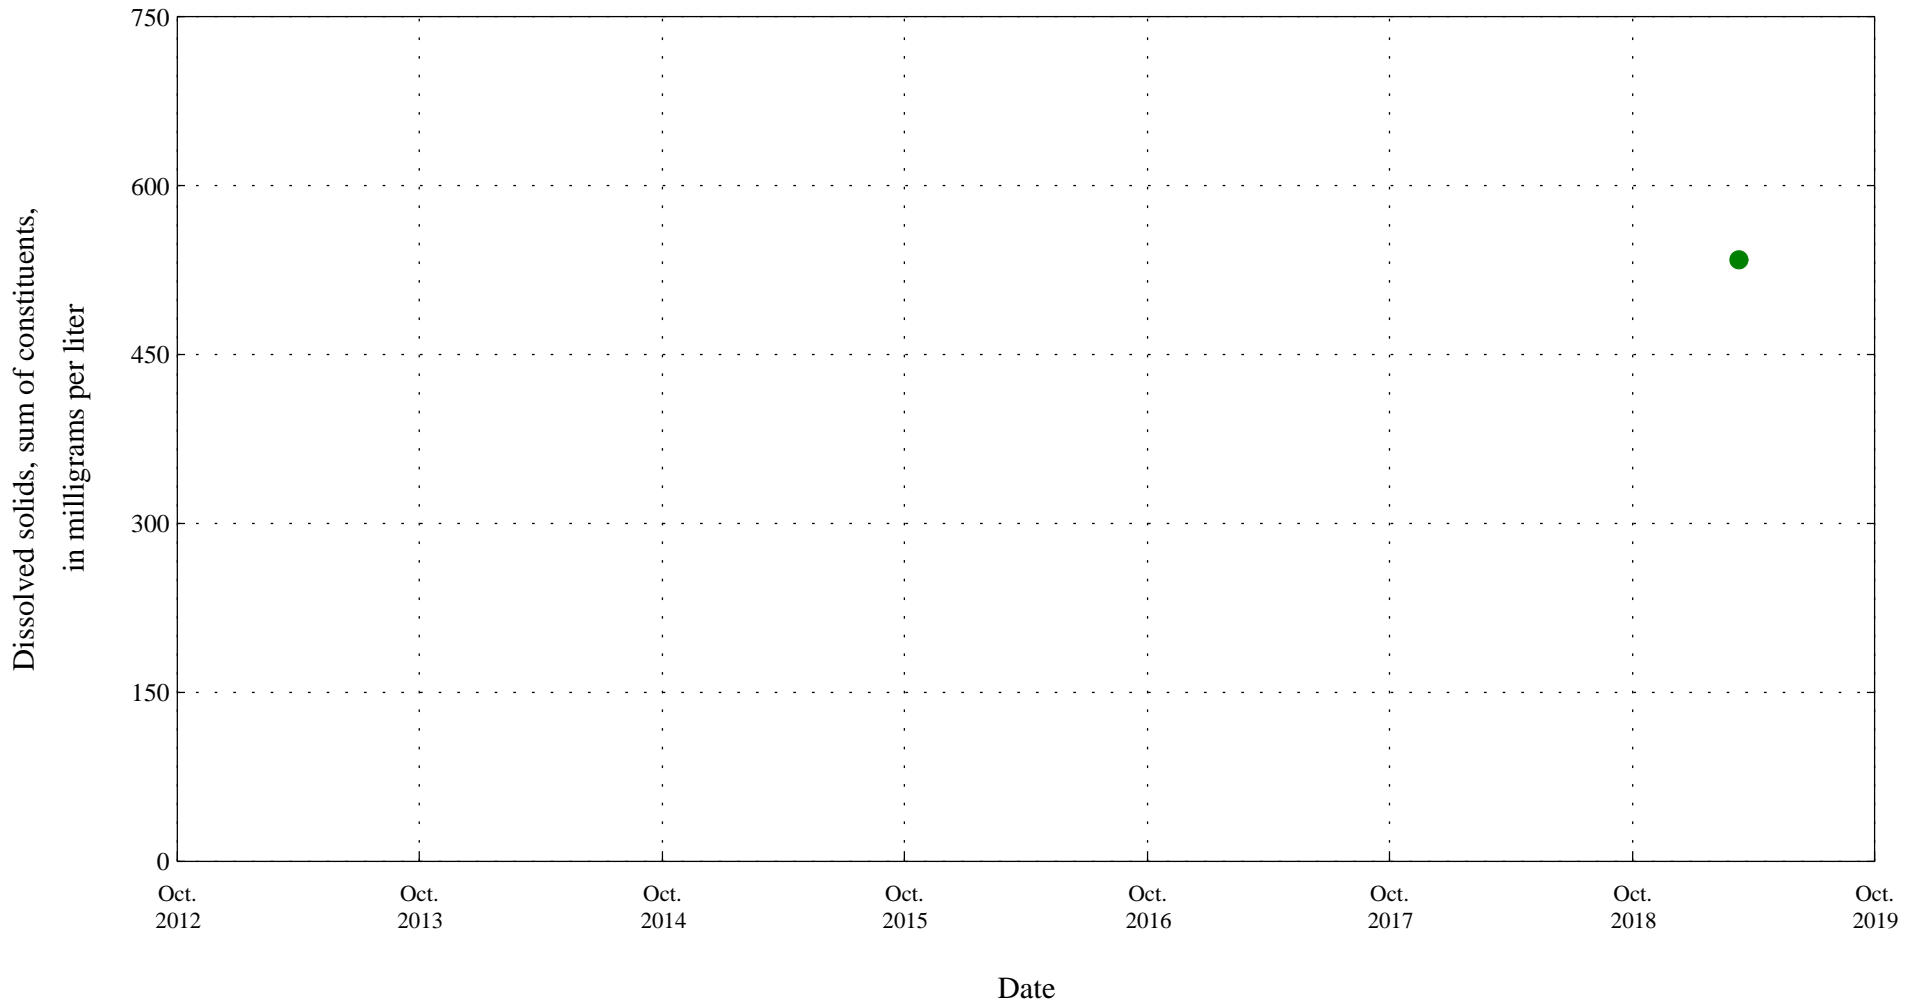


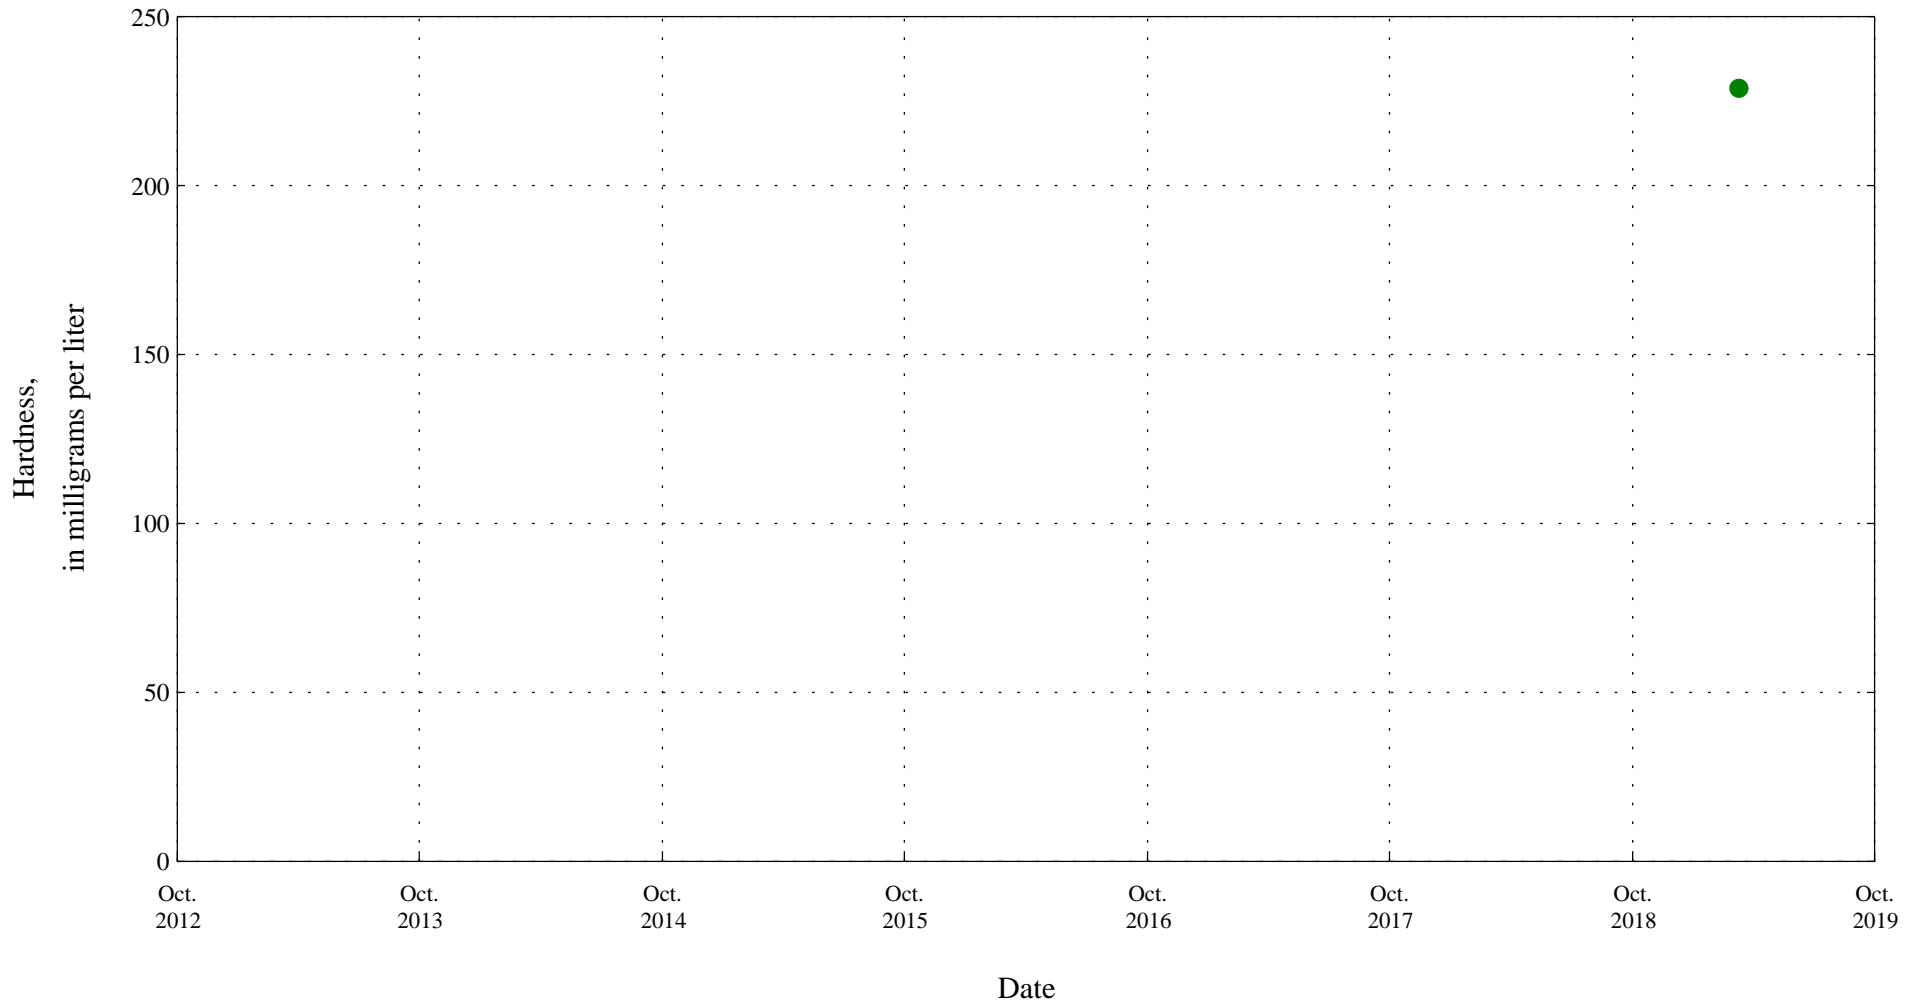


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

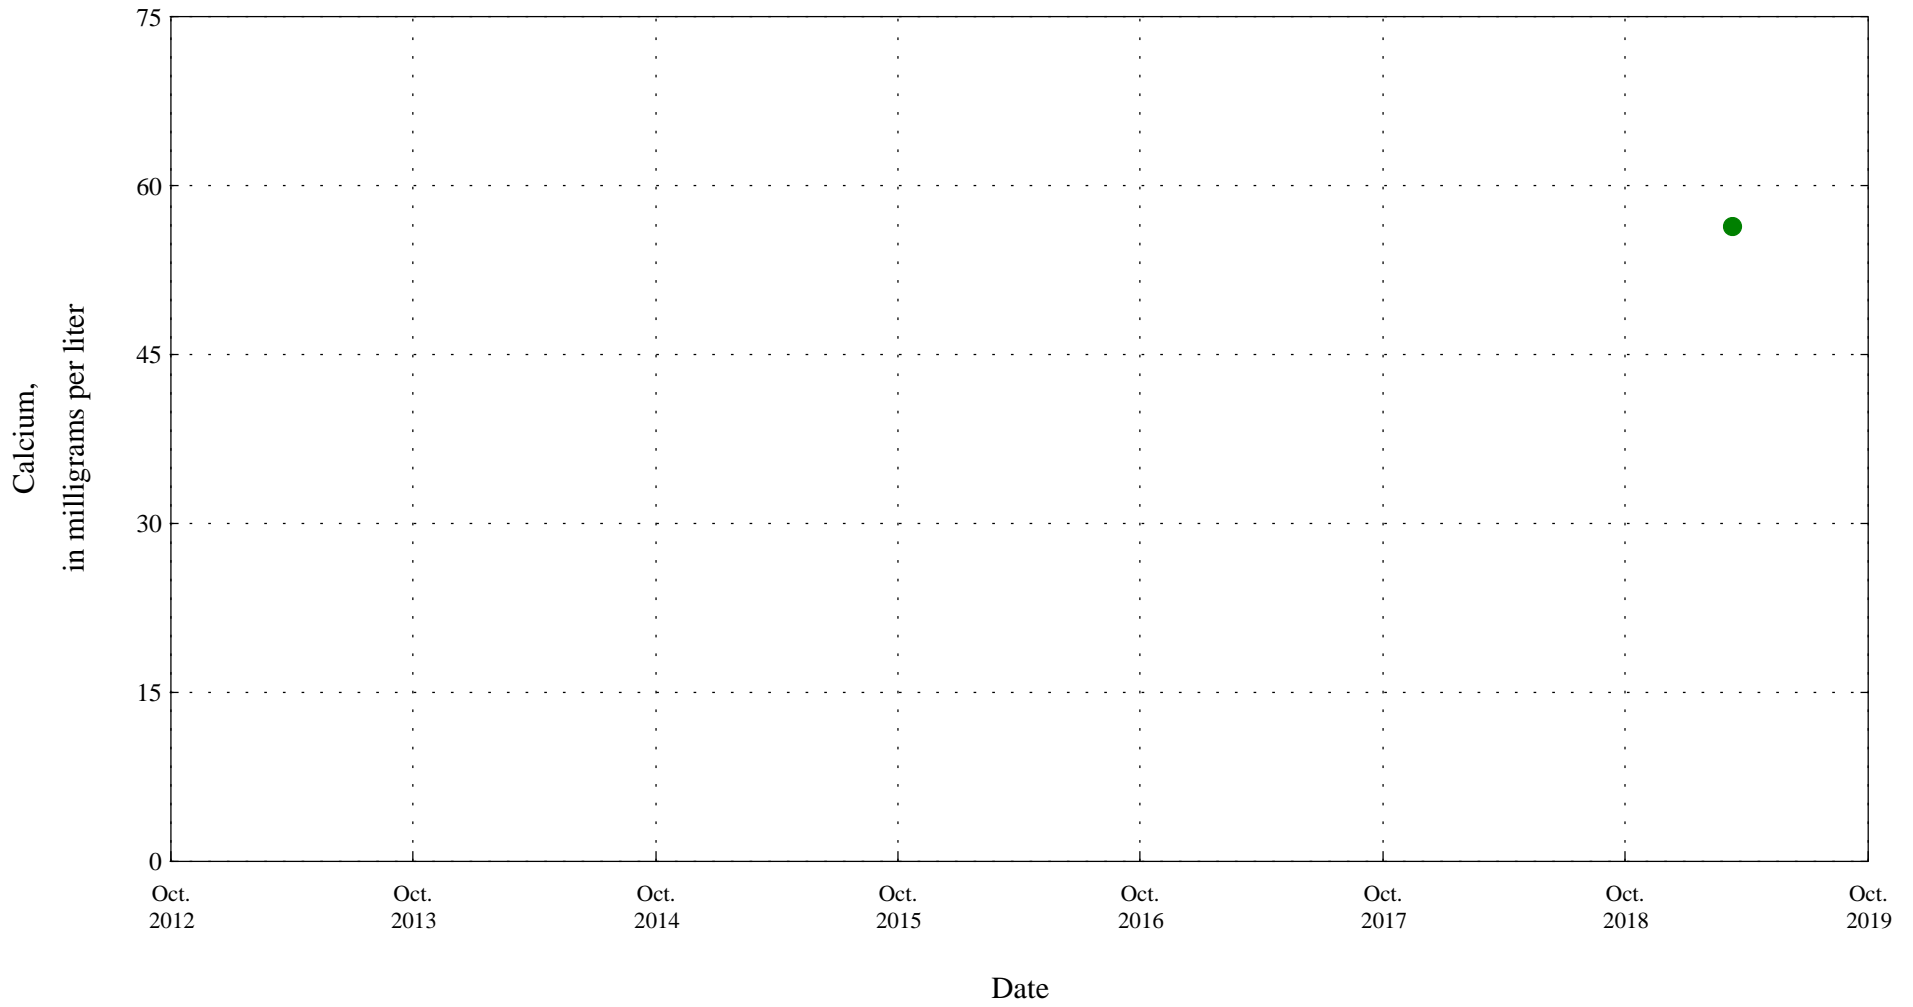Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

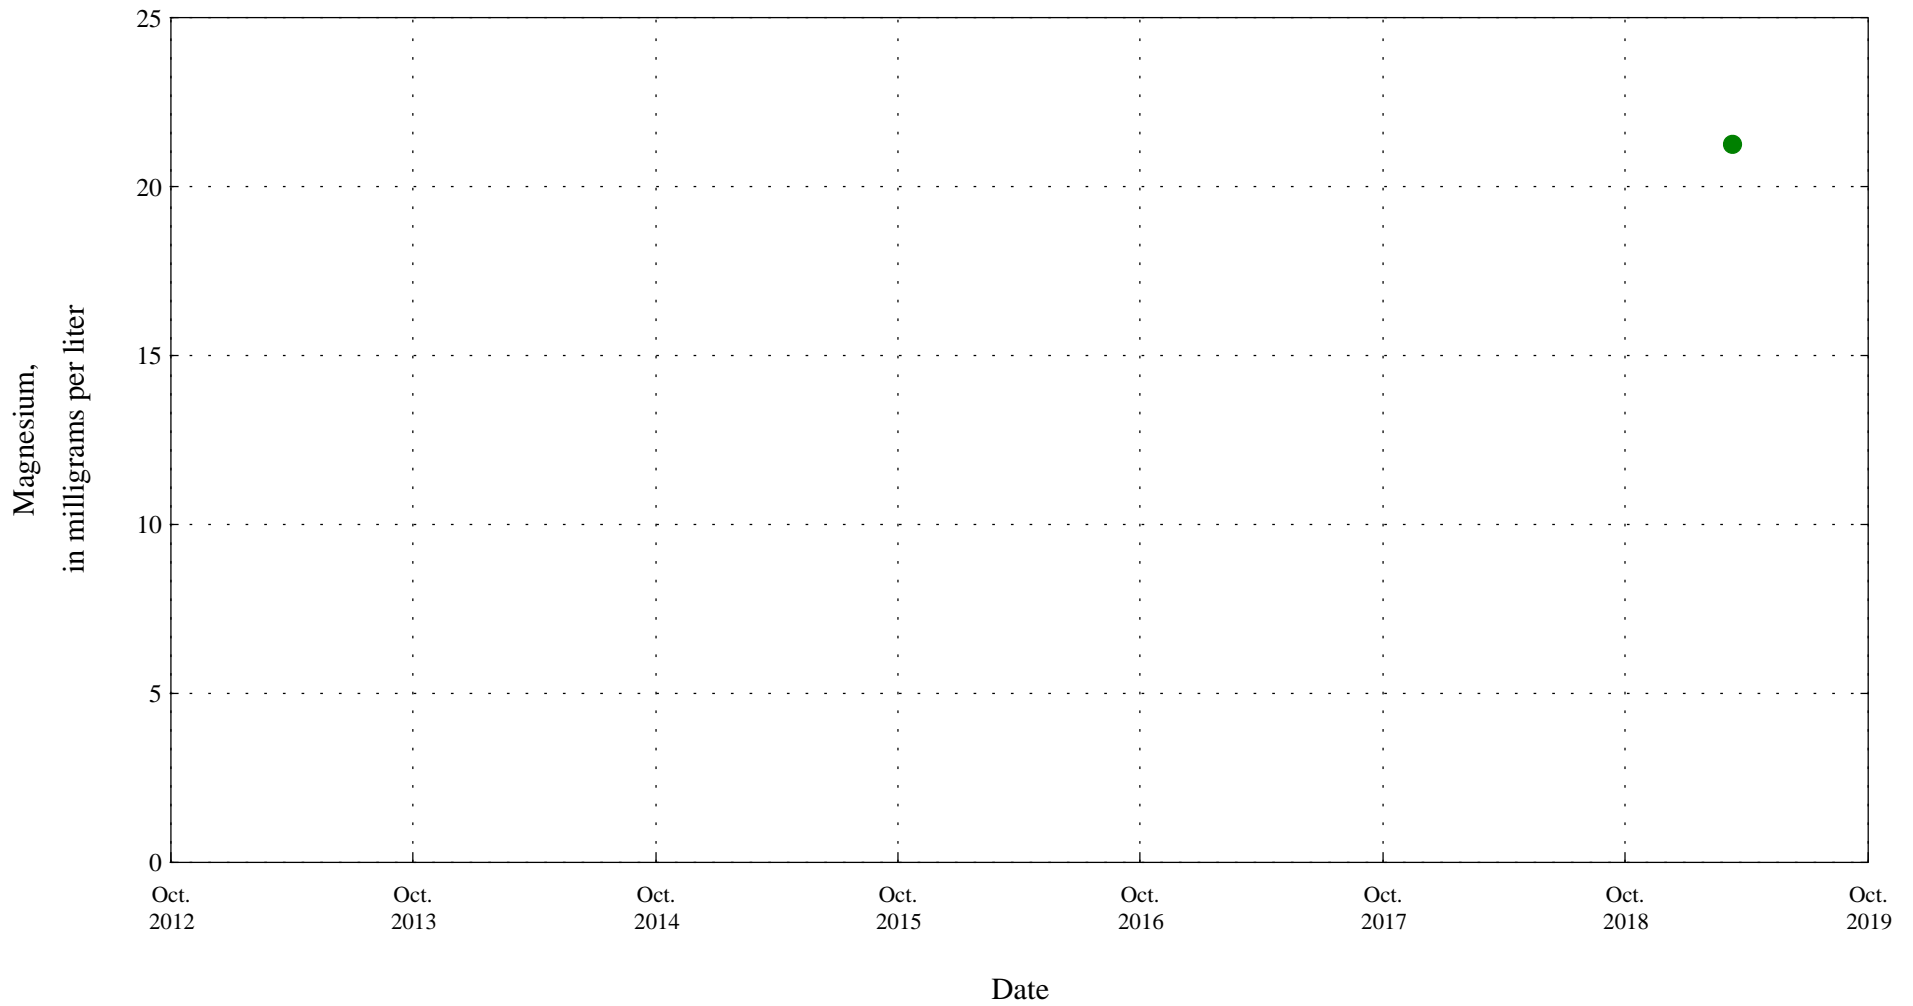Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

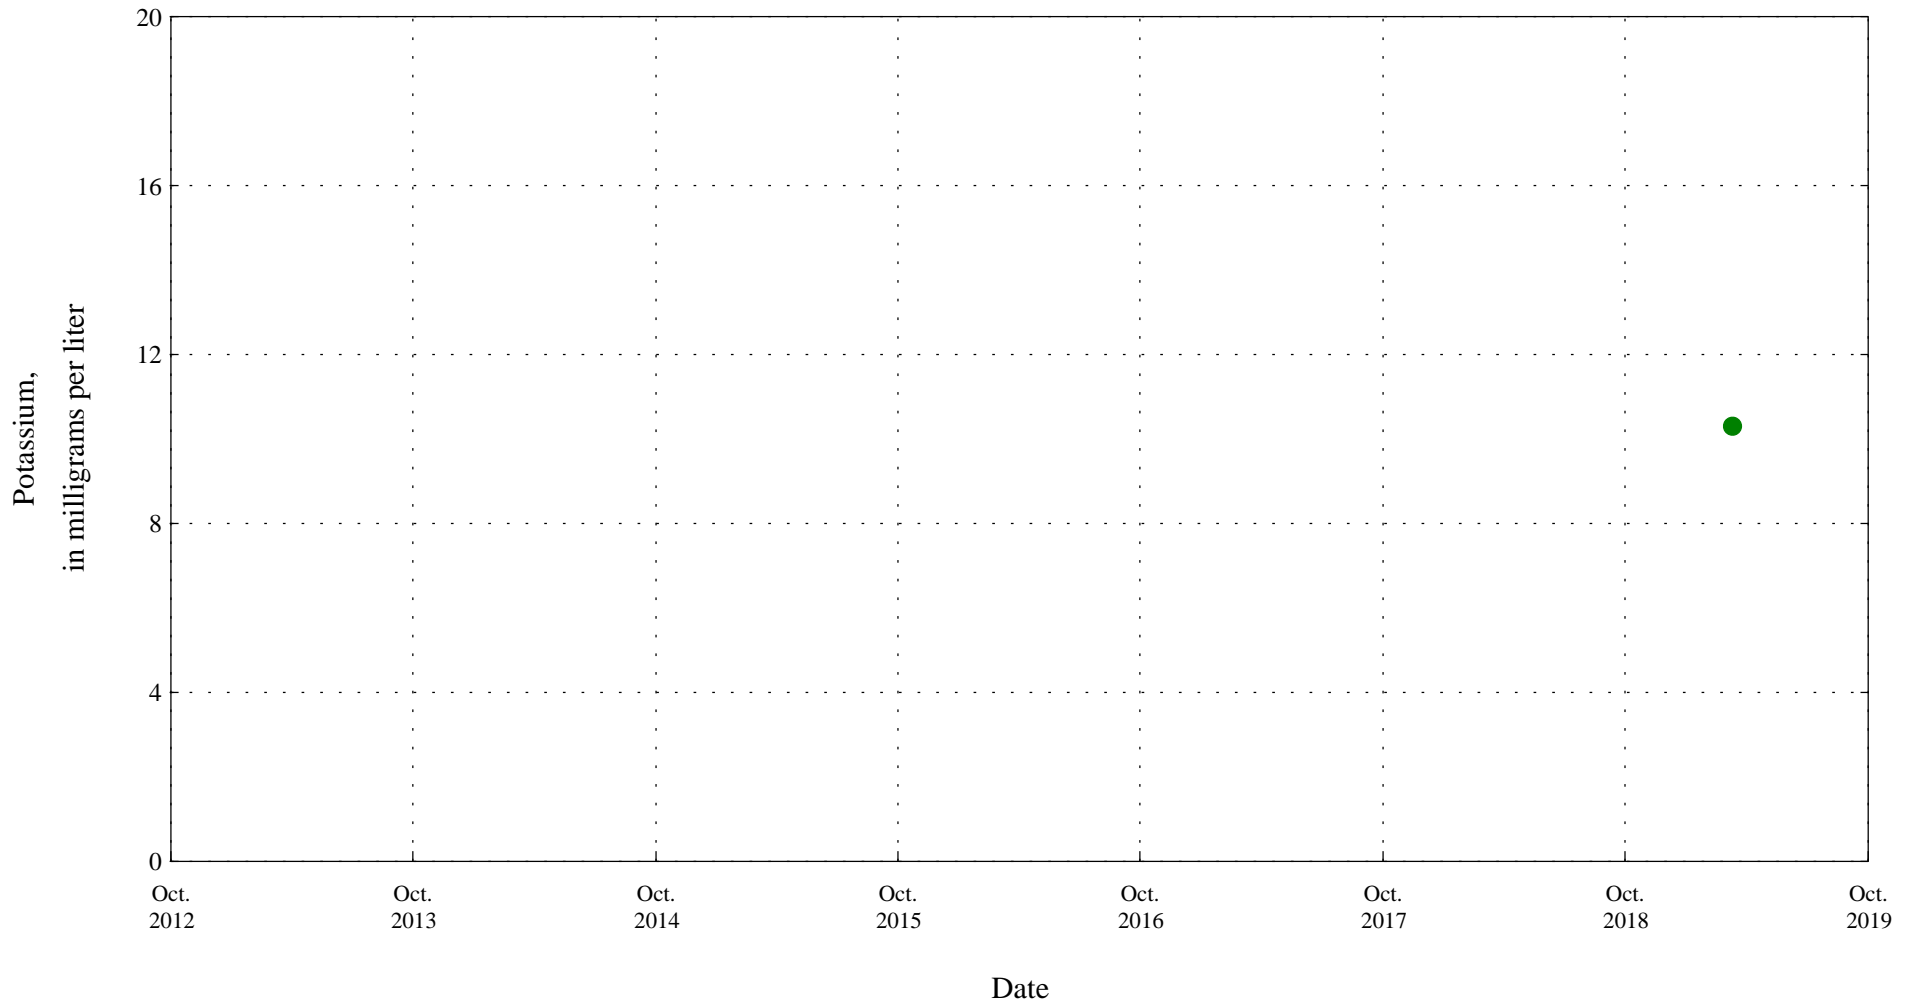Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



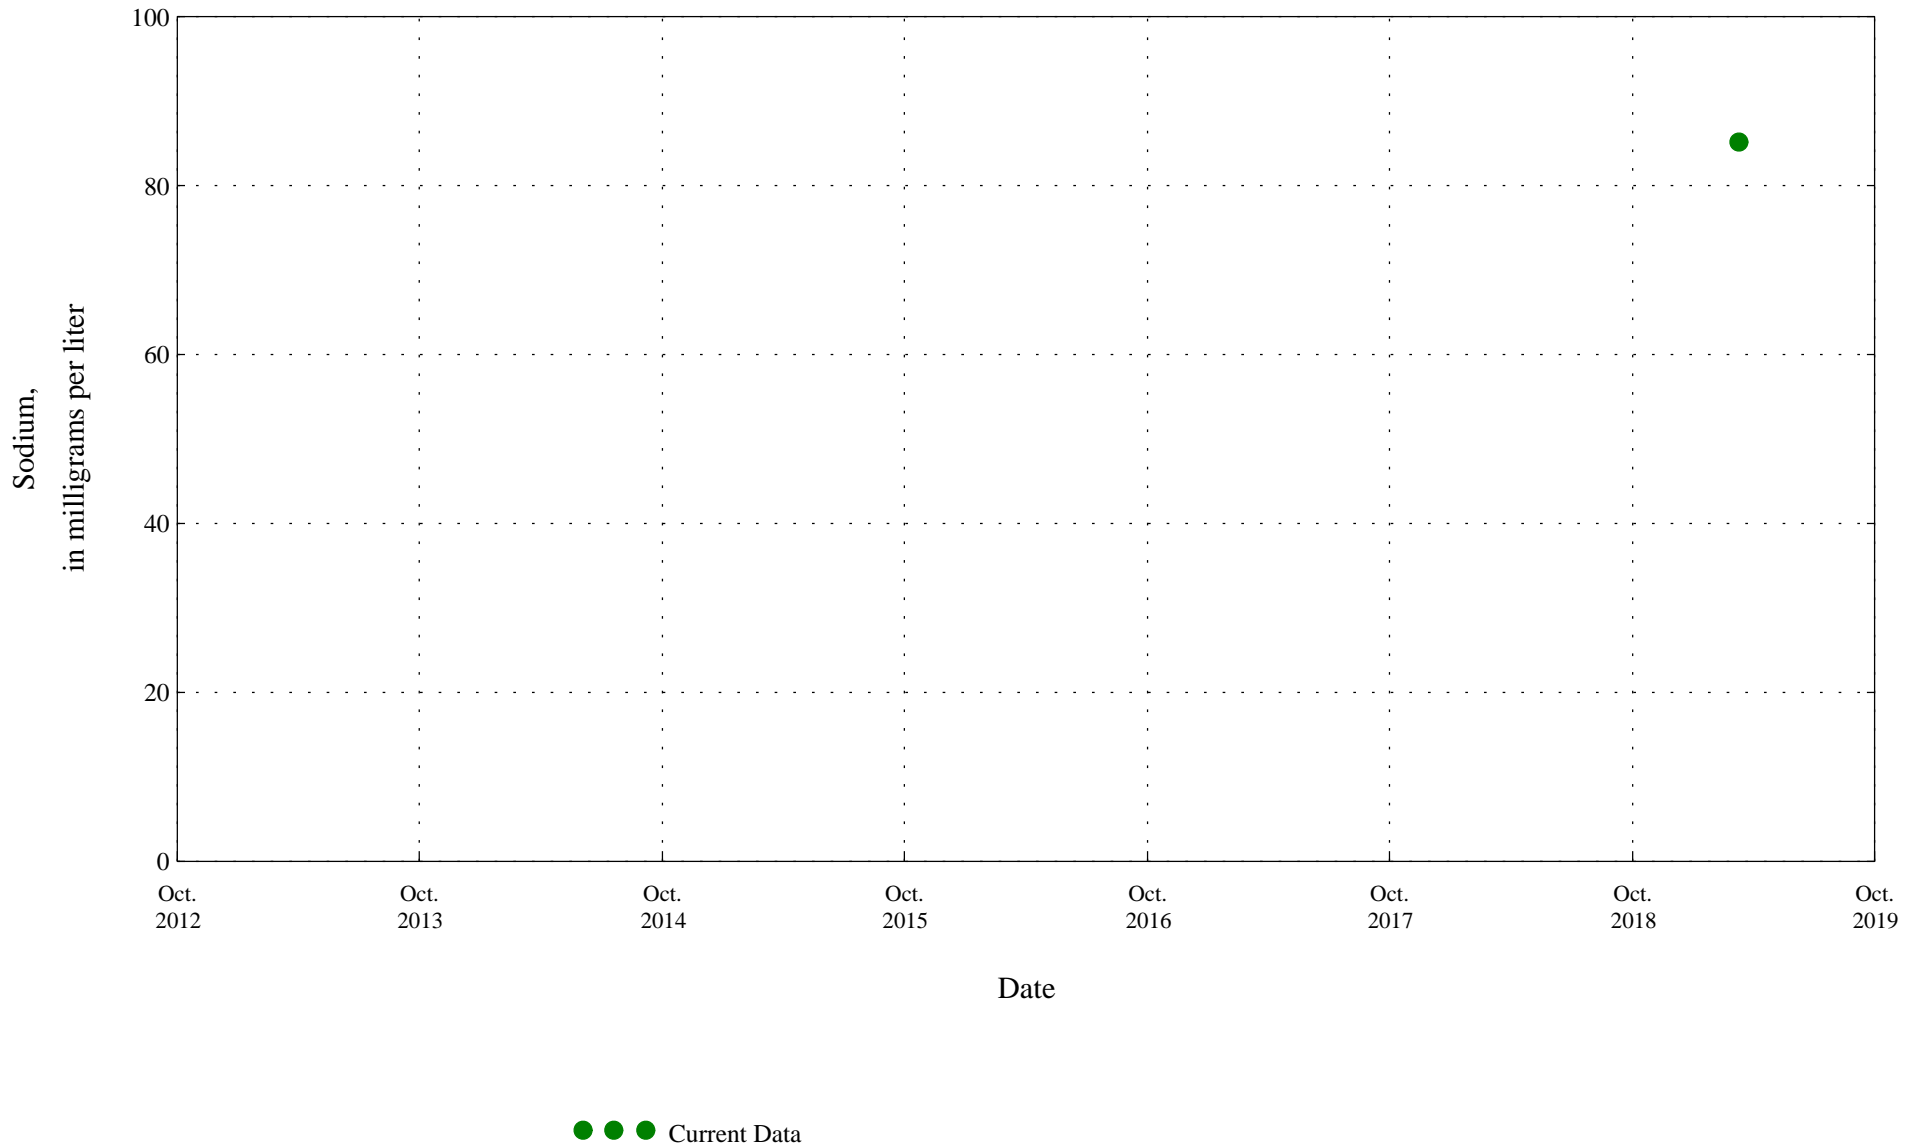


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

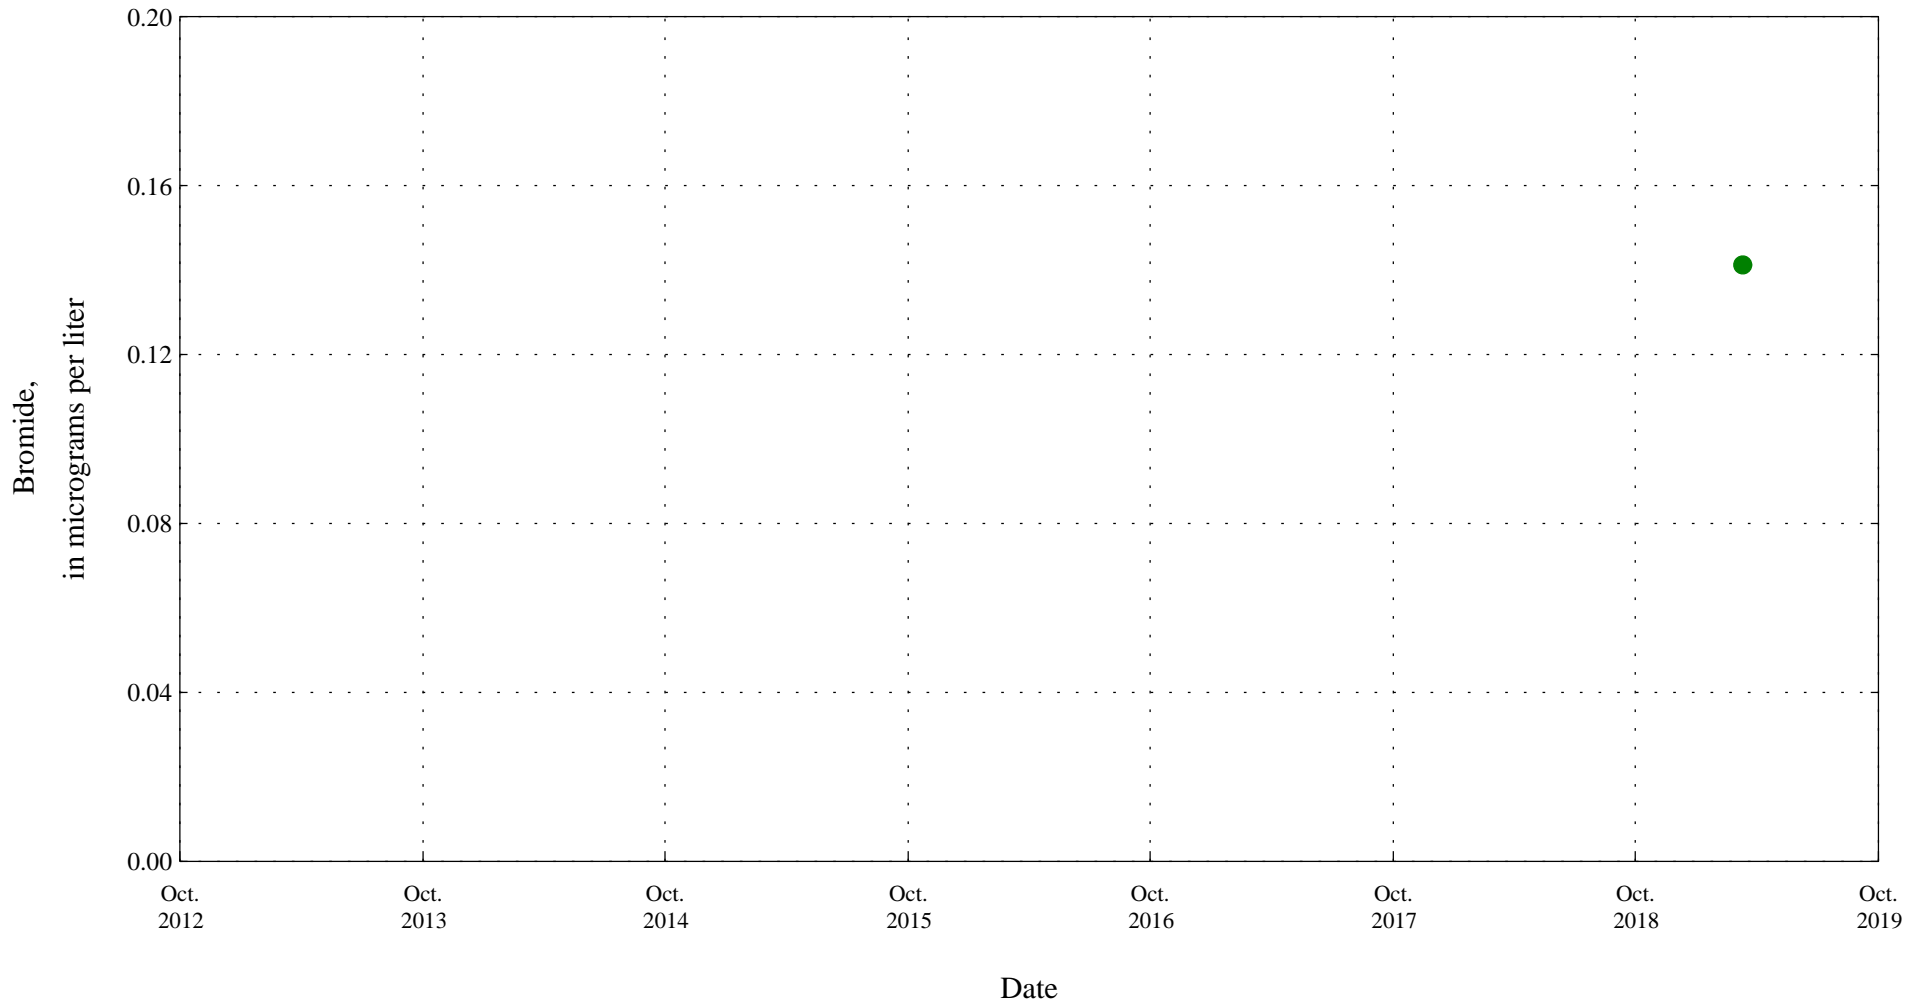

● ● ● Current Data

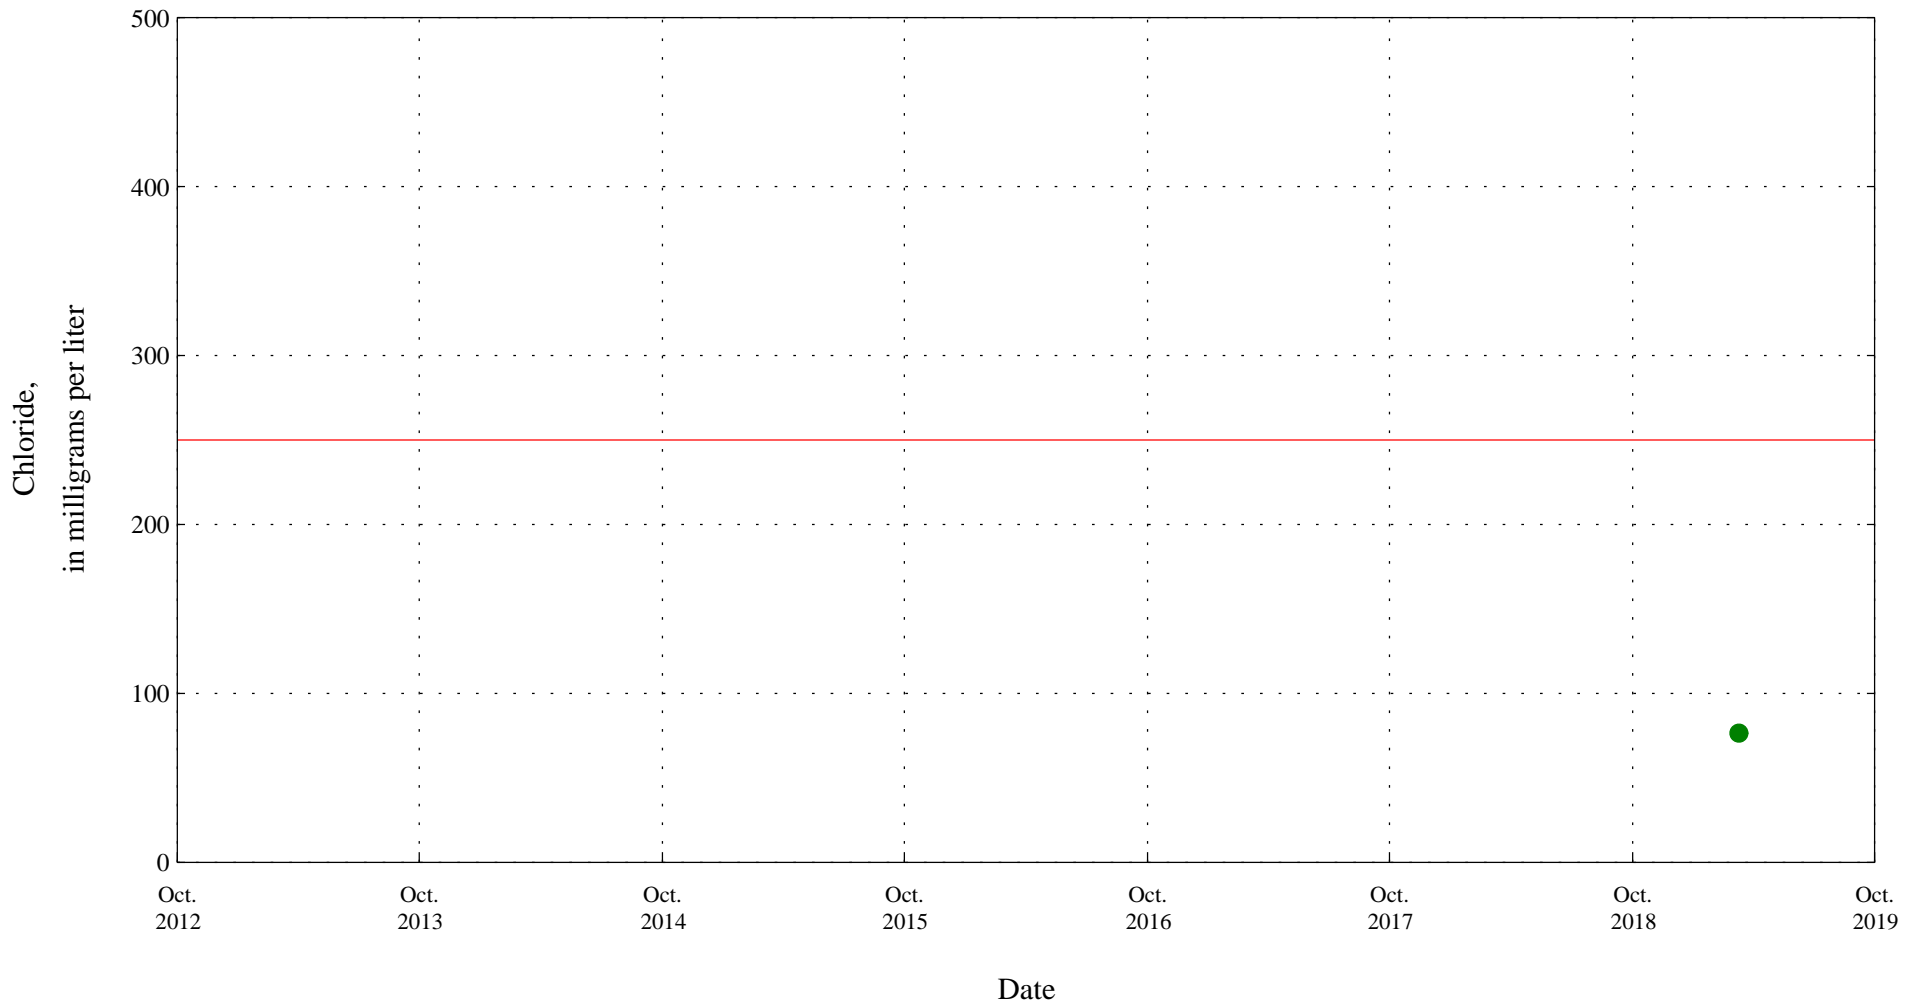Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

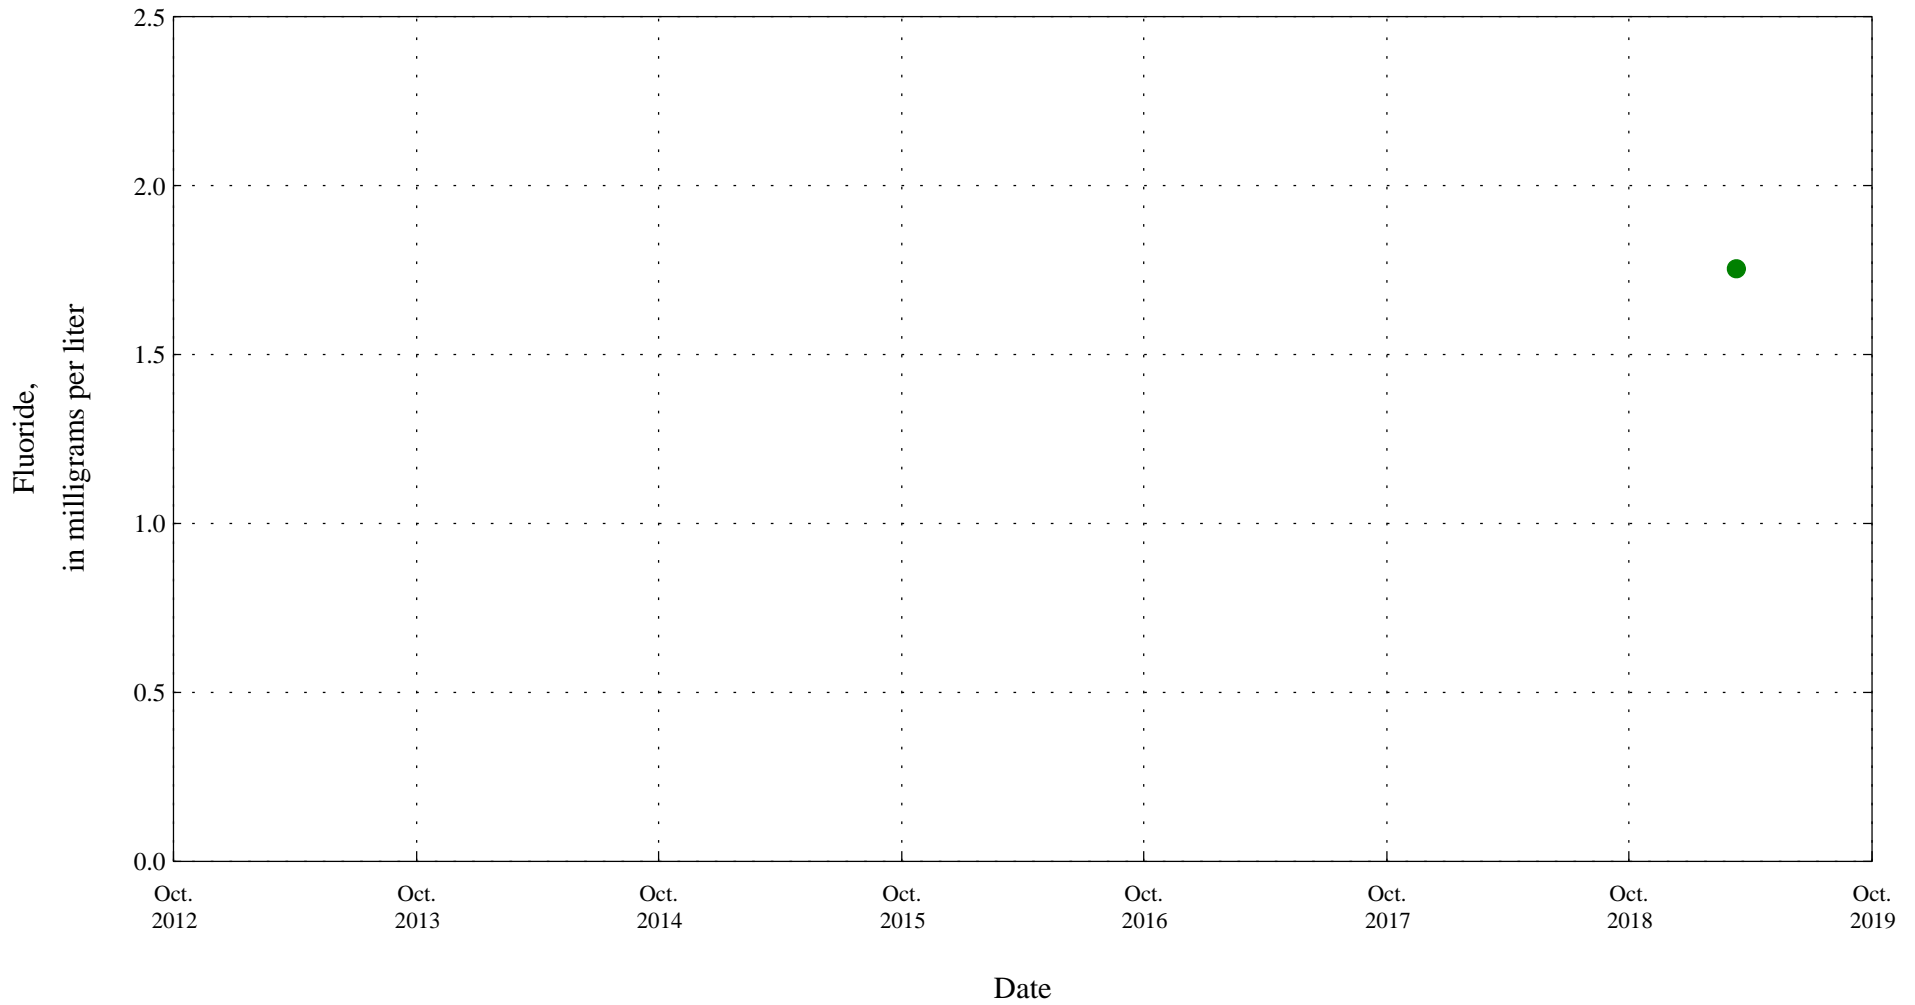Human Health Based Water Supply Chronic Standard 250

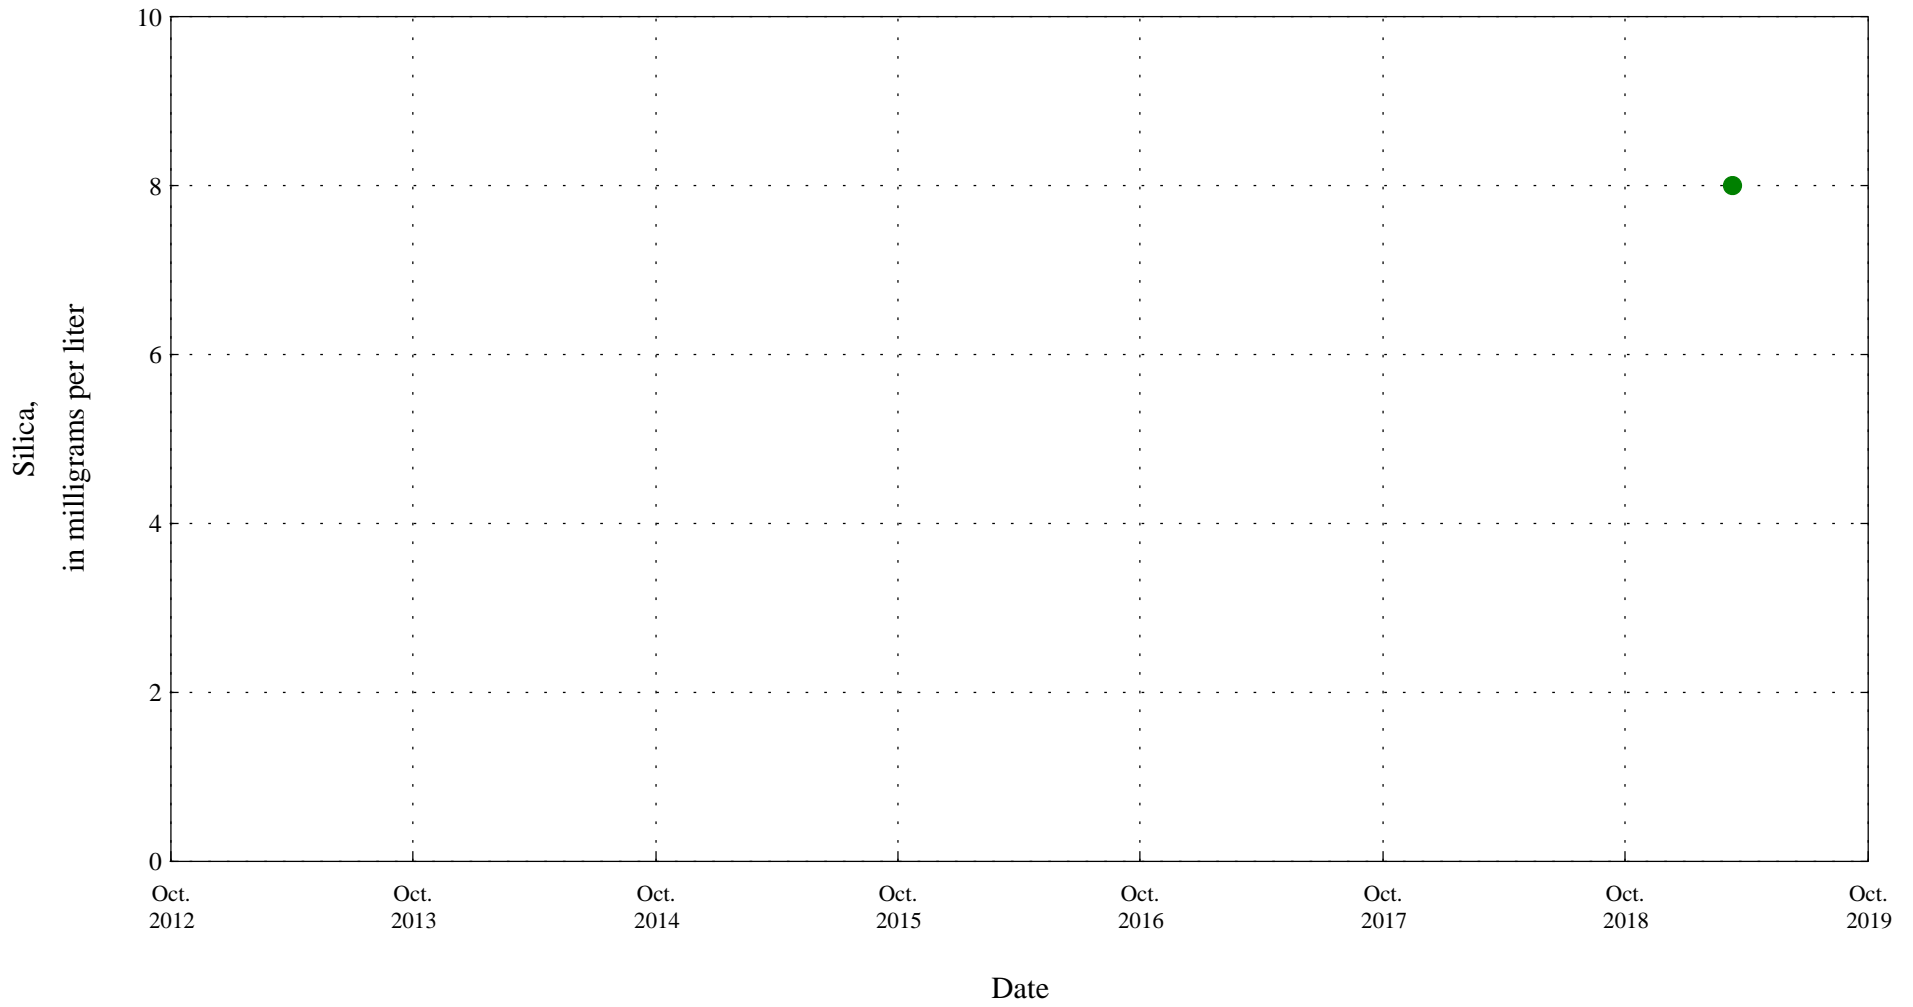


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

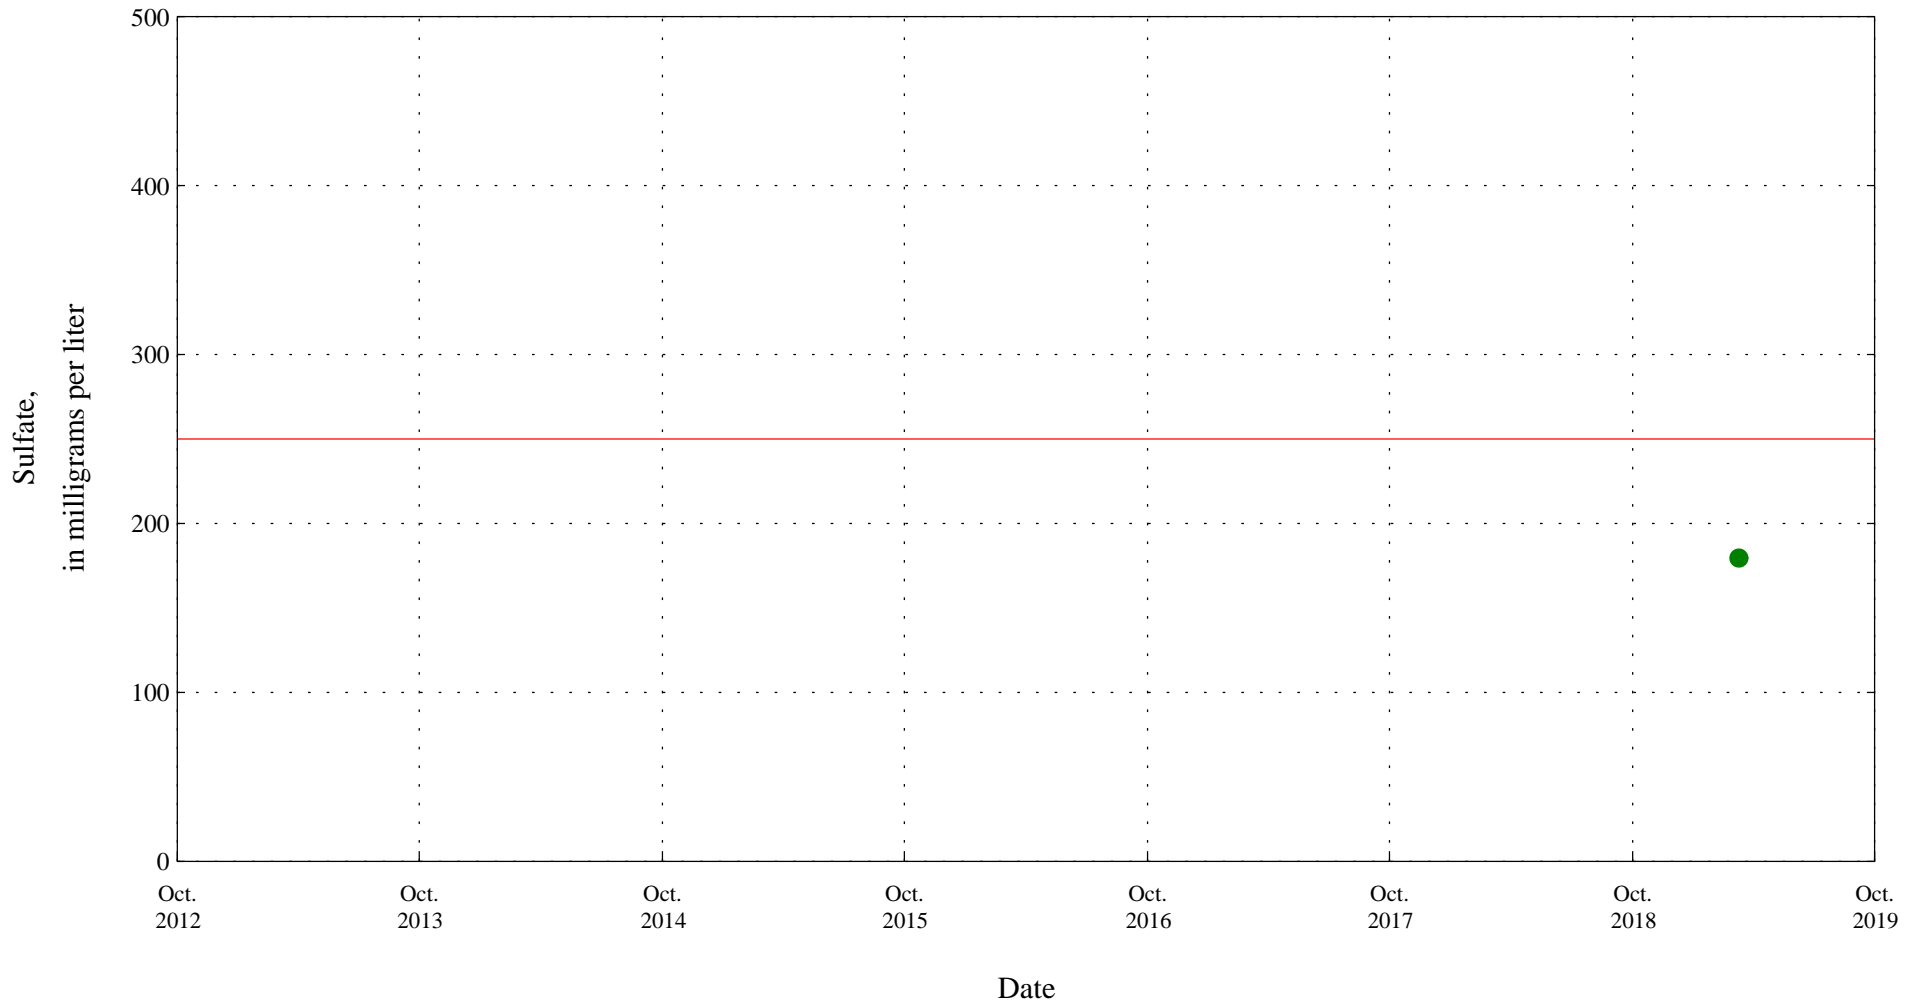
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Human Health Based Water Supply Chronic Standard 250

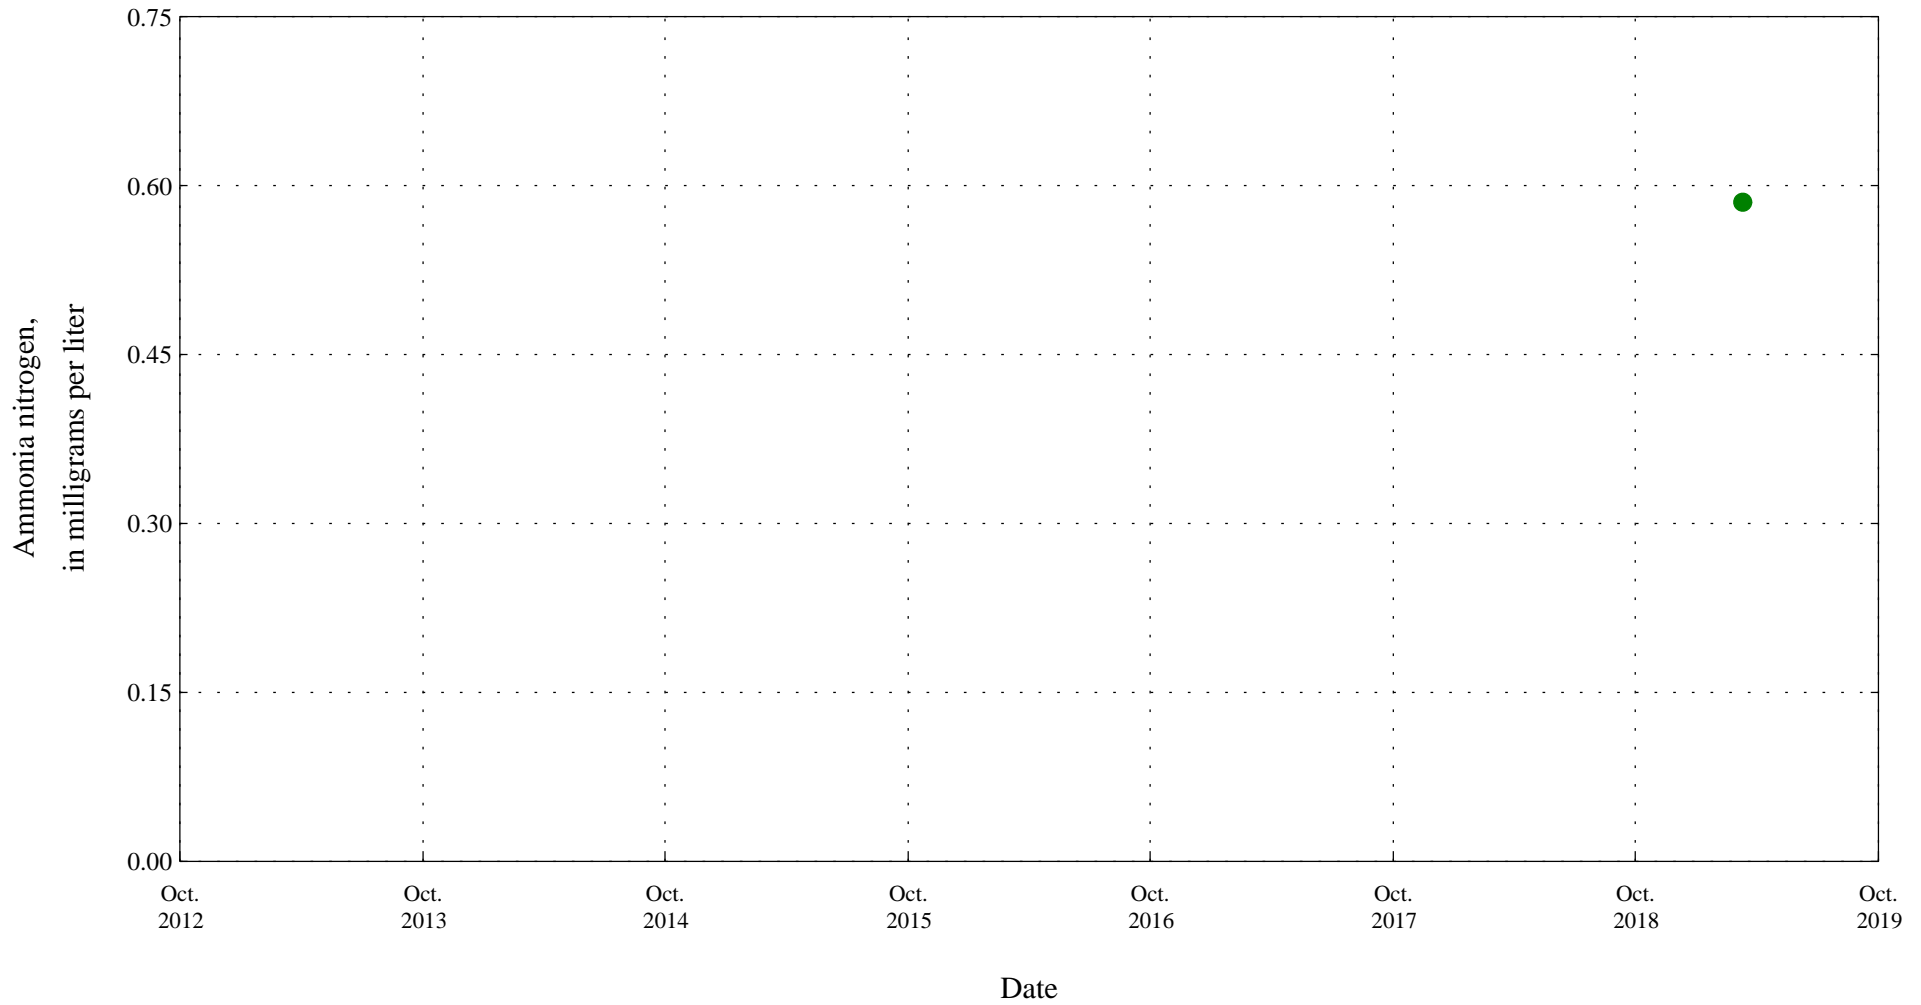
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Aquatic Life Acute Standard 8.4  
Aquatic Life Chronic Standard 3.3

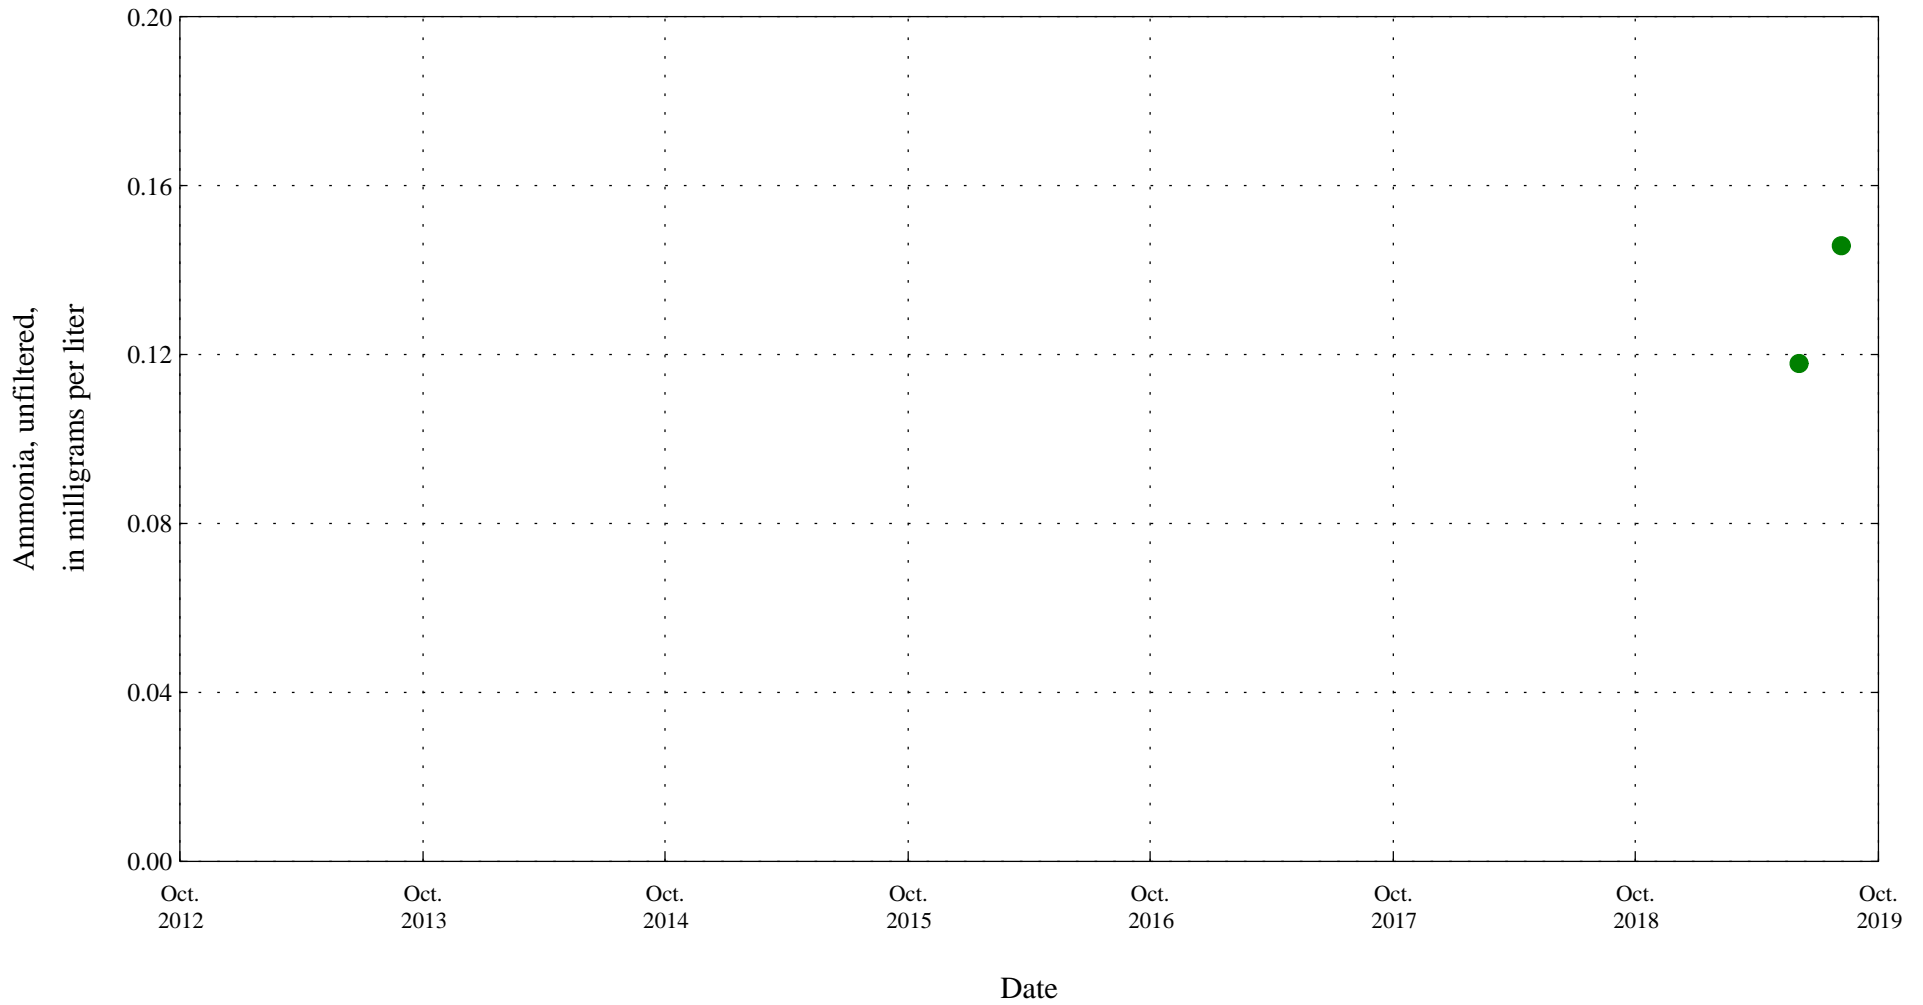Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

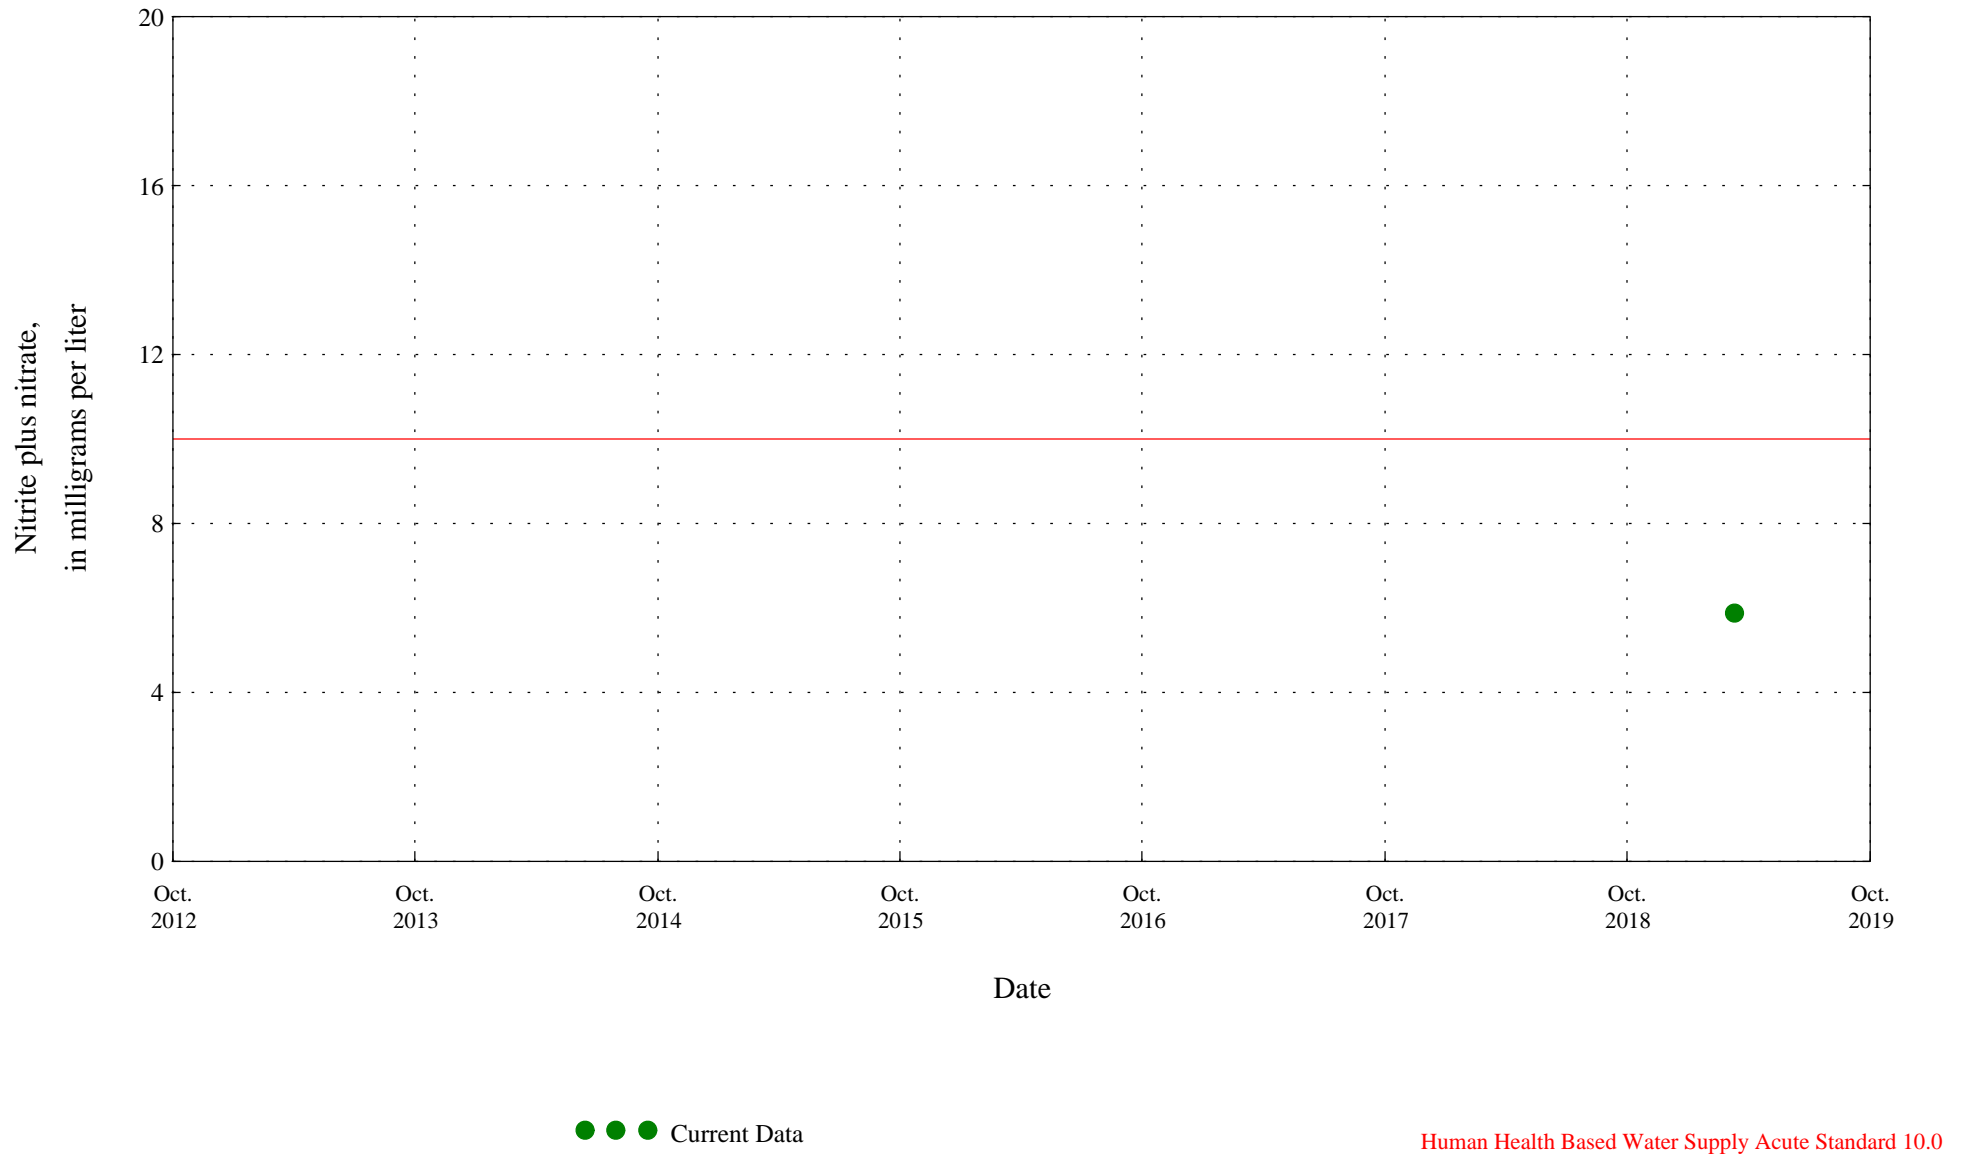


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.


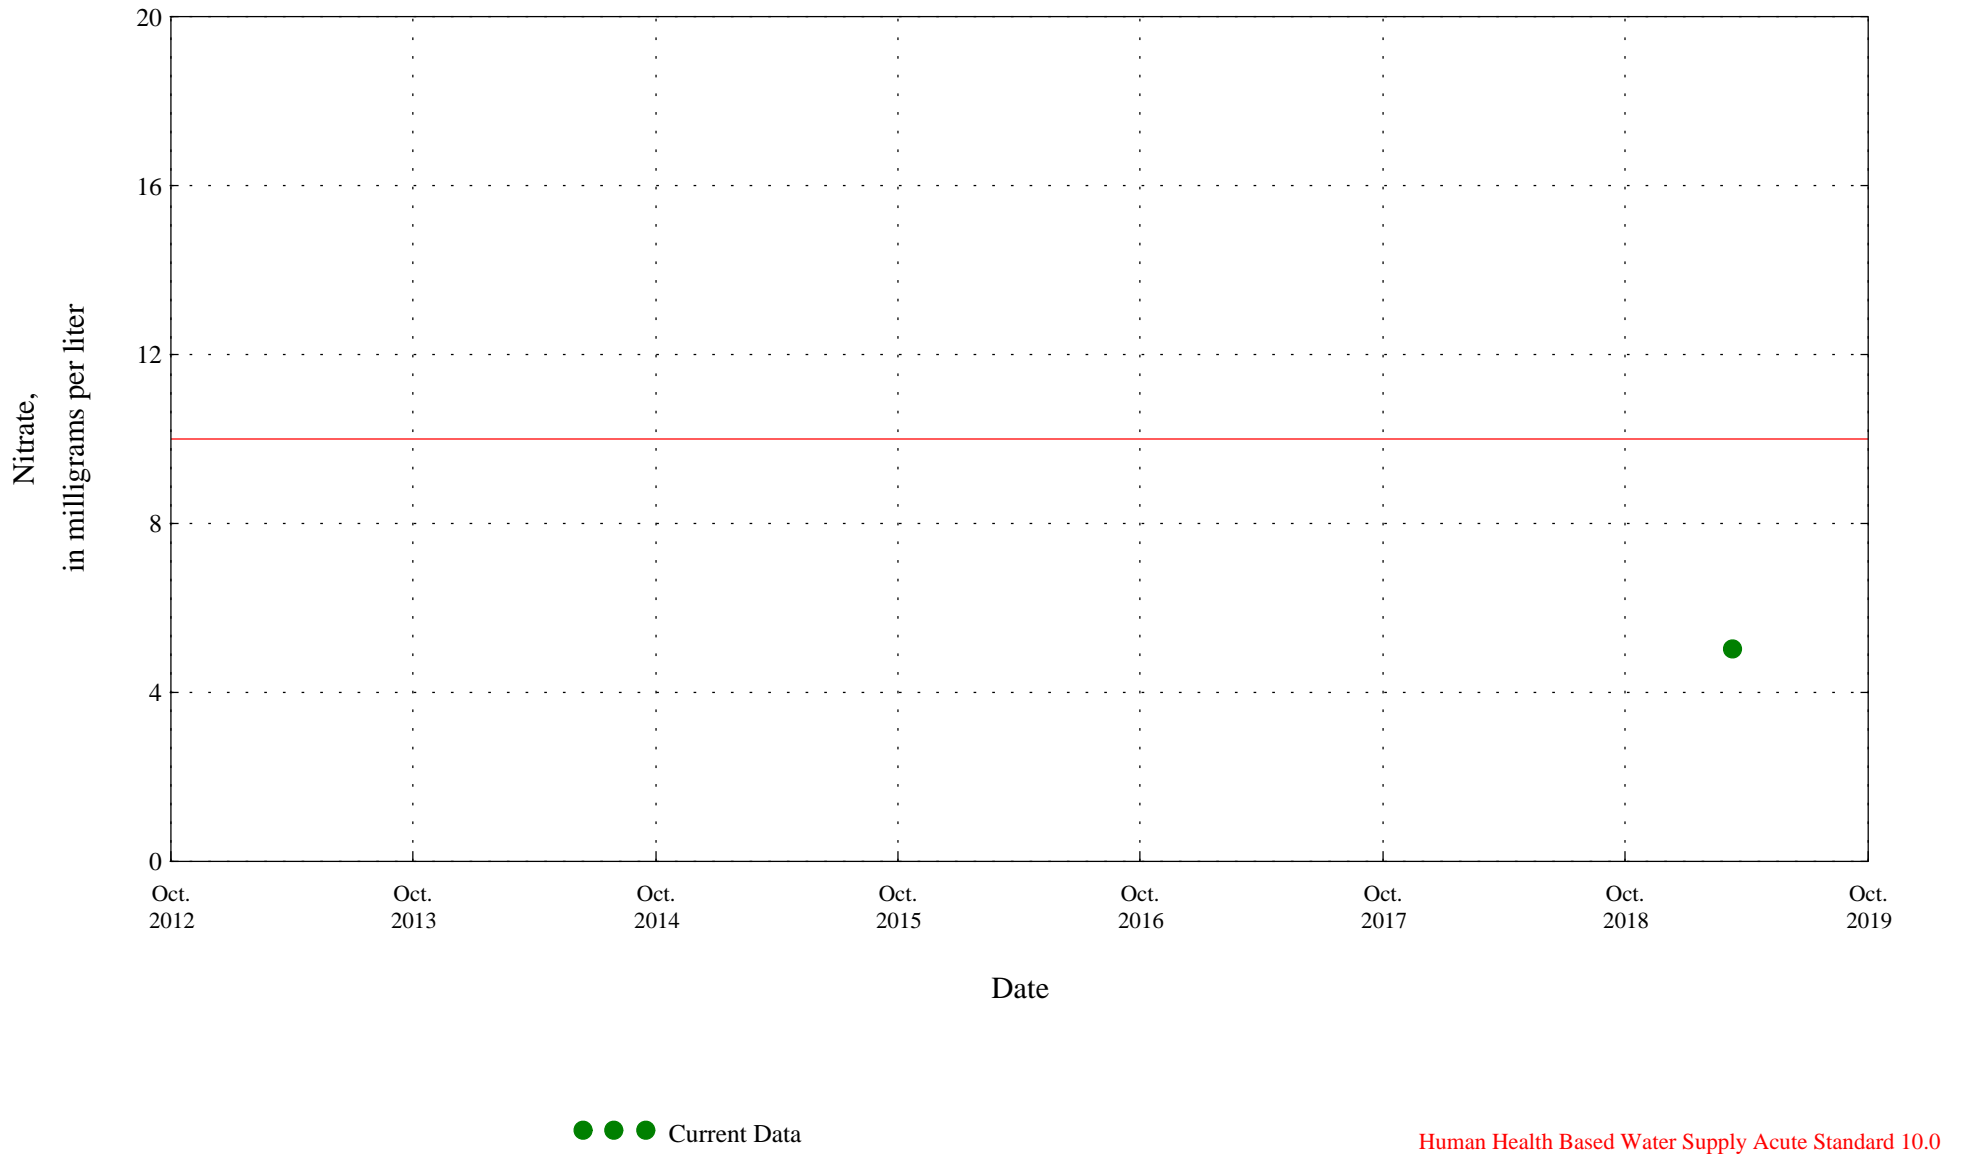


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

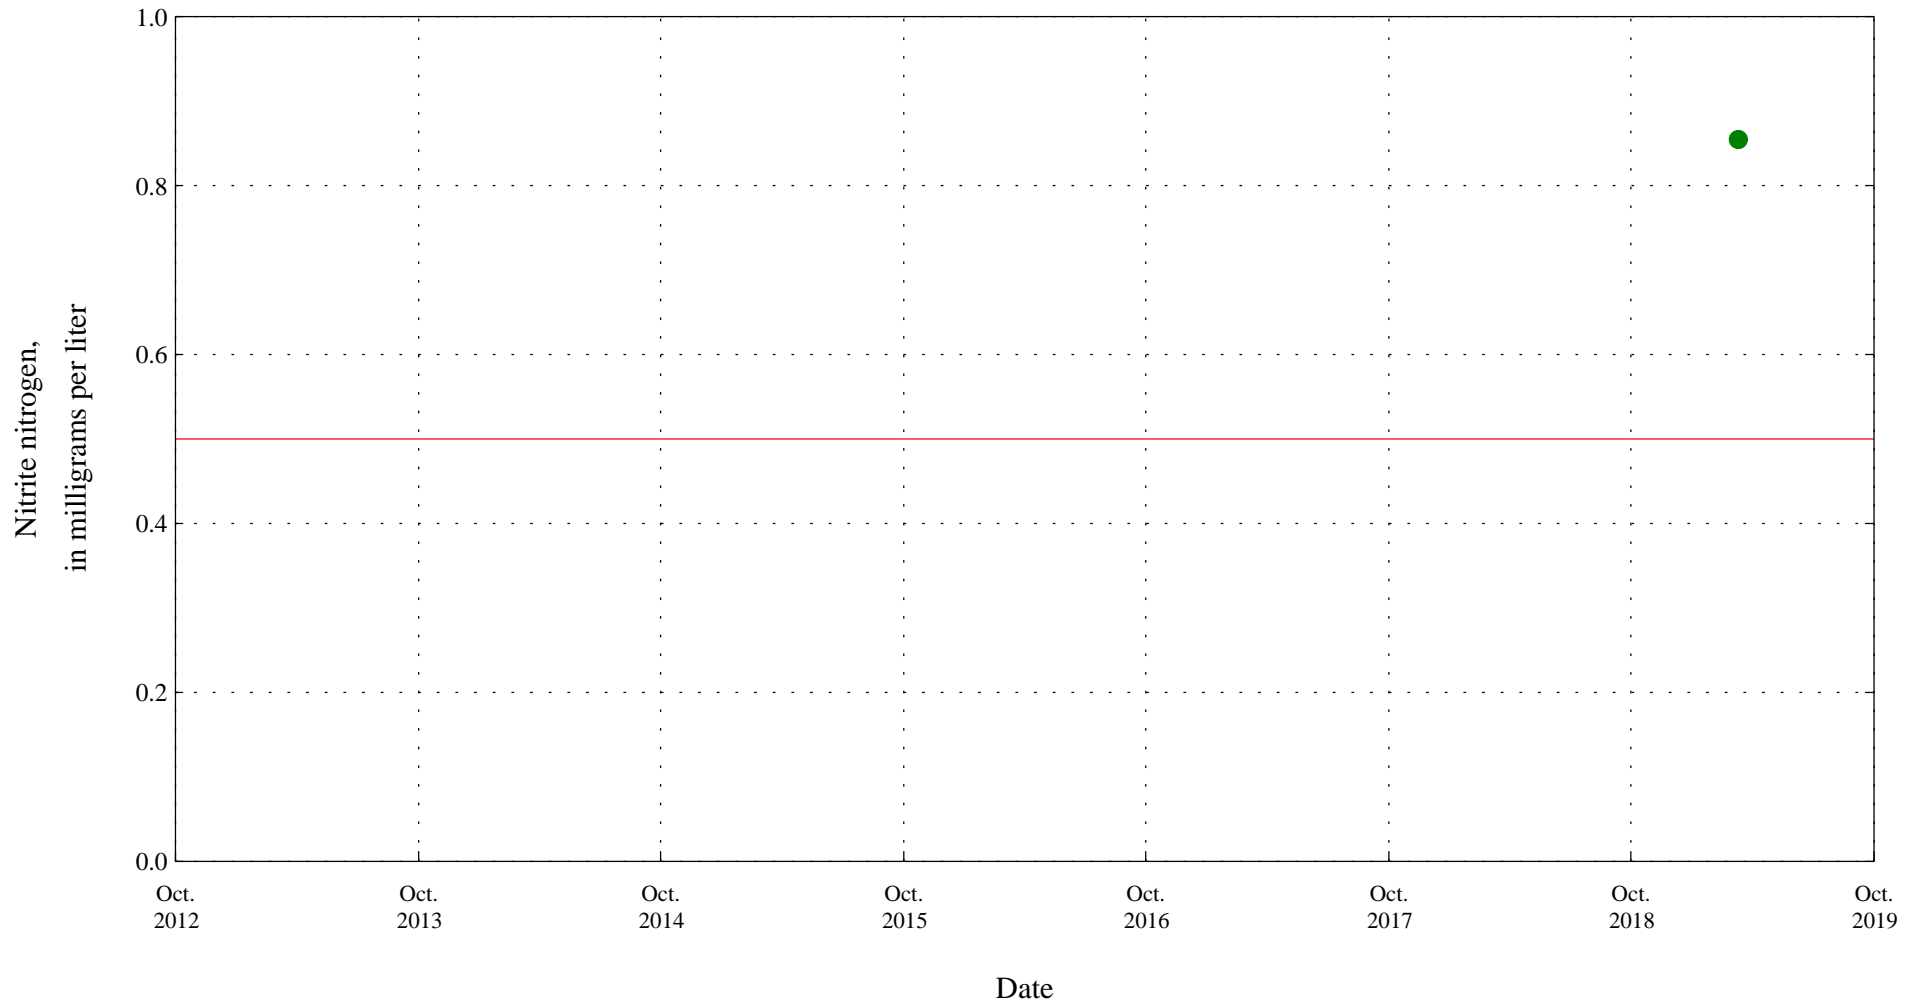


● ● ● Current Data

Aquatic Life Acute Standard 0.50



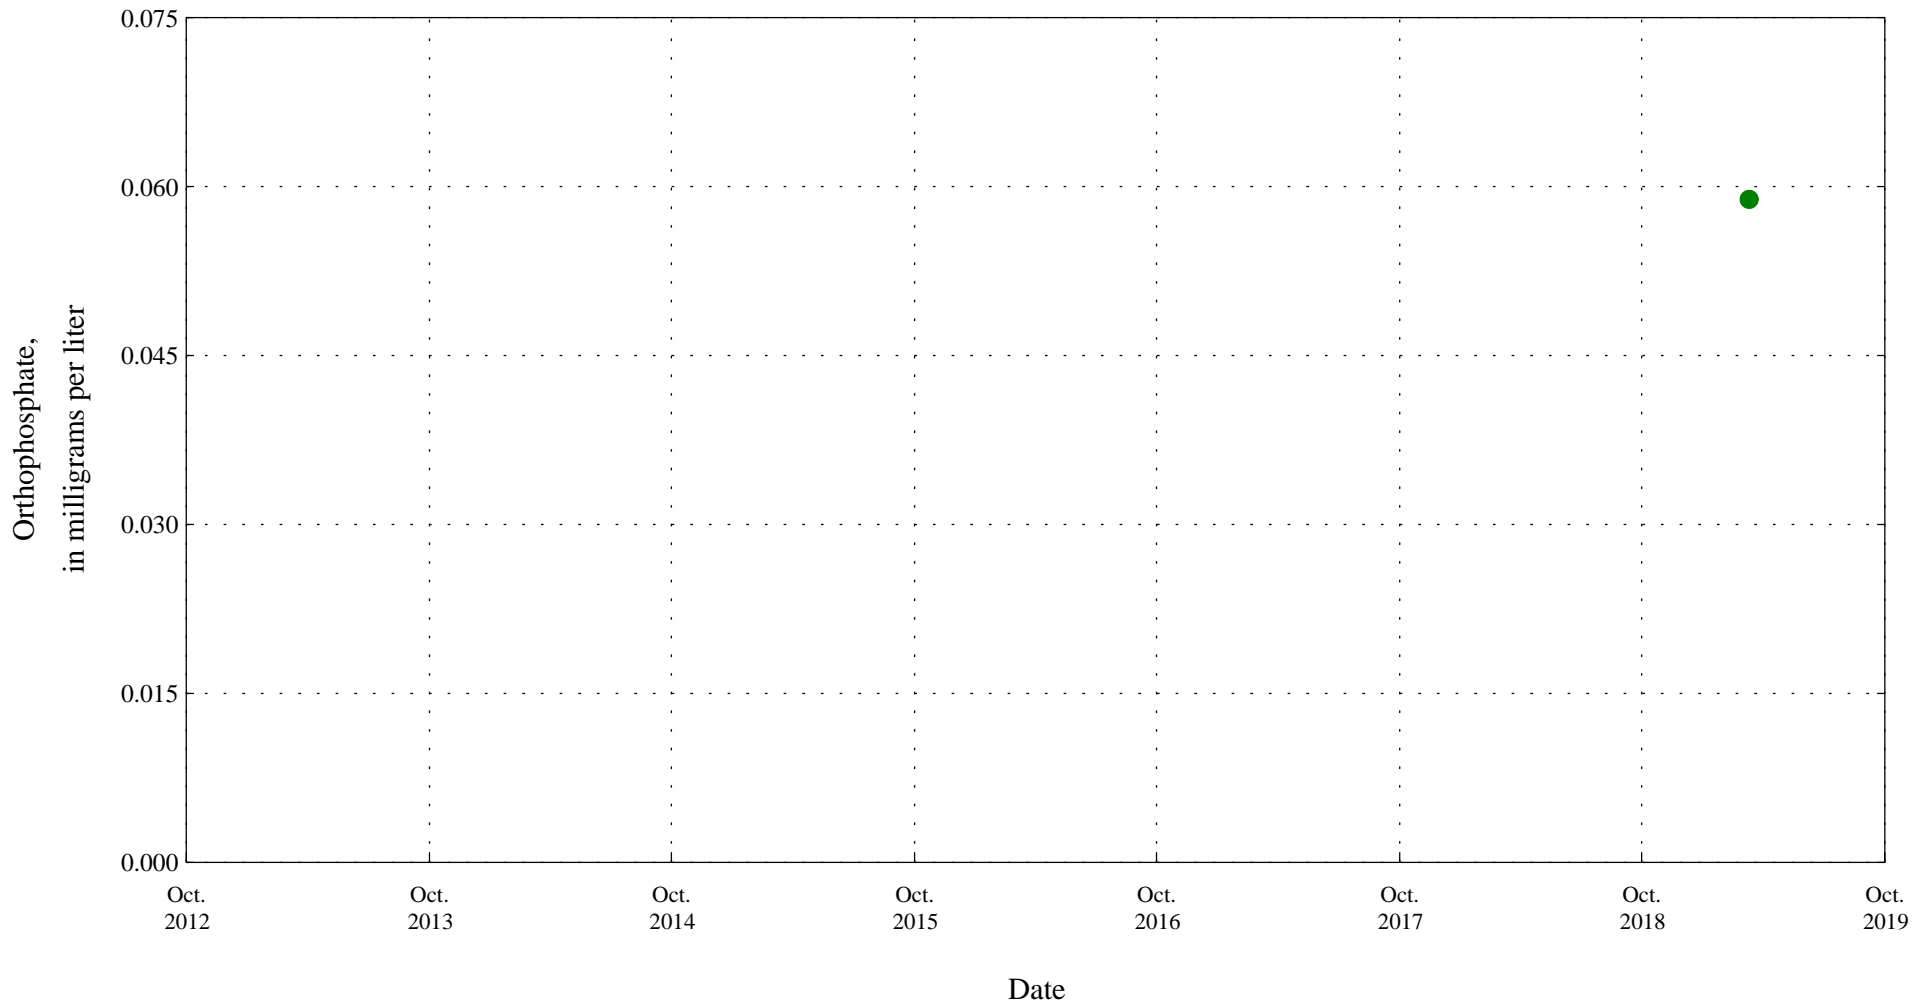Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.






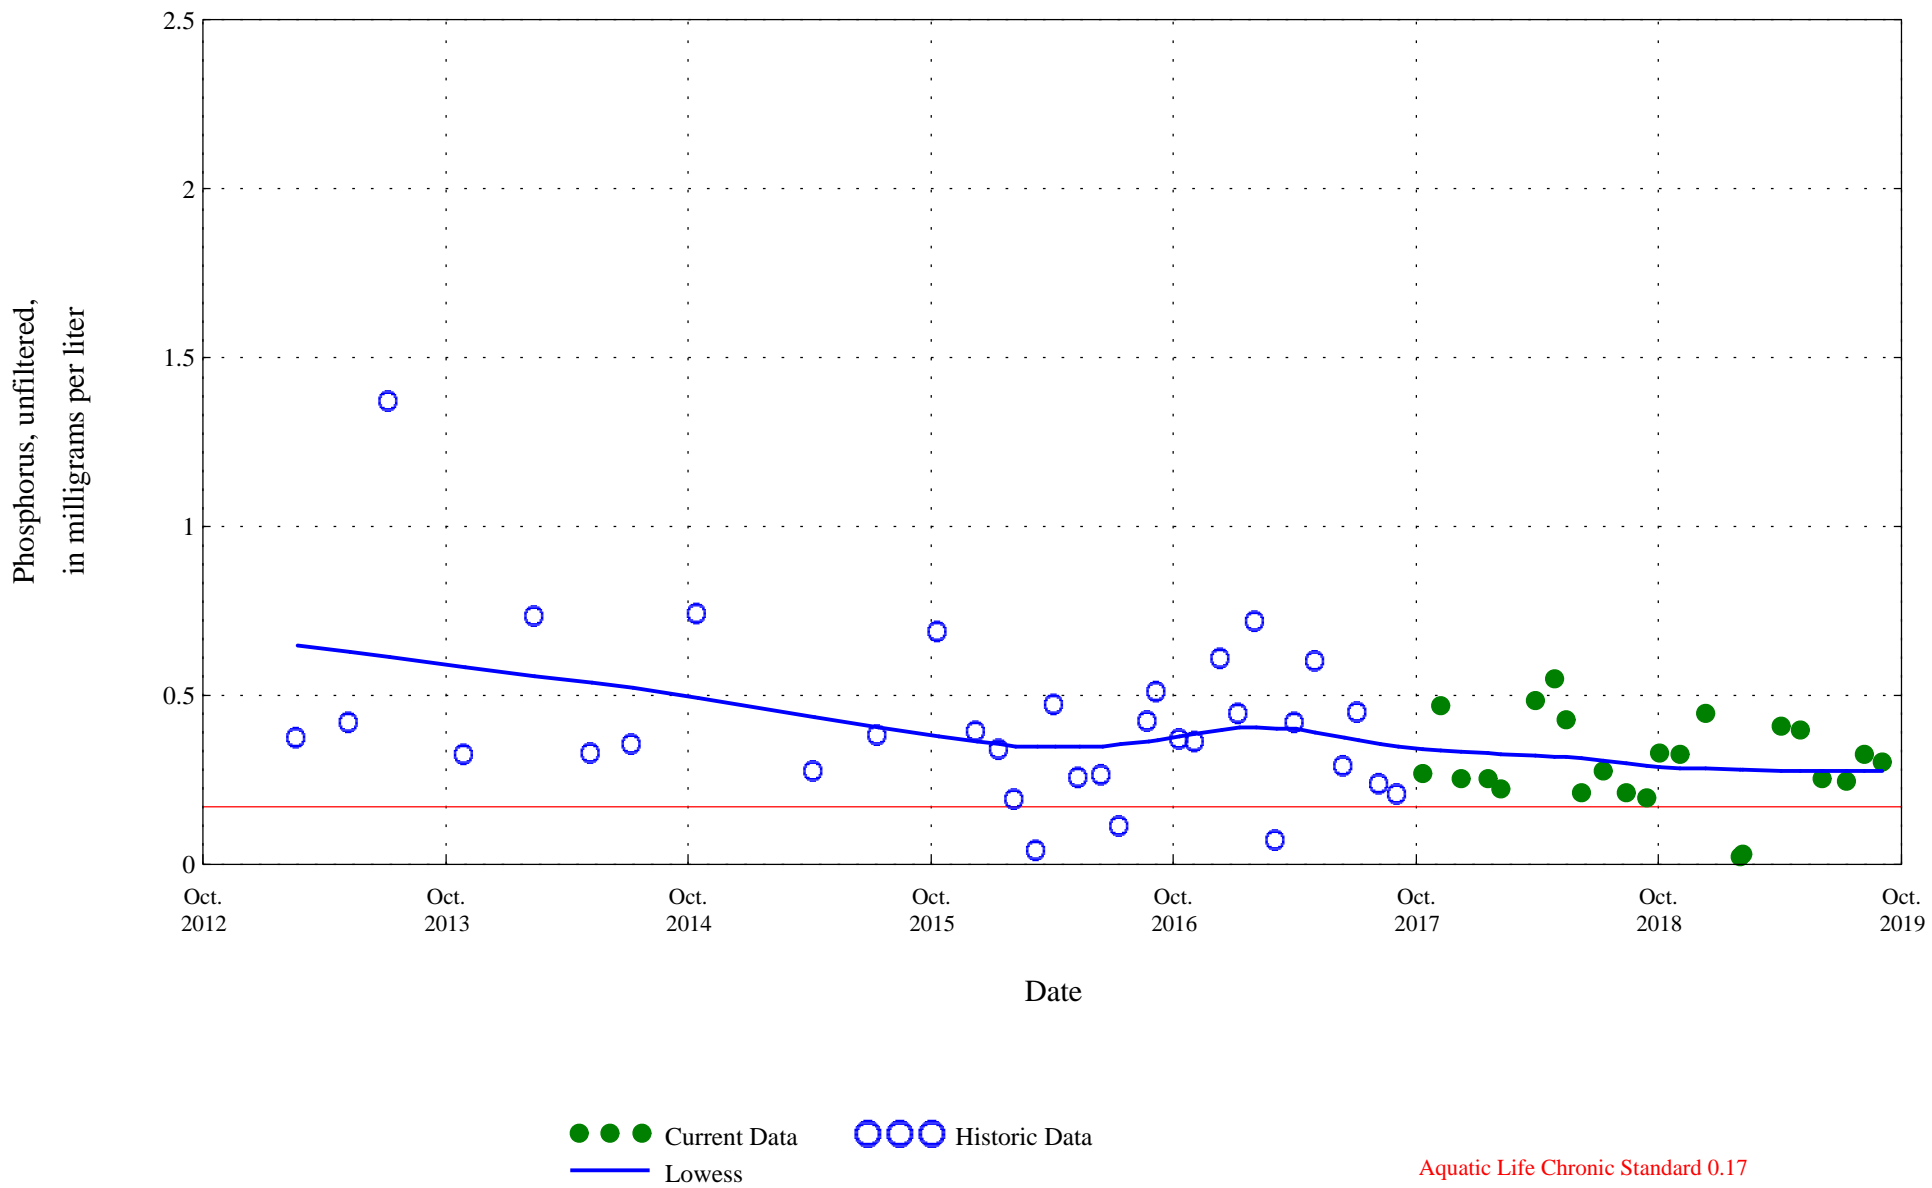Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

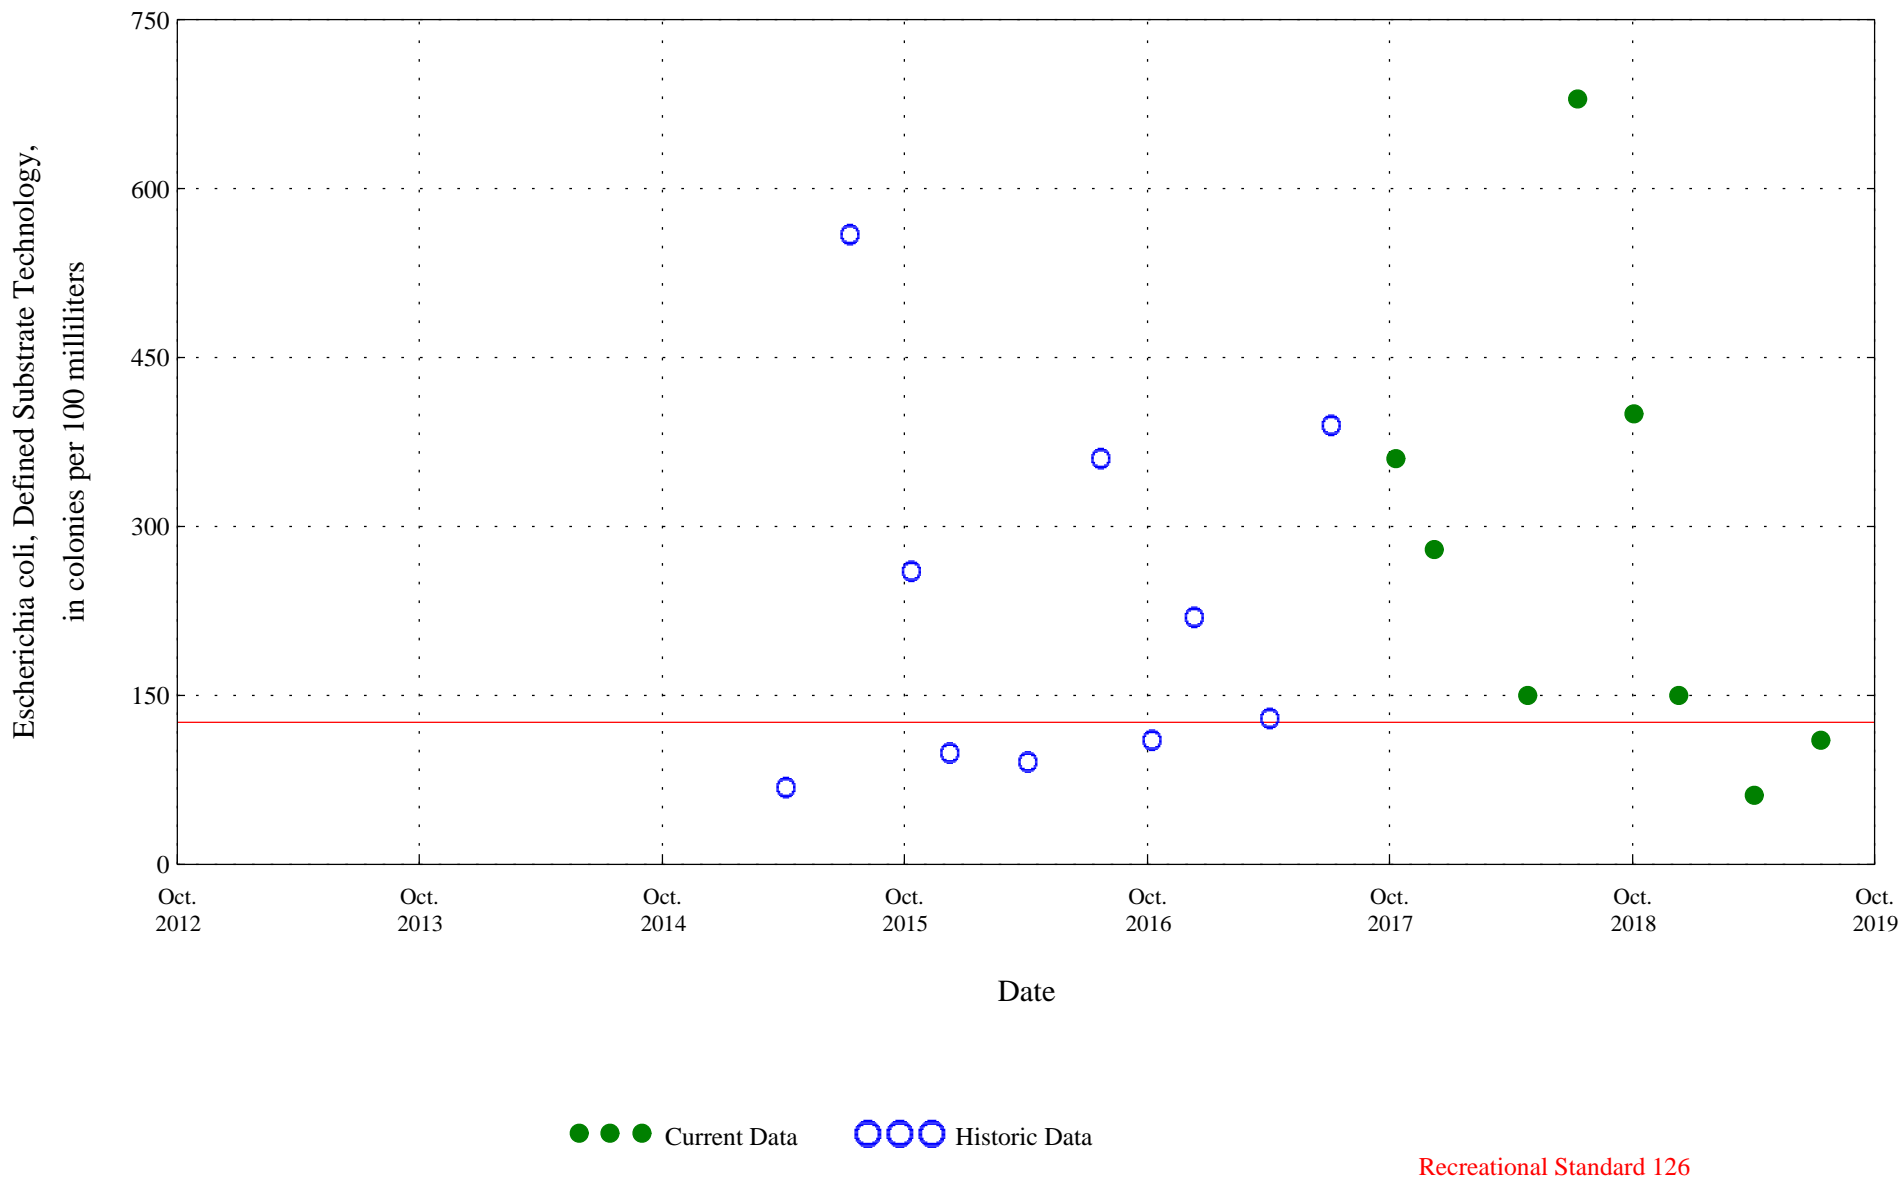


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



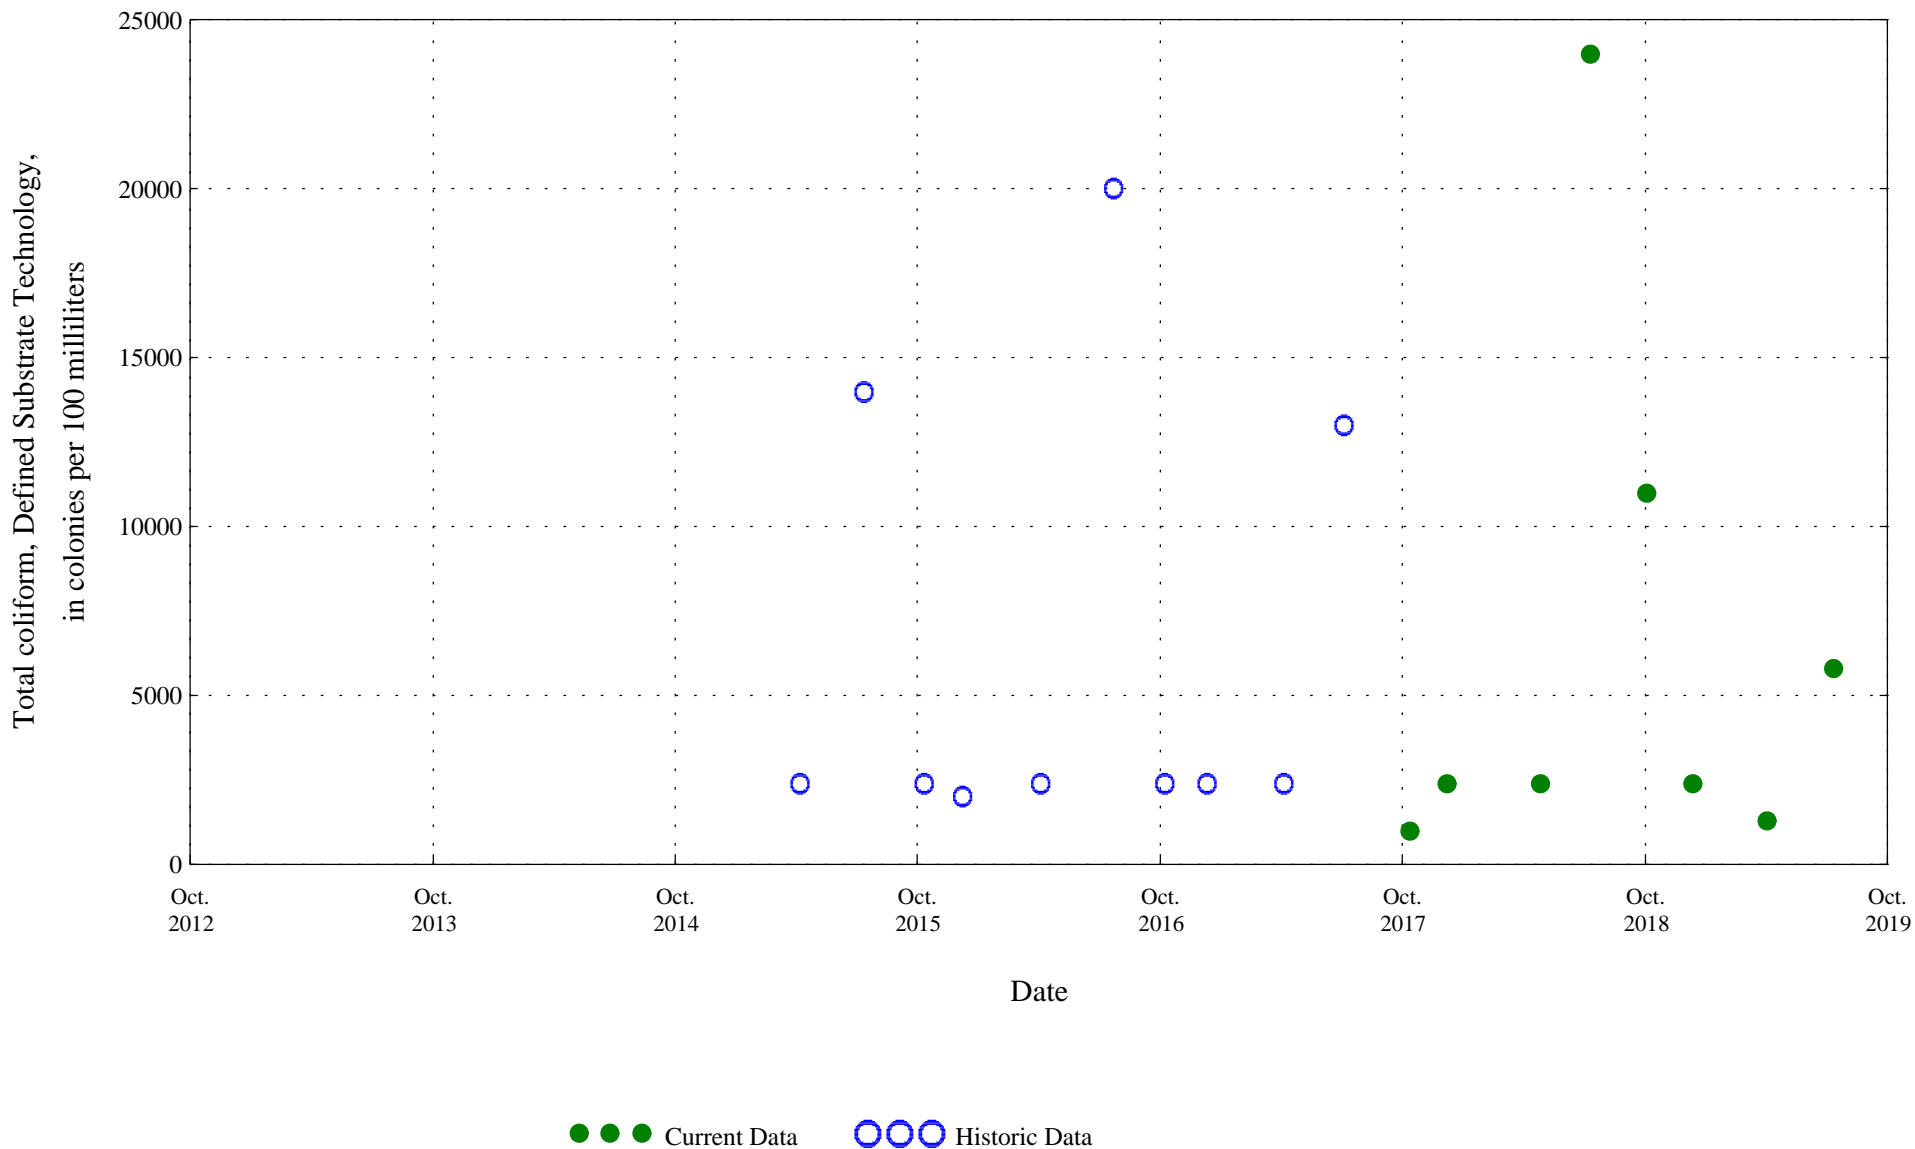


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.

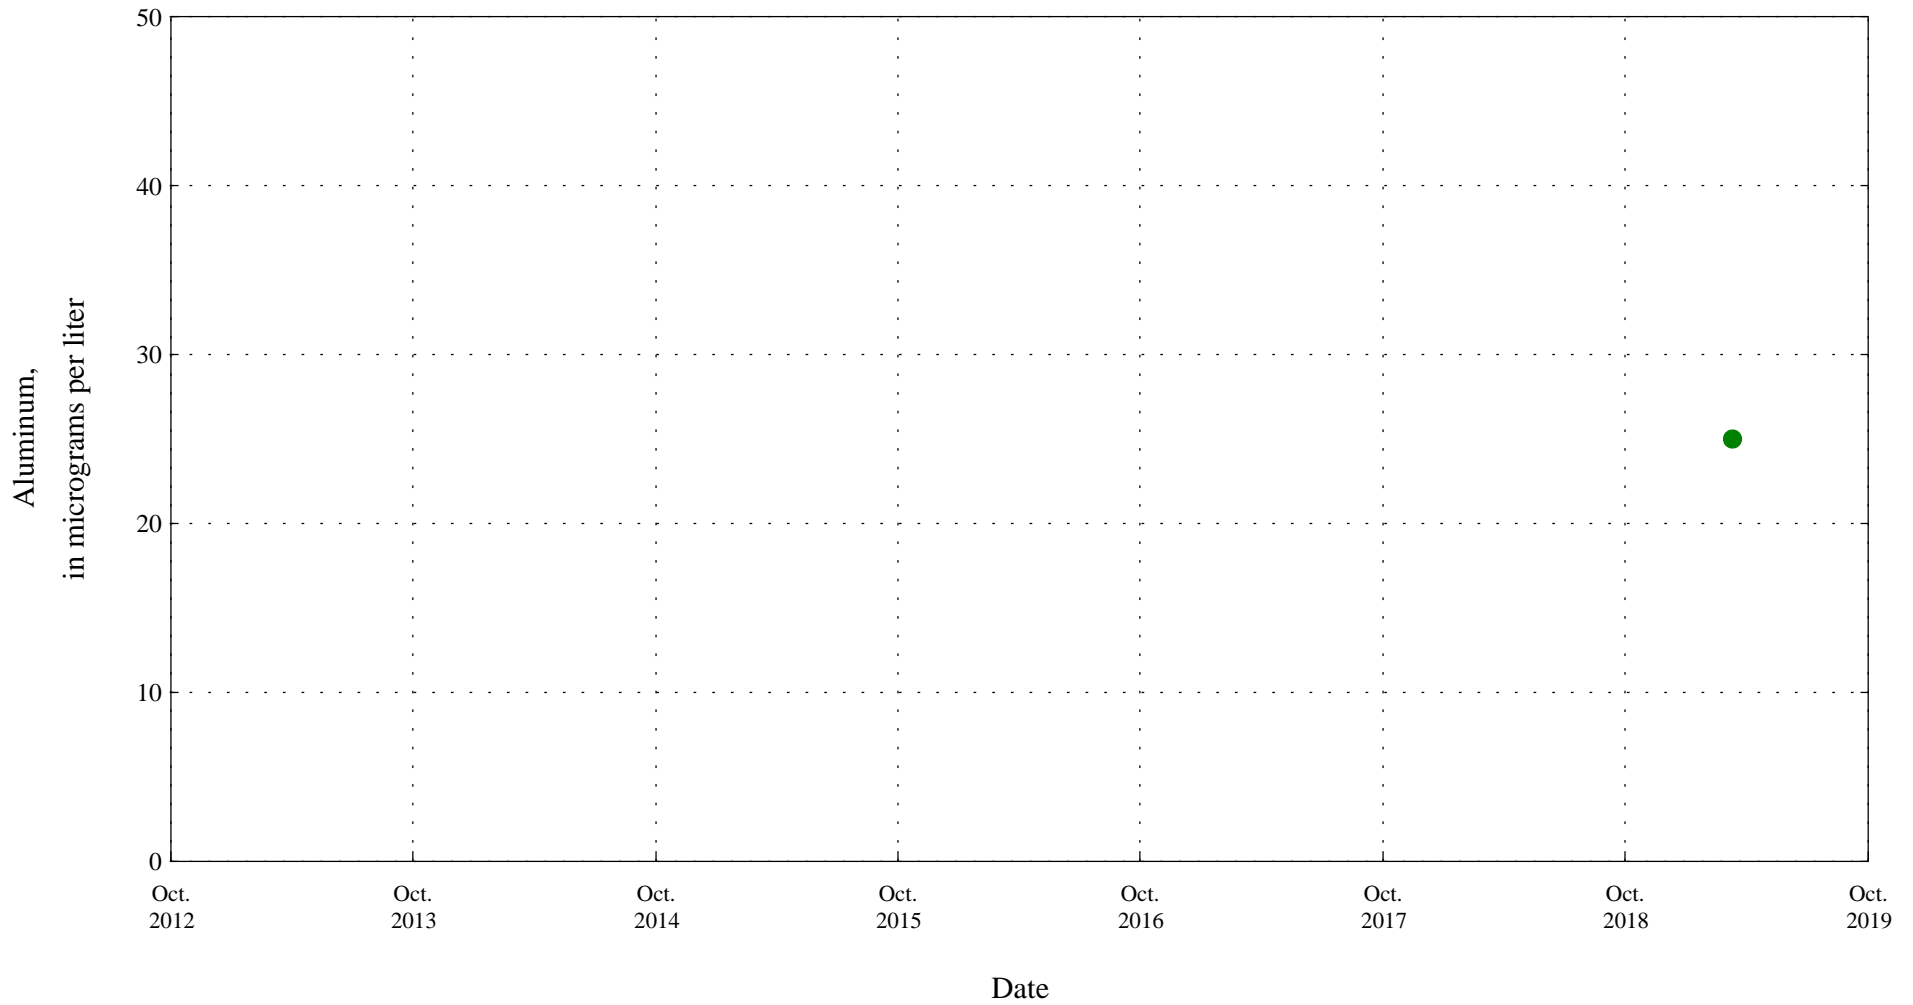

● ● ● Current Data

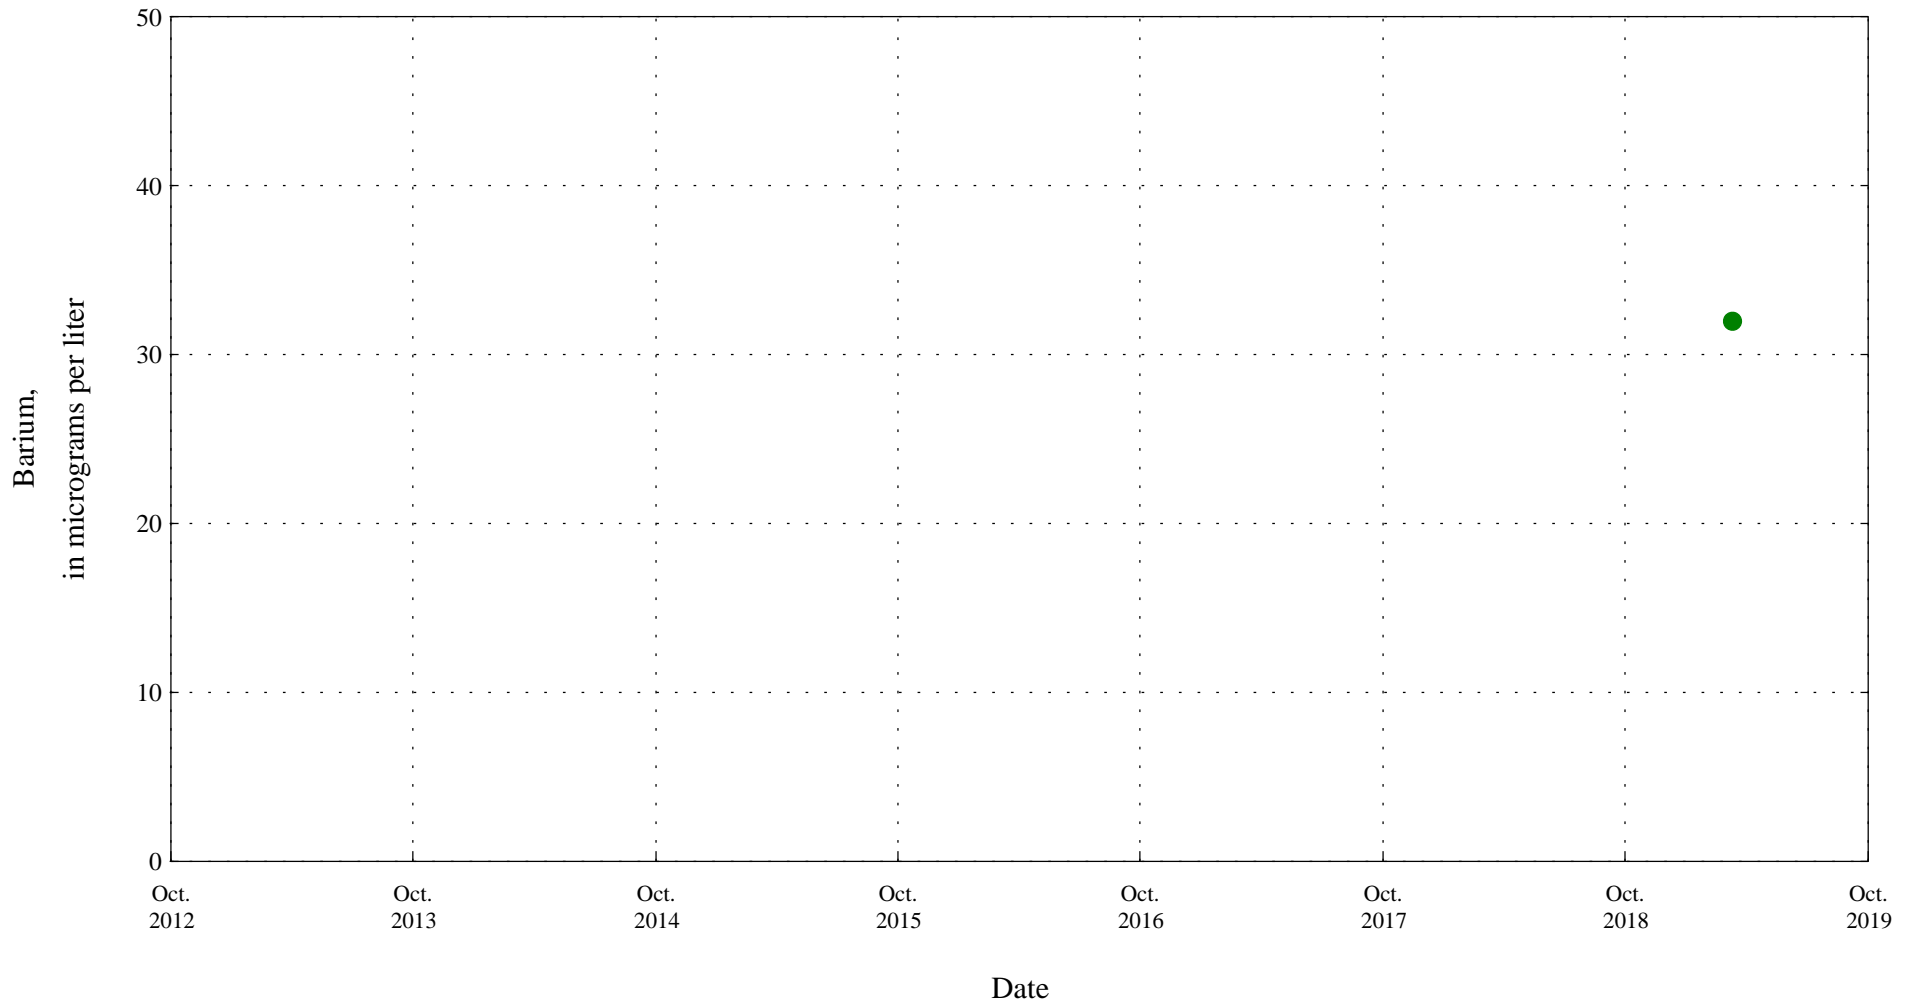
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Water Supply Chronic Standard 1,000

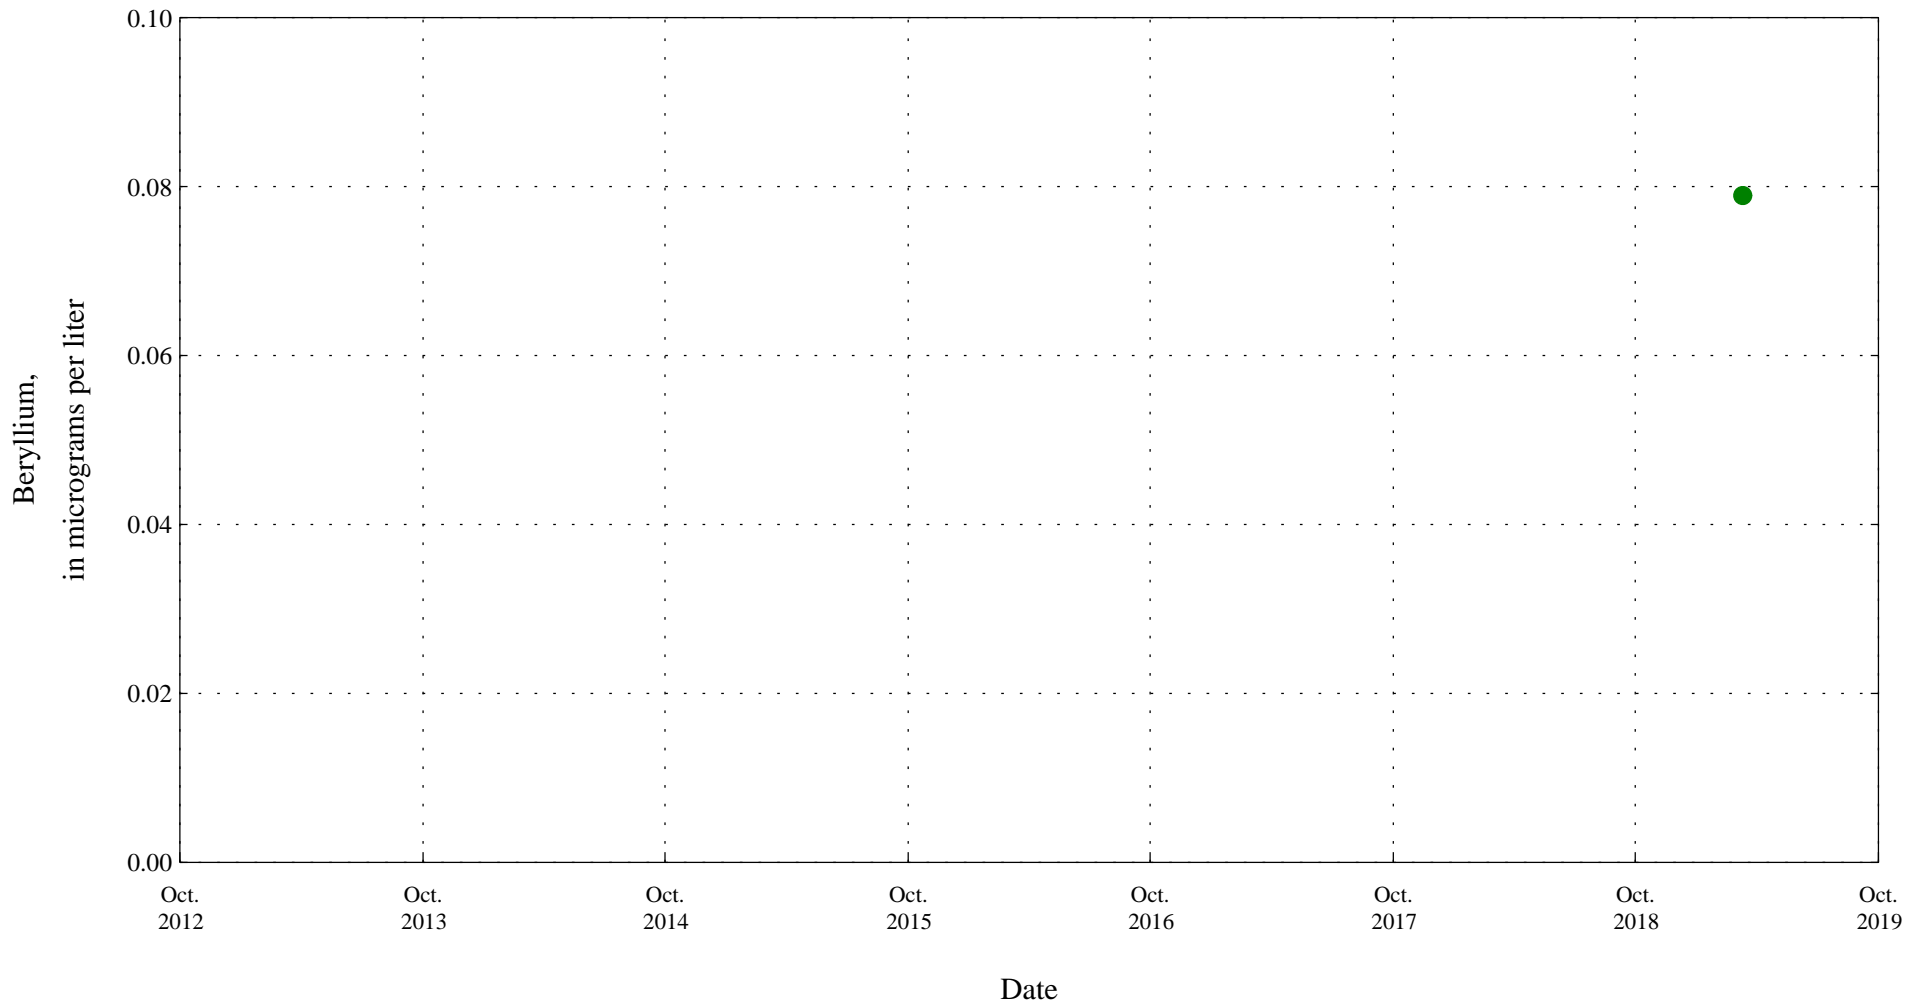Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

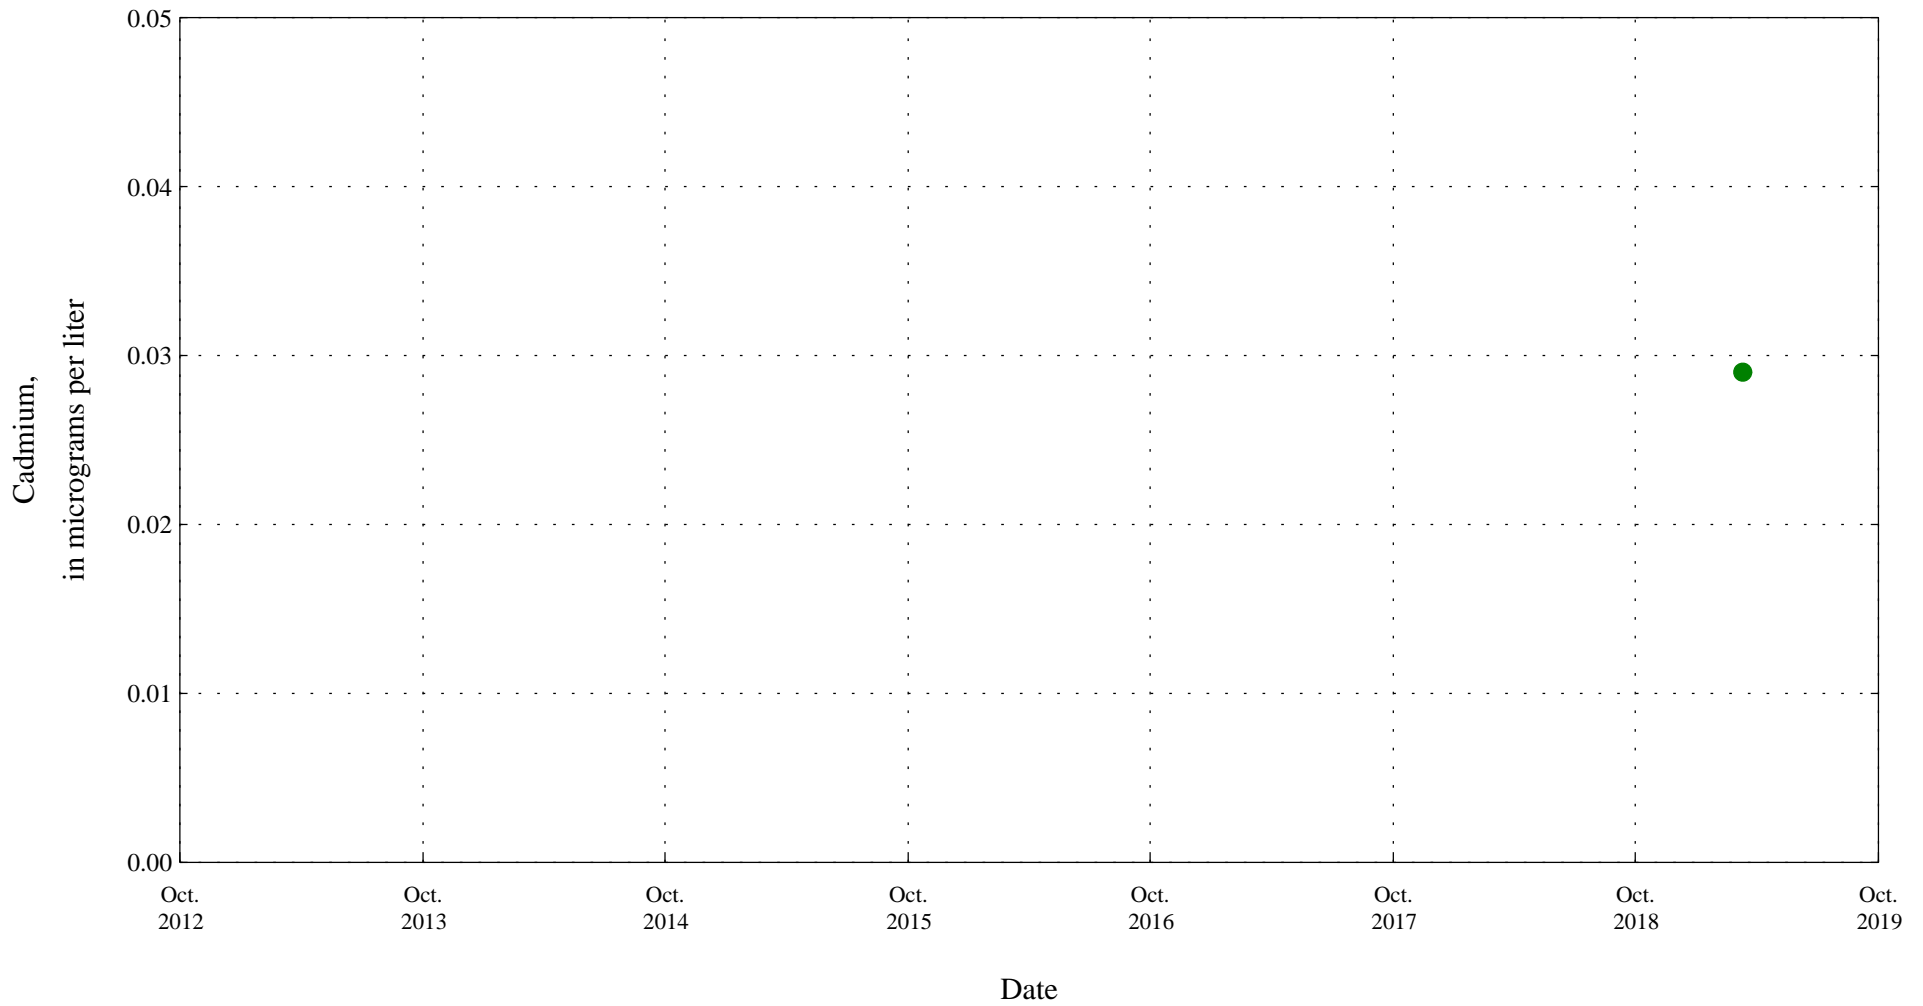Water Supply Chronic Standard 4.0

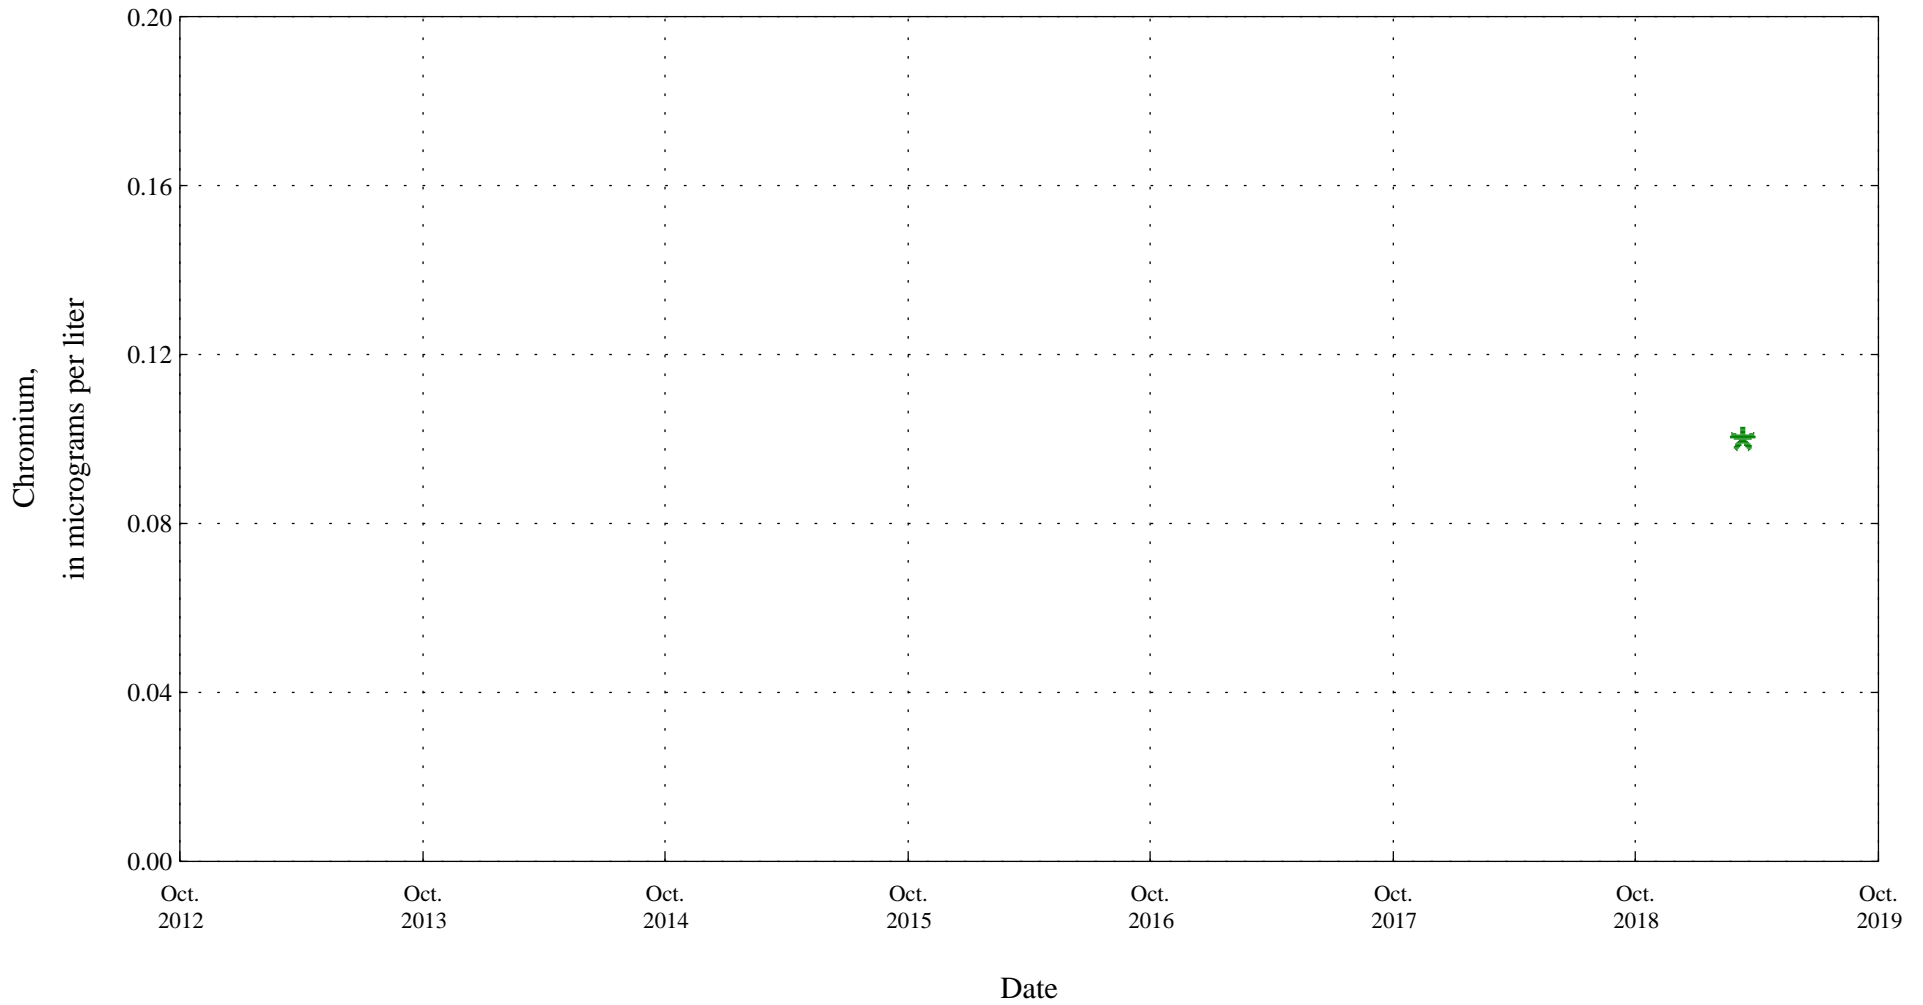


Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




\* \* \* Current Censored Data

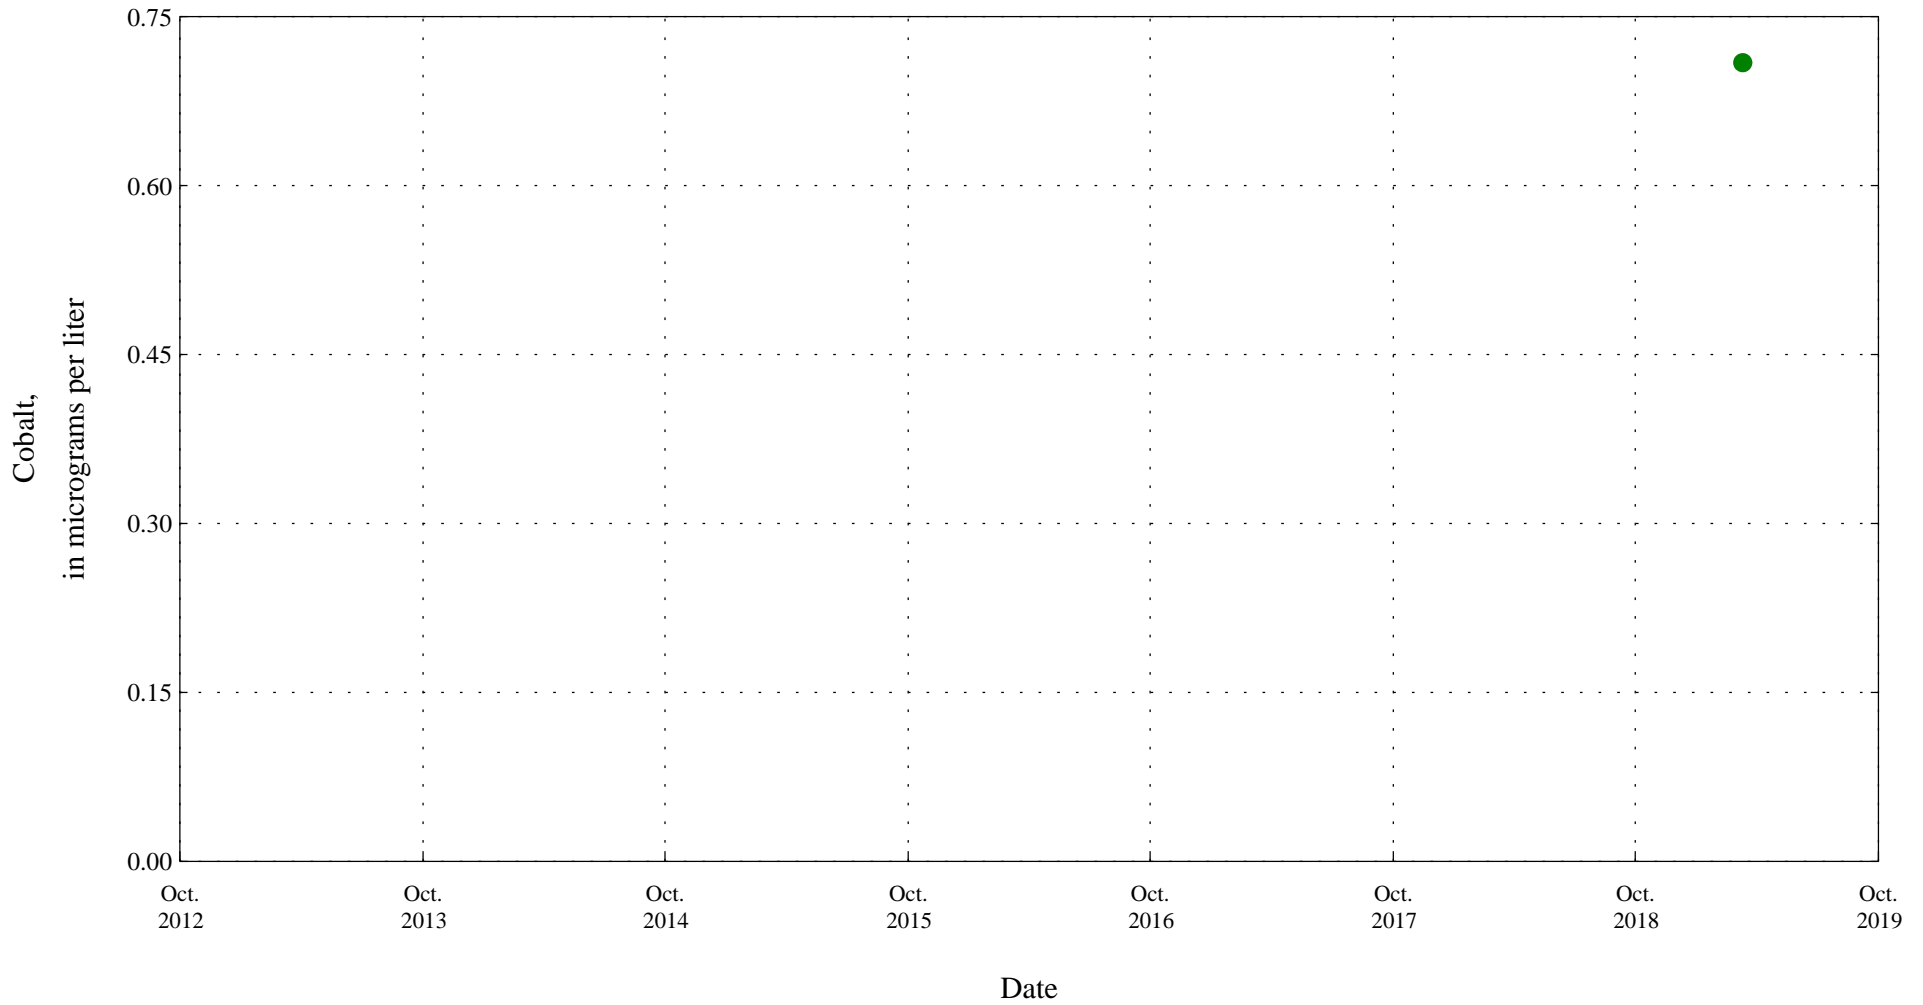Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

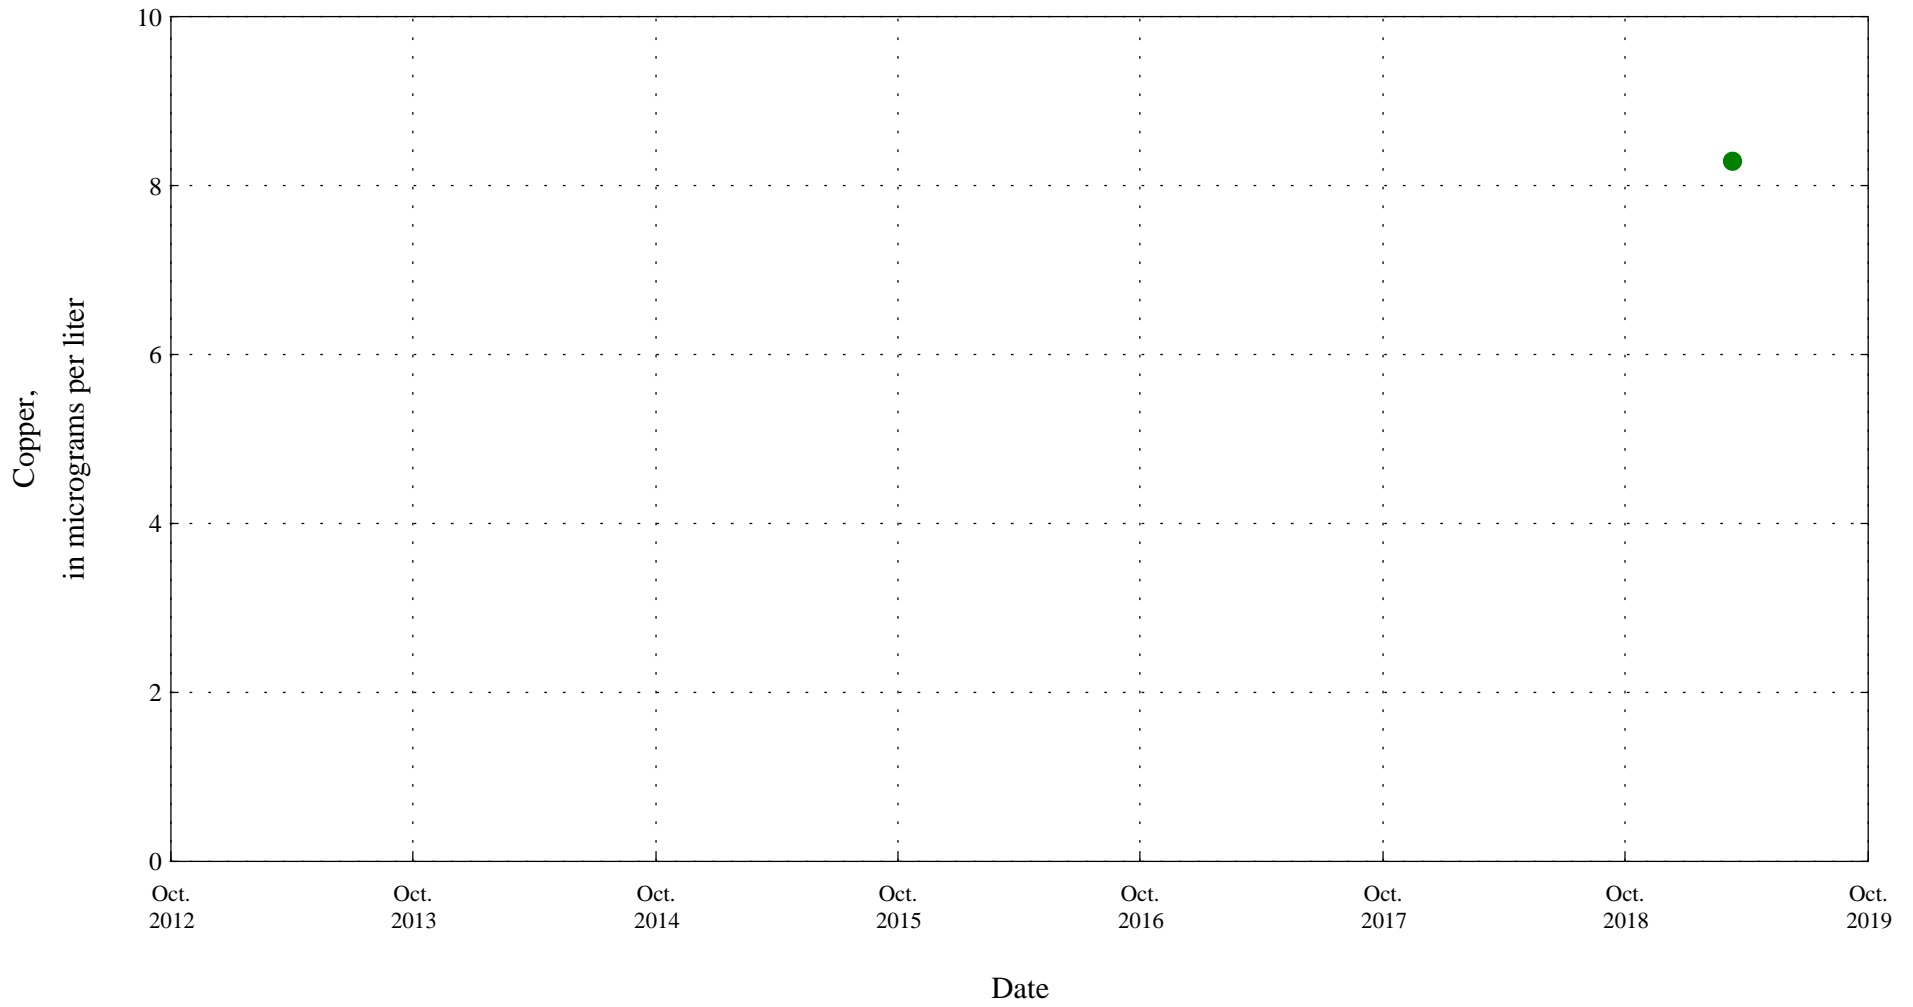Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

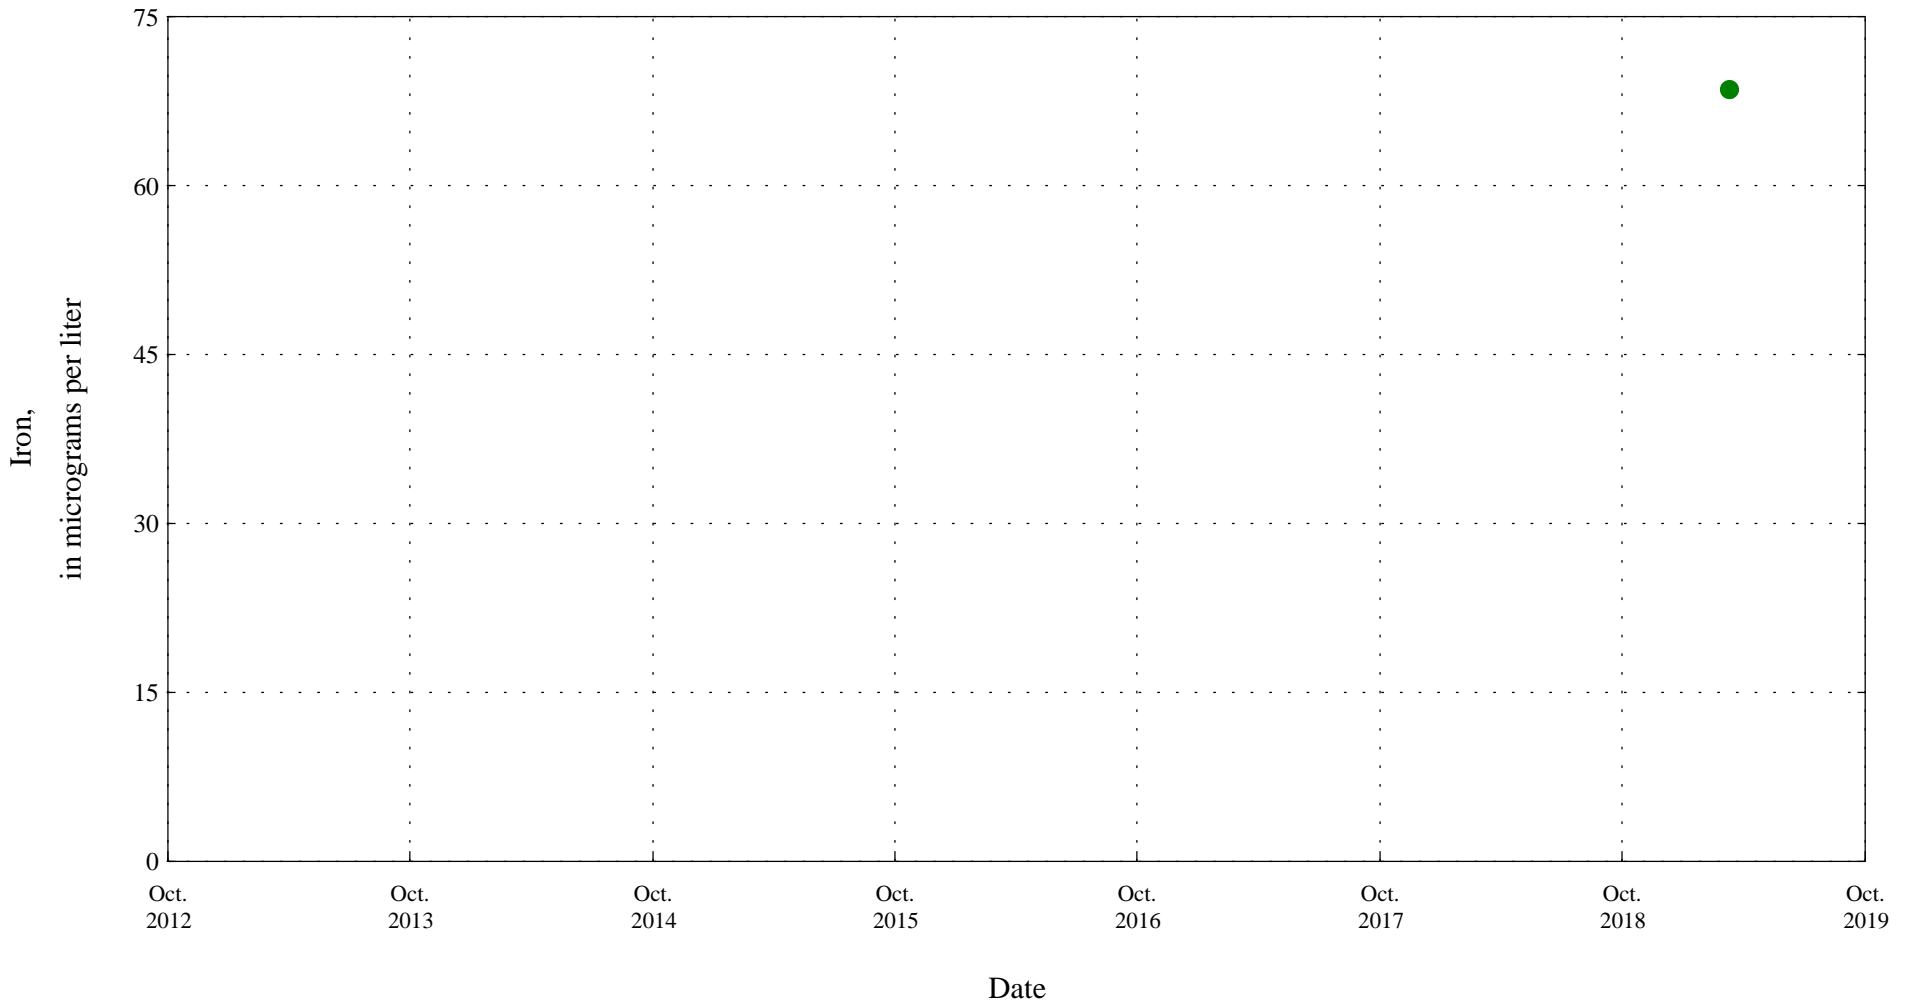
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data


Human Health Based Water Supply Chronic Standard 300

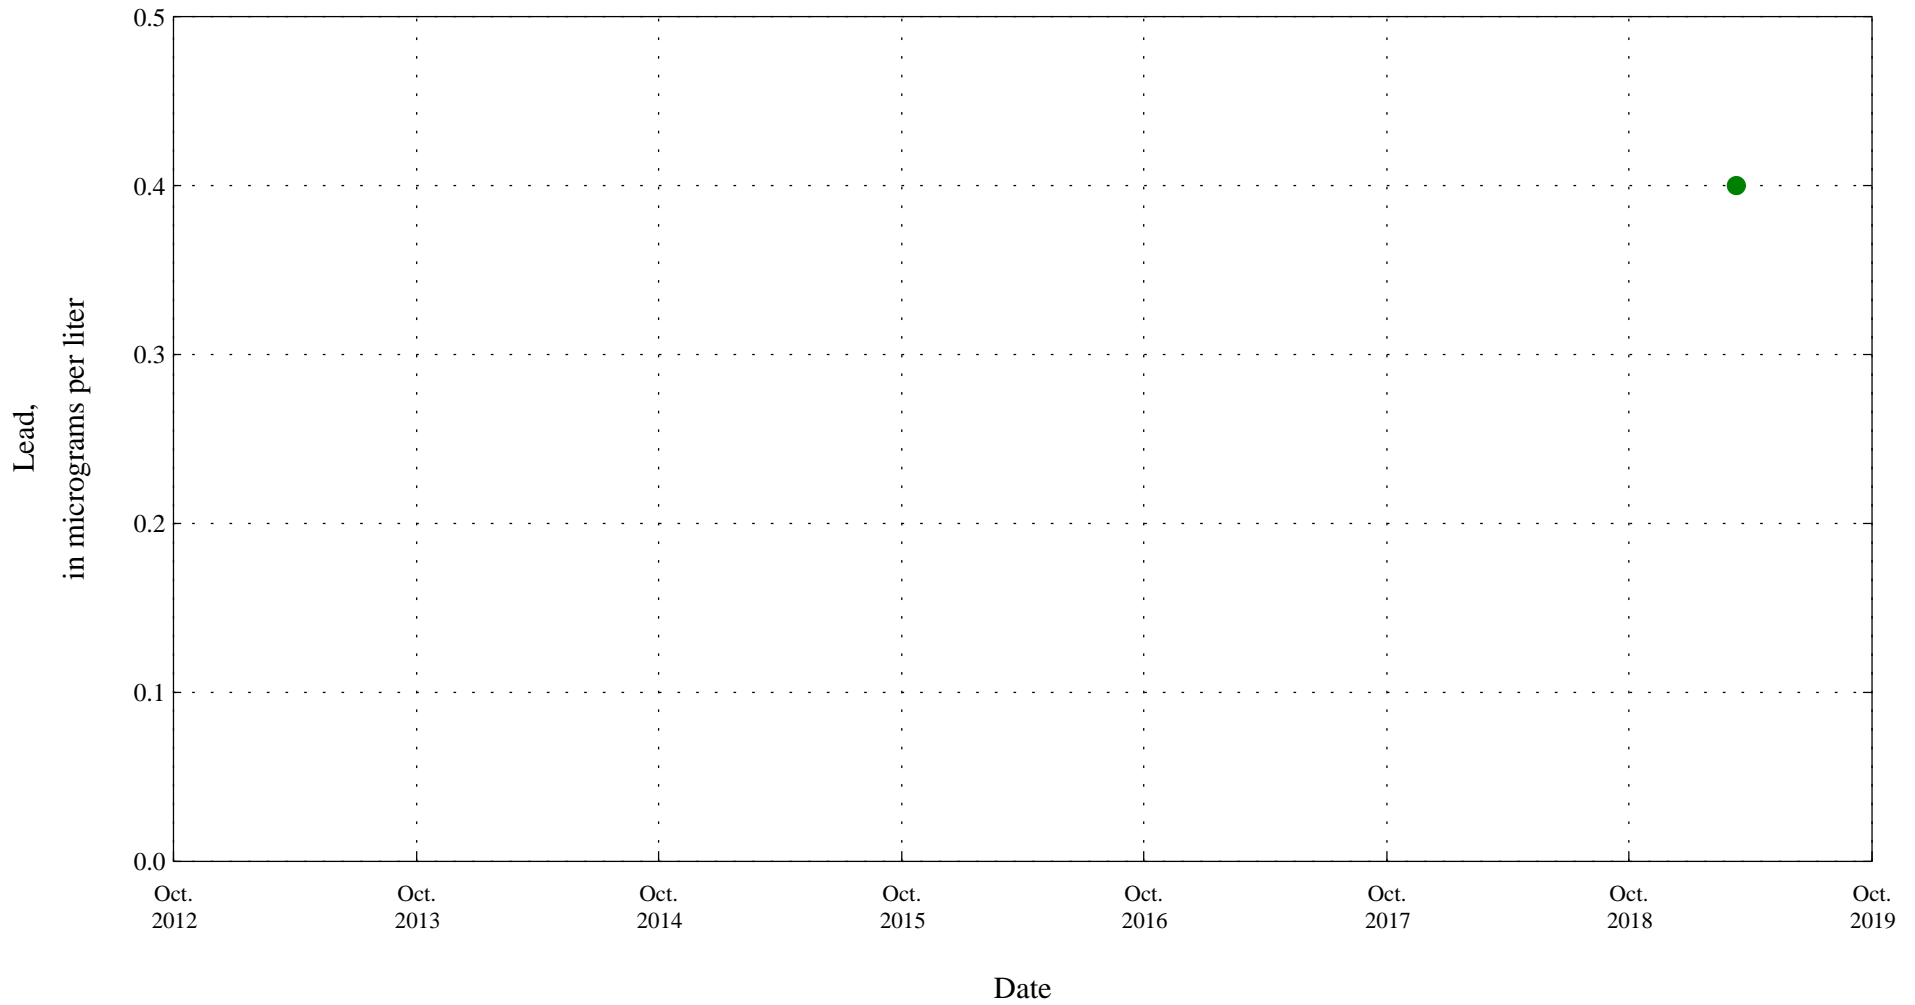Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

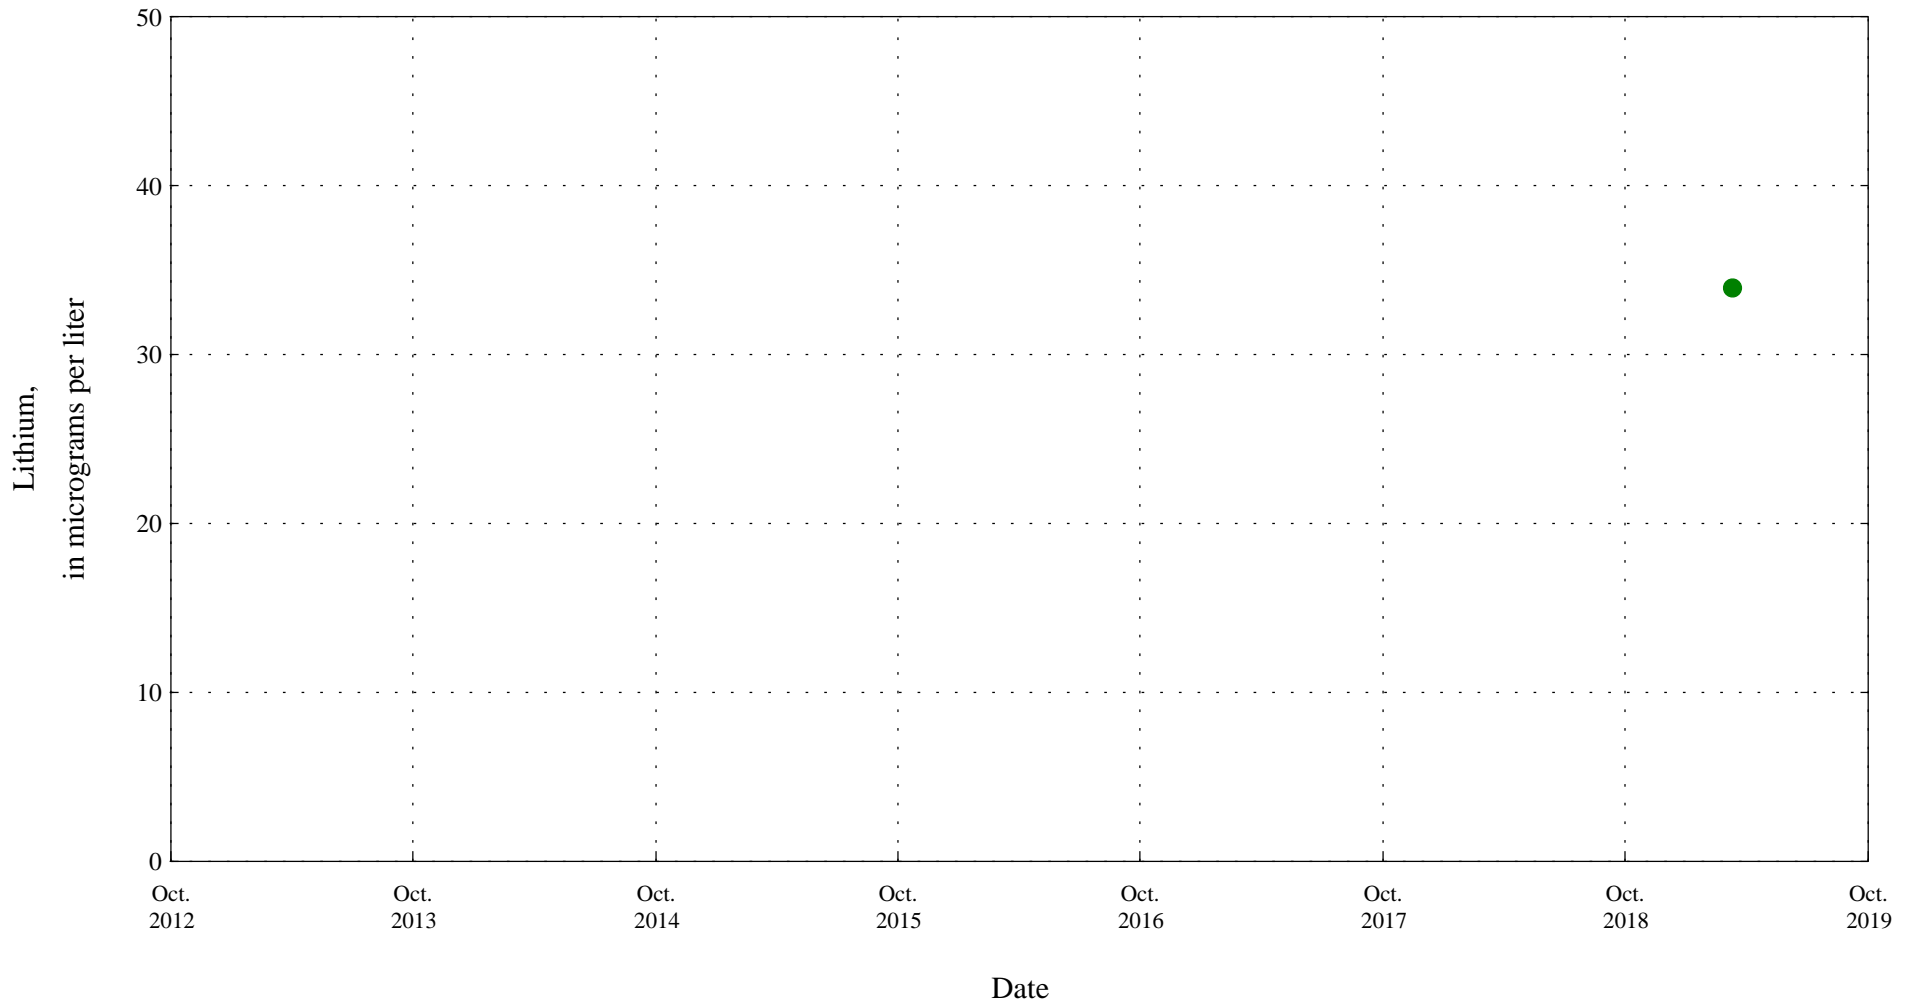Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

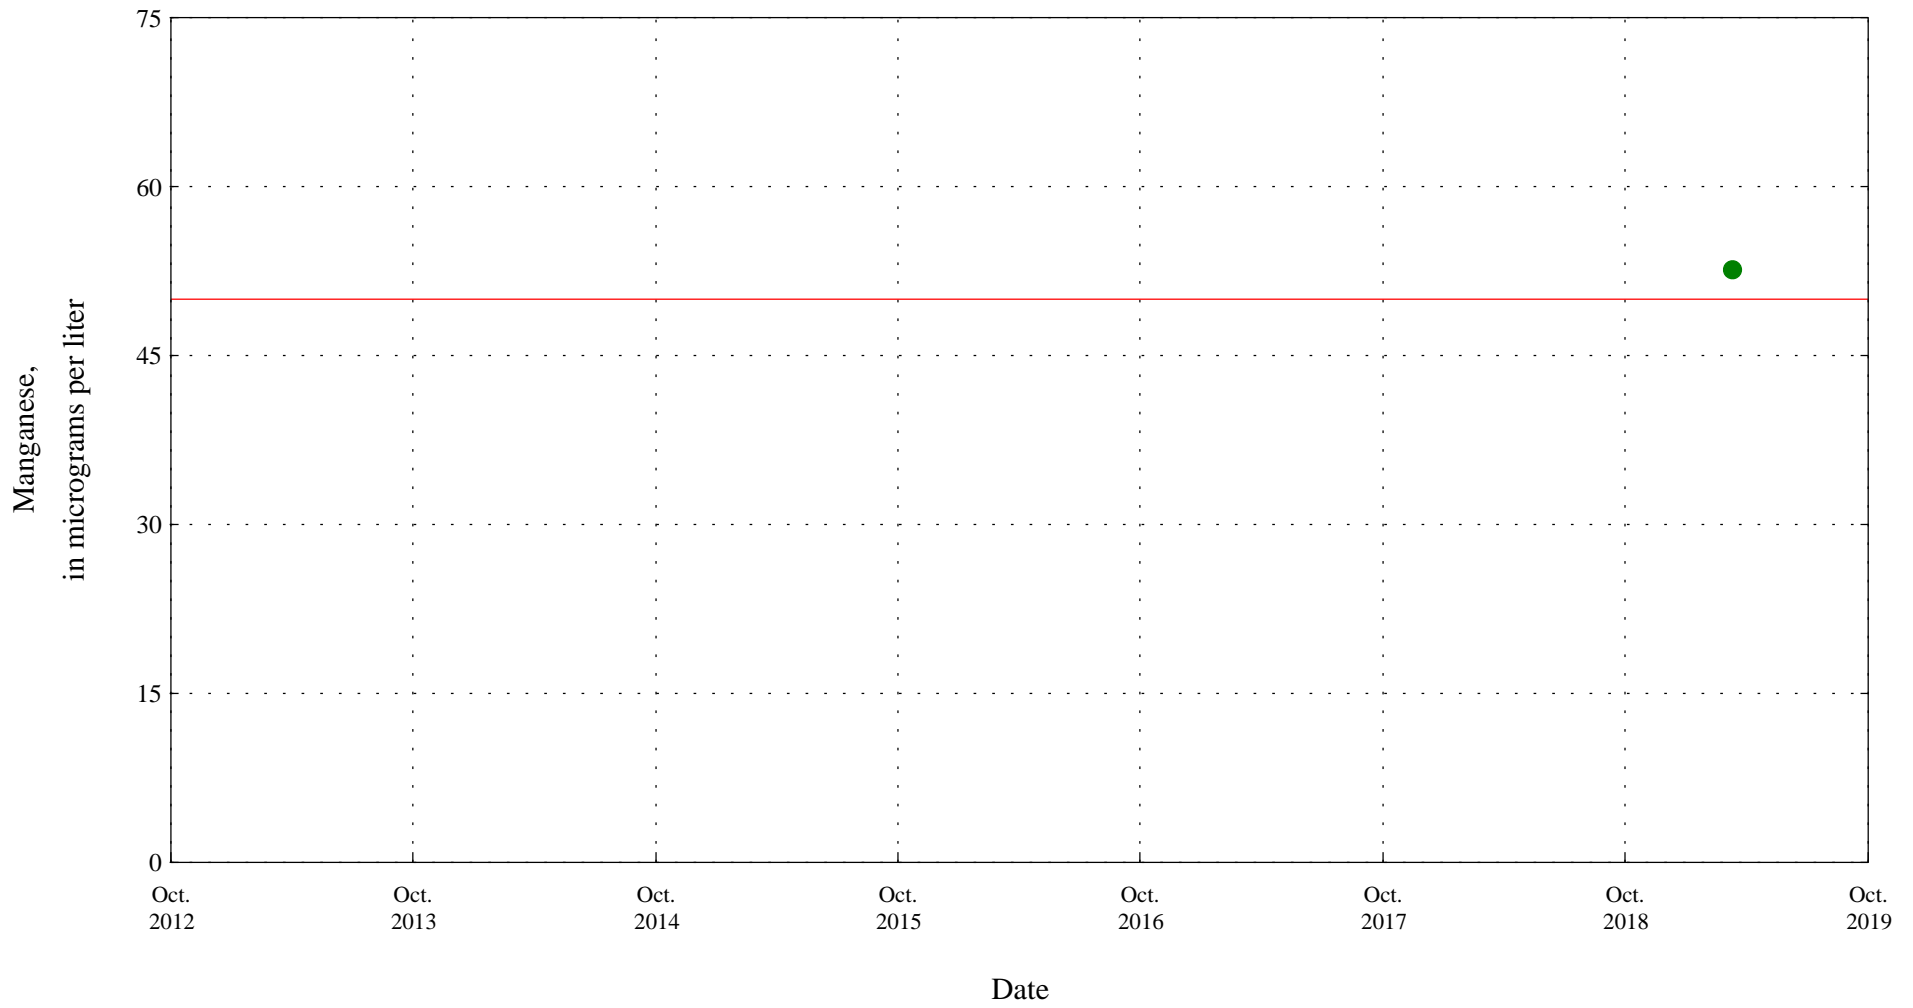Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

Human Health Based Water Supply Chronic Standard 50.0



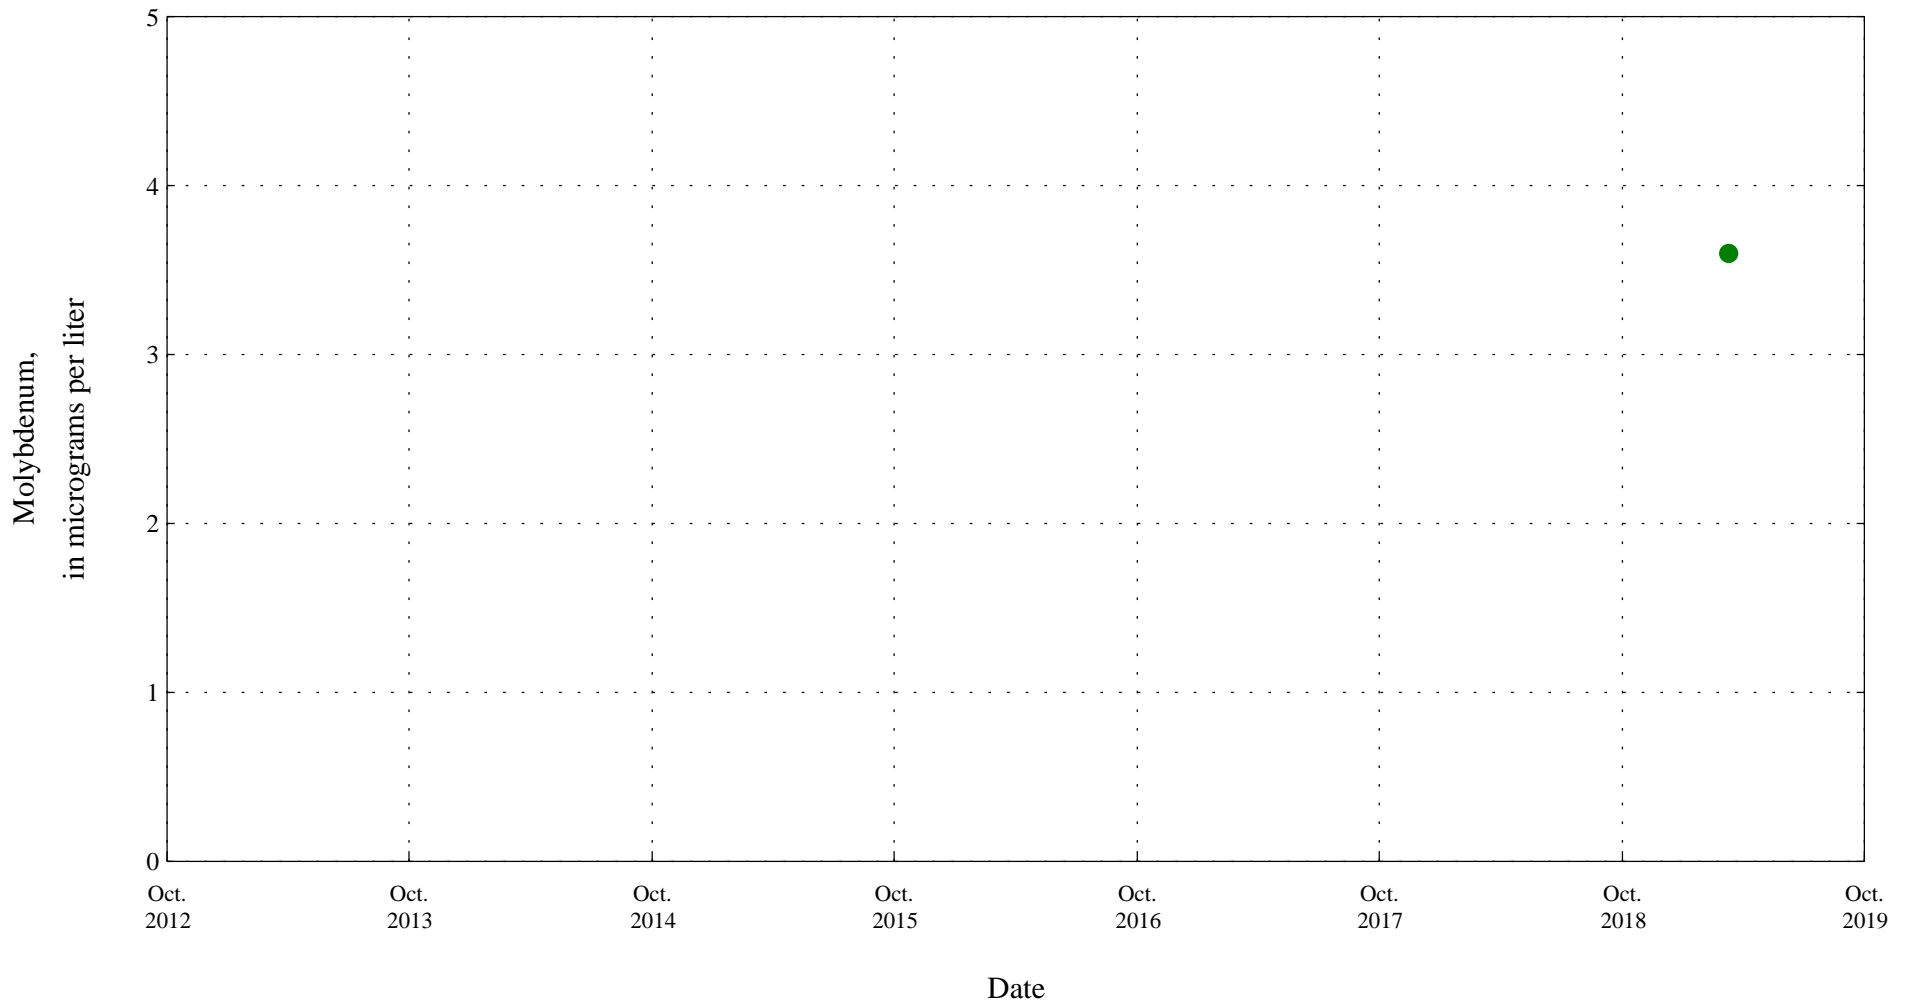
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data


Water Supply Chronic Standard 210

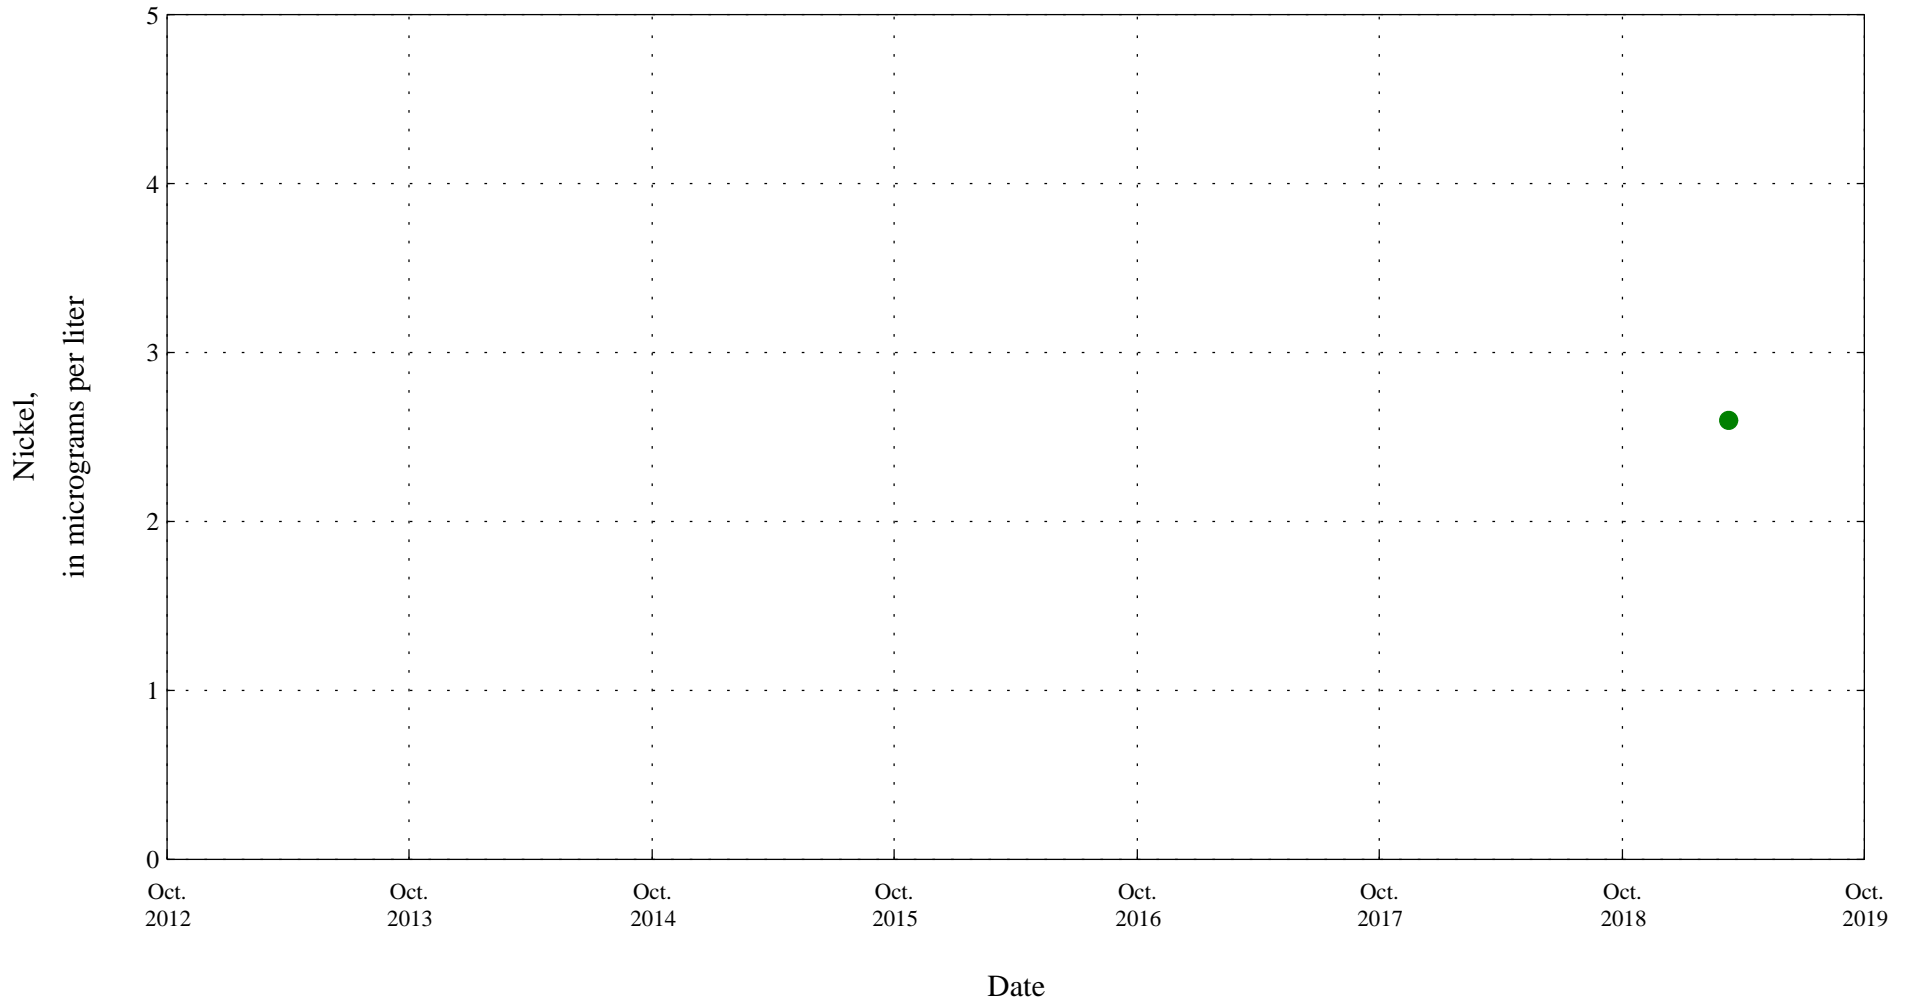Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

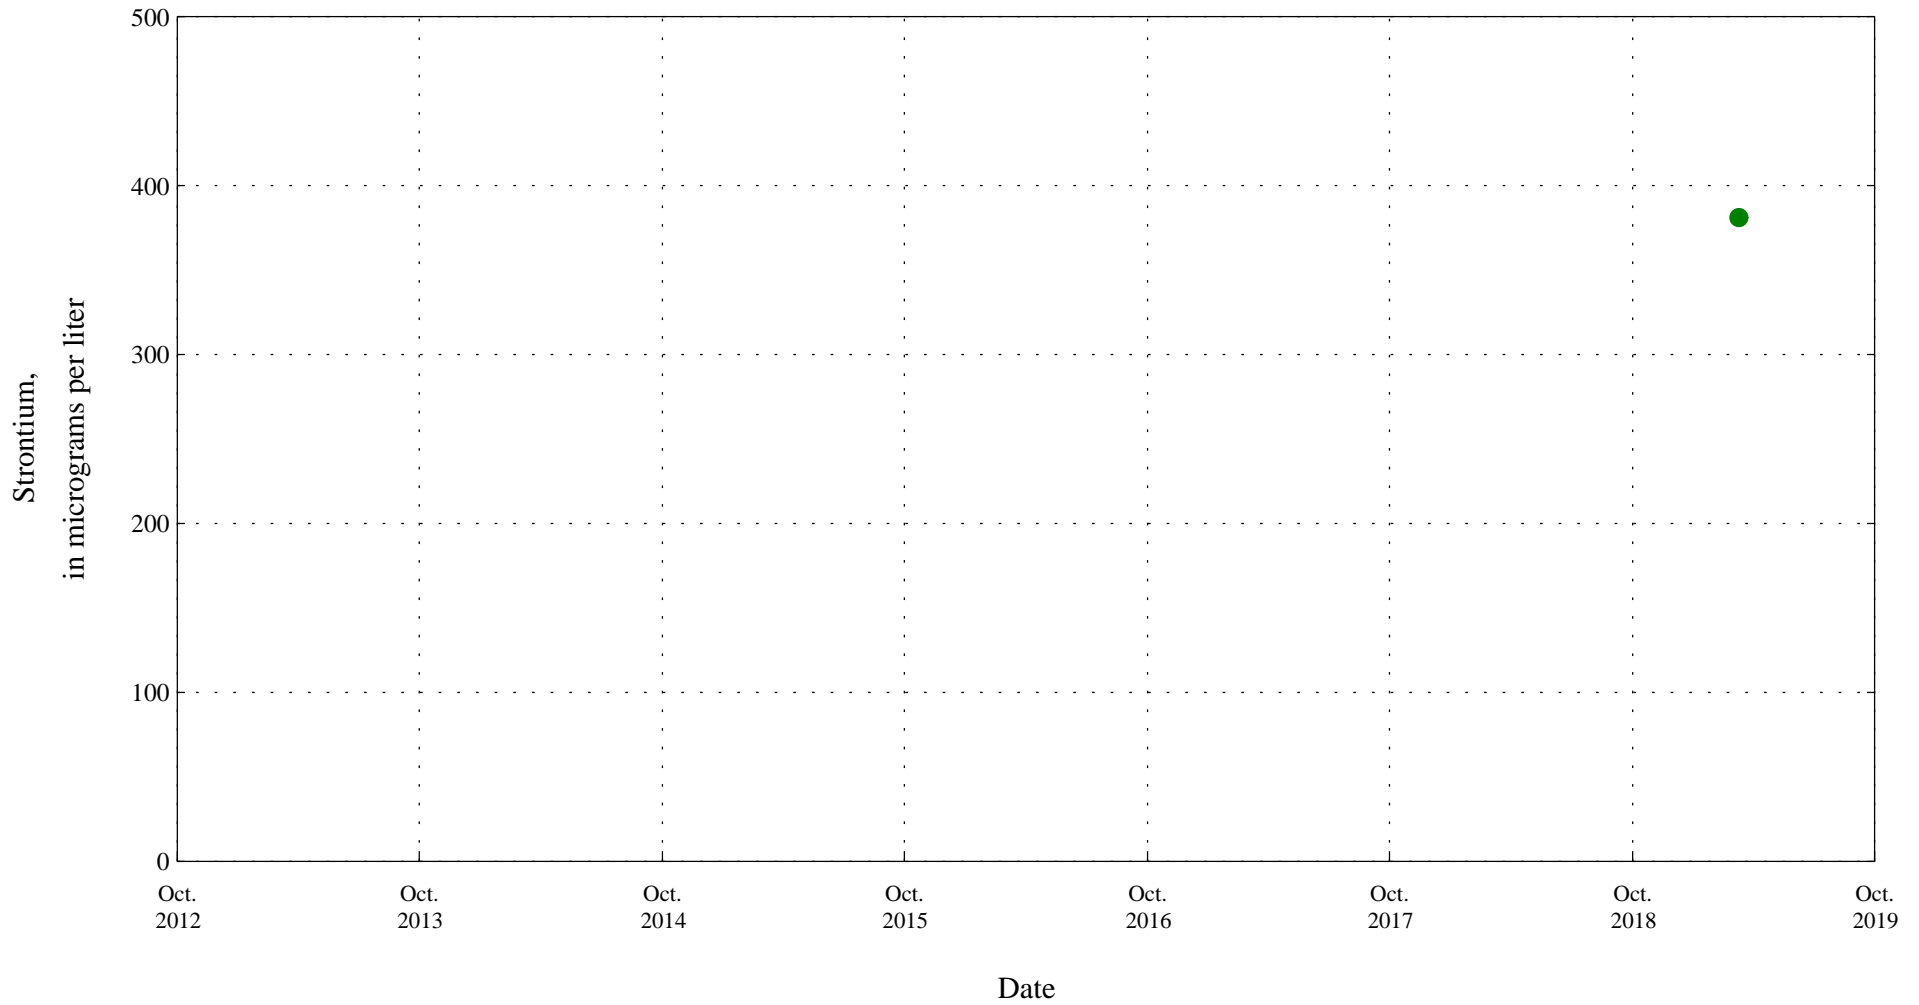Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

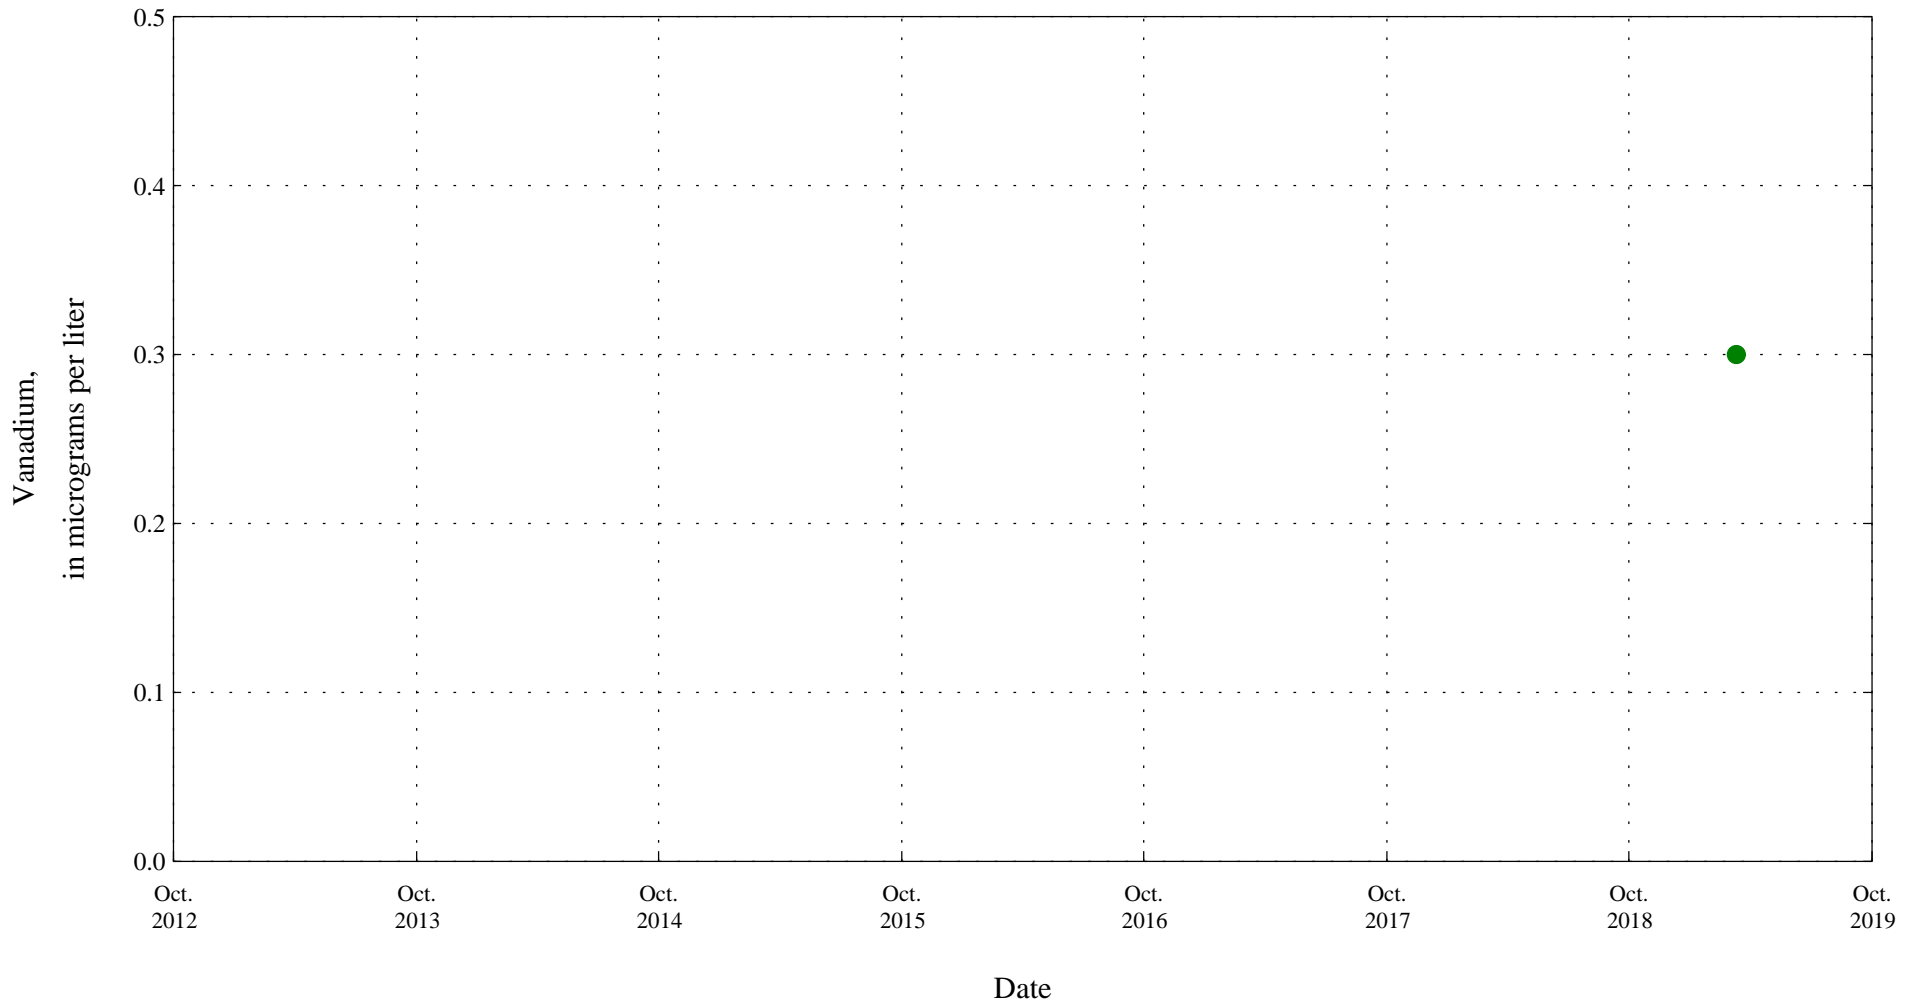Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

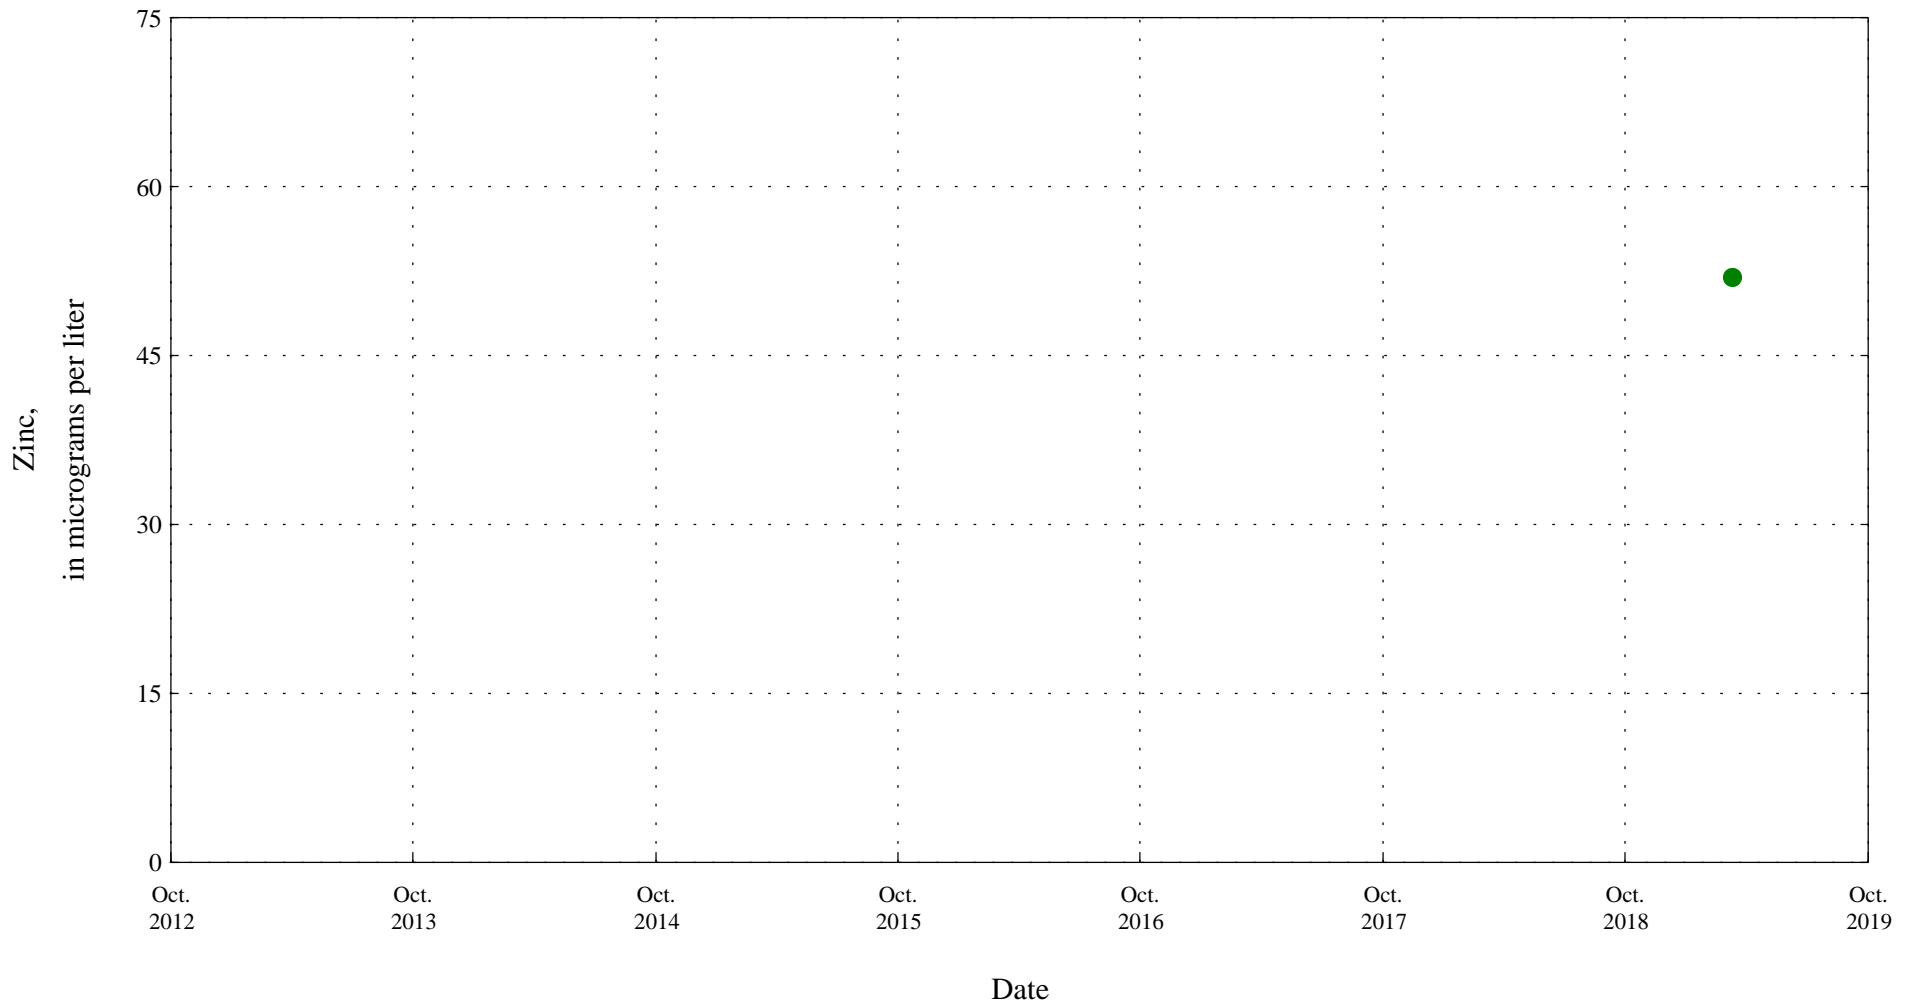Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

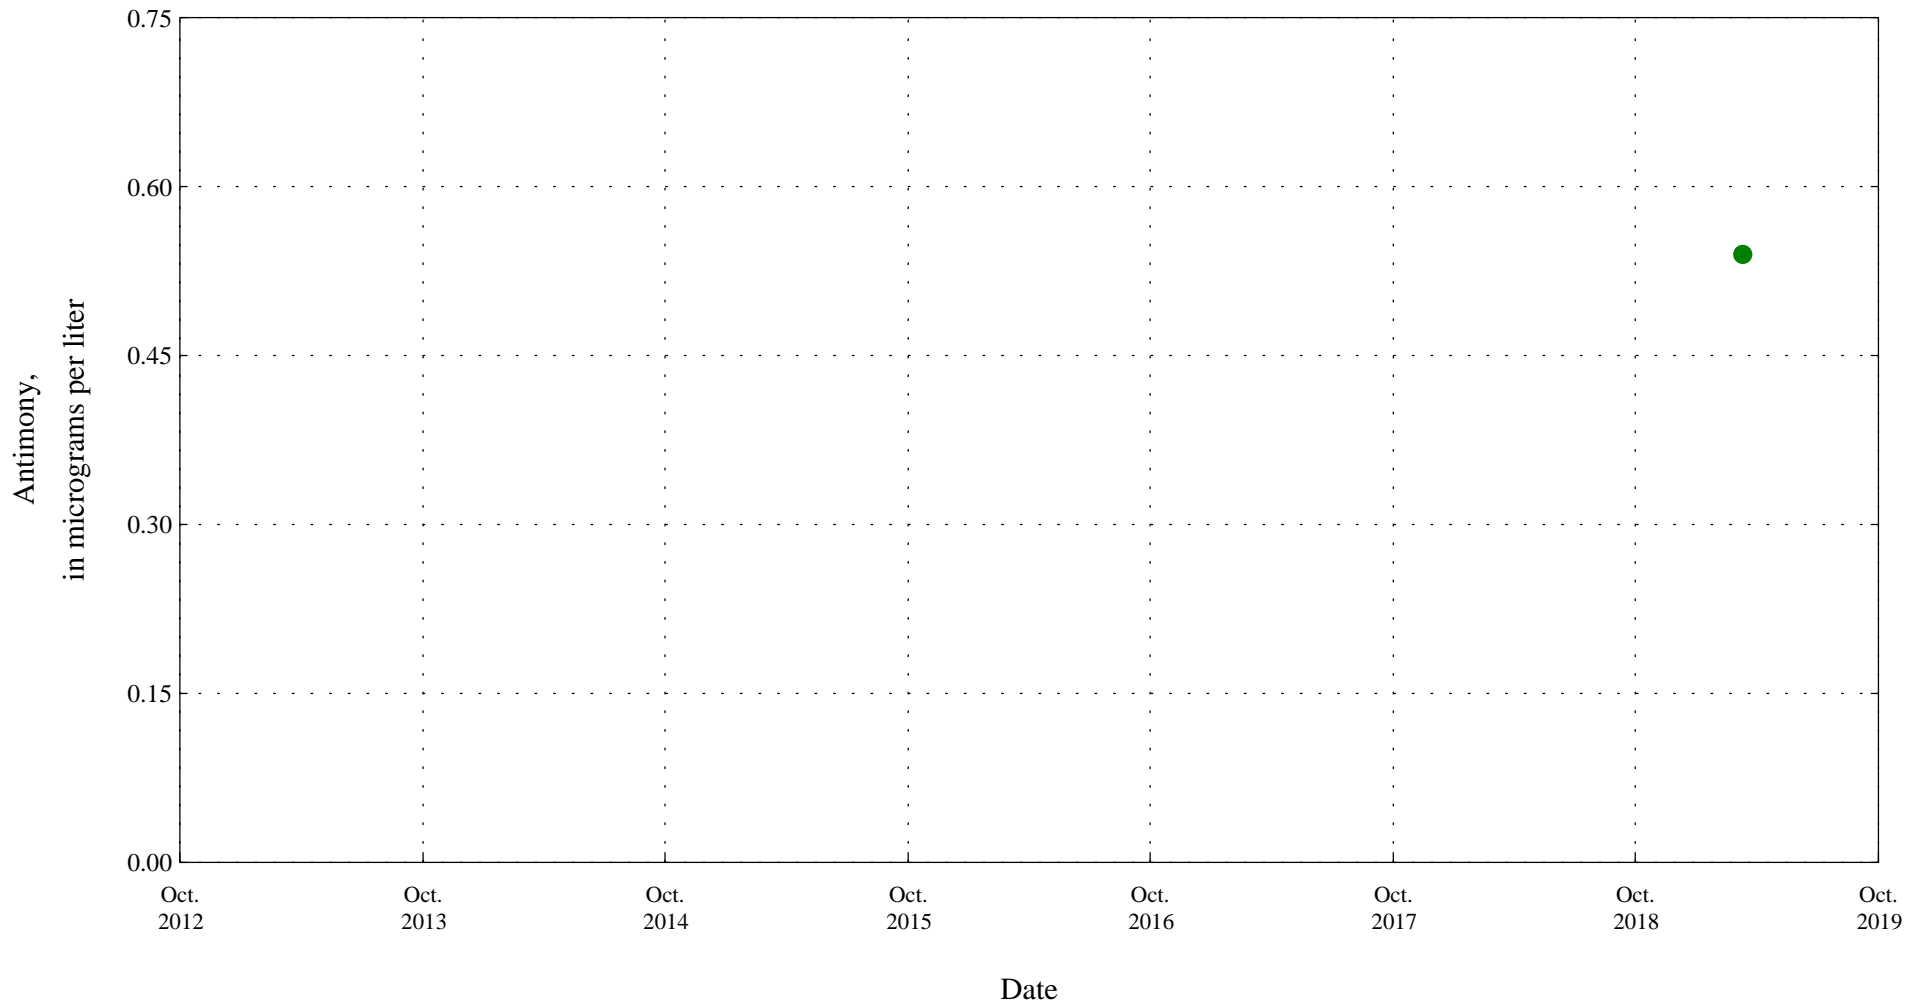
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Water and Fish Chronic Standard 5.6

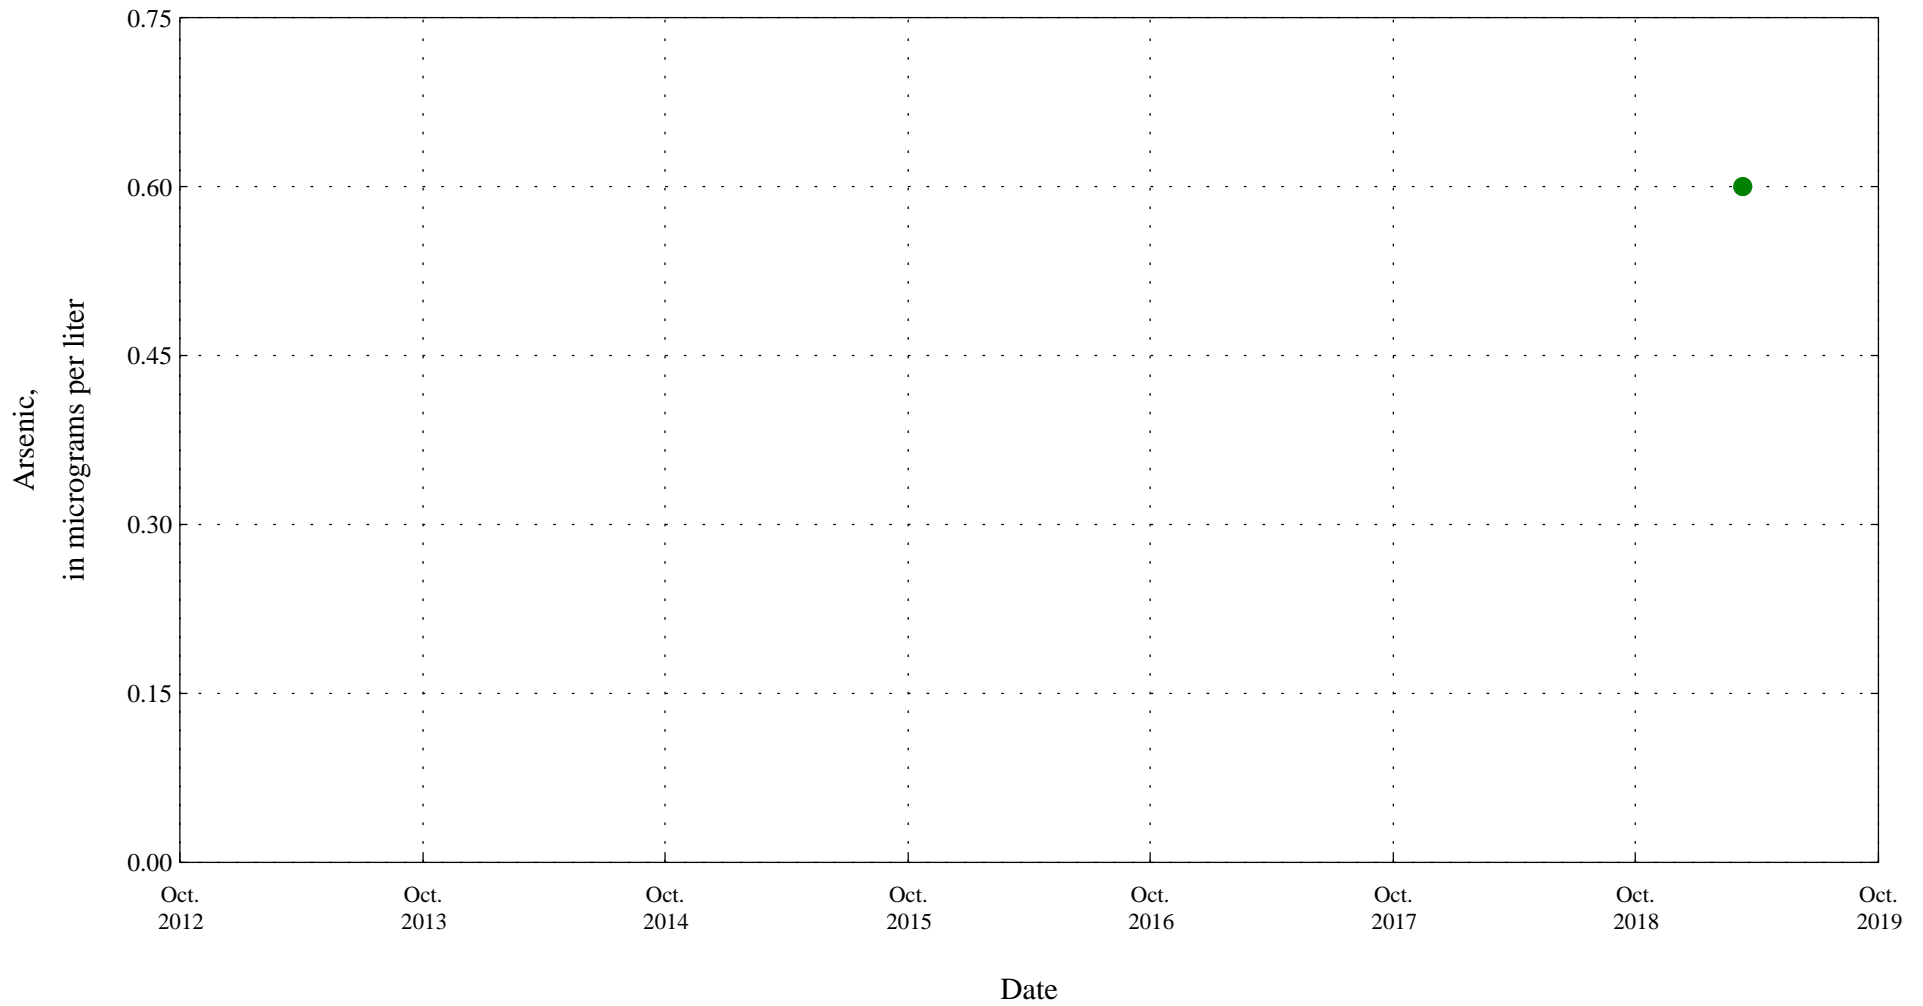
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Aquatic Life Acute Standard 340

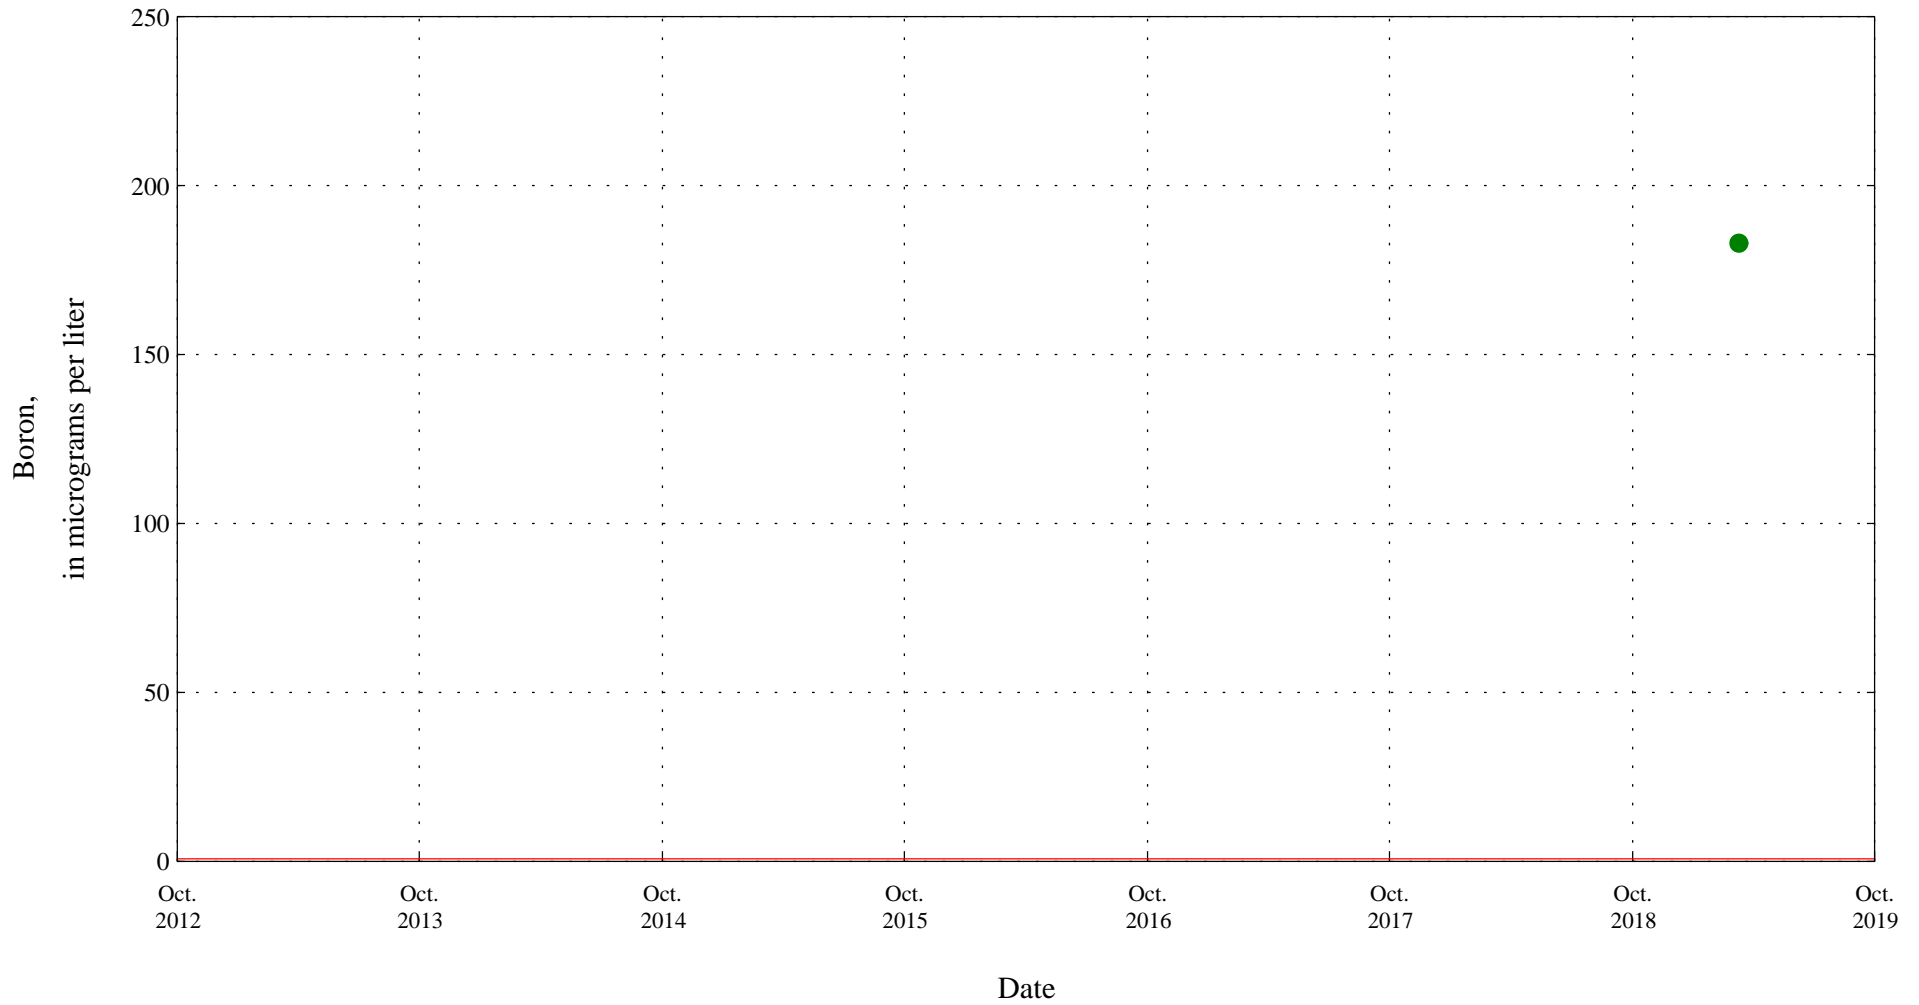Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.




● ● ● Current Data

Agriculture Chronic Standard 0.75



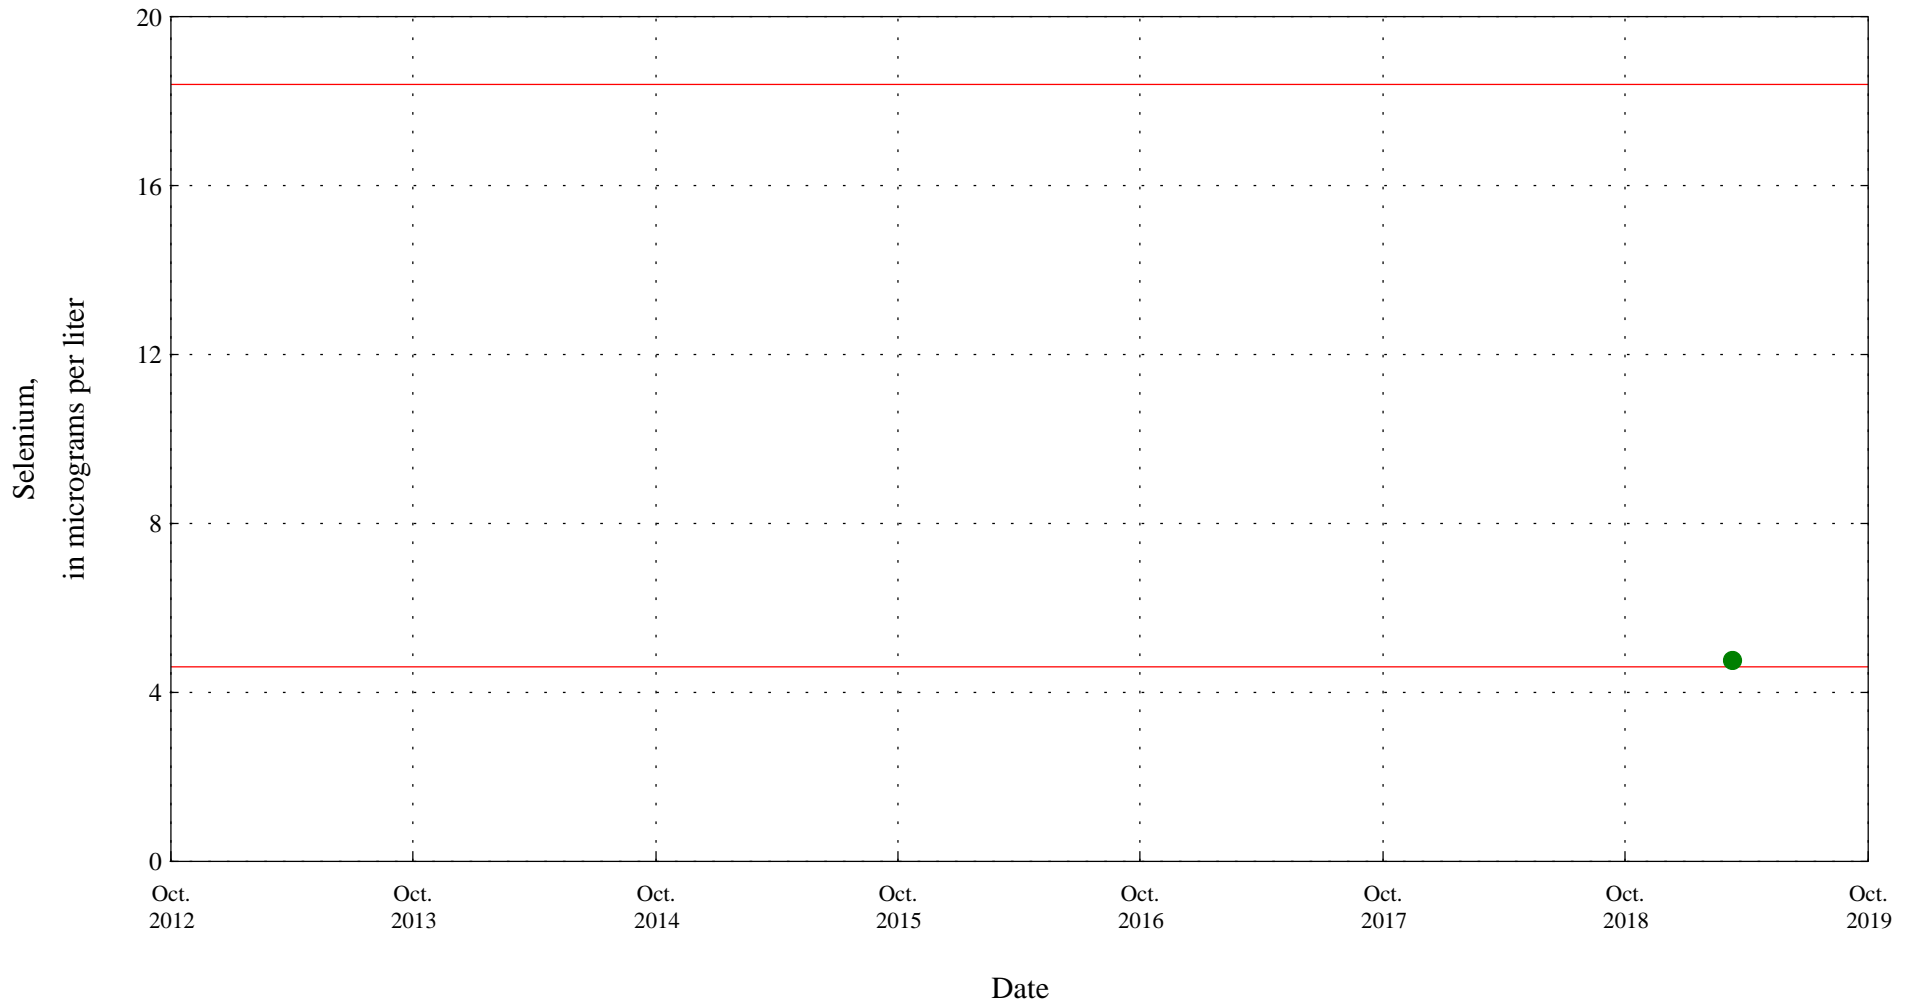
Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data


Aquatic Life Acute Standard 18.4  
Aquatic Life Chronic Standard 4.6

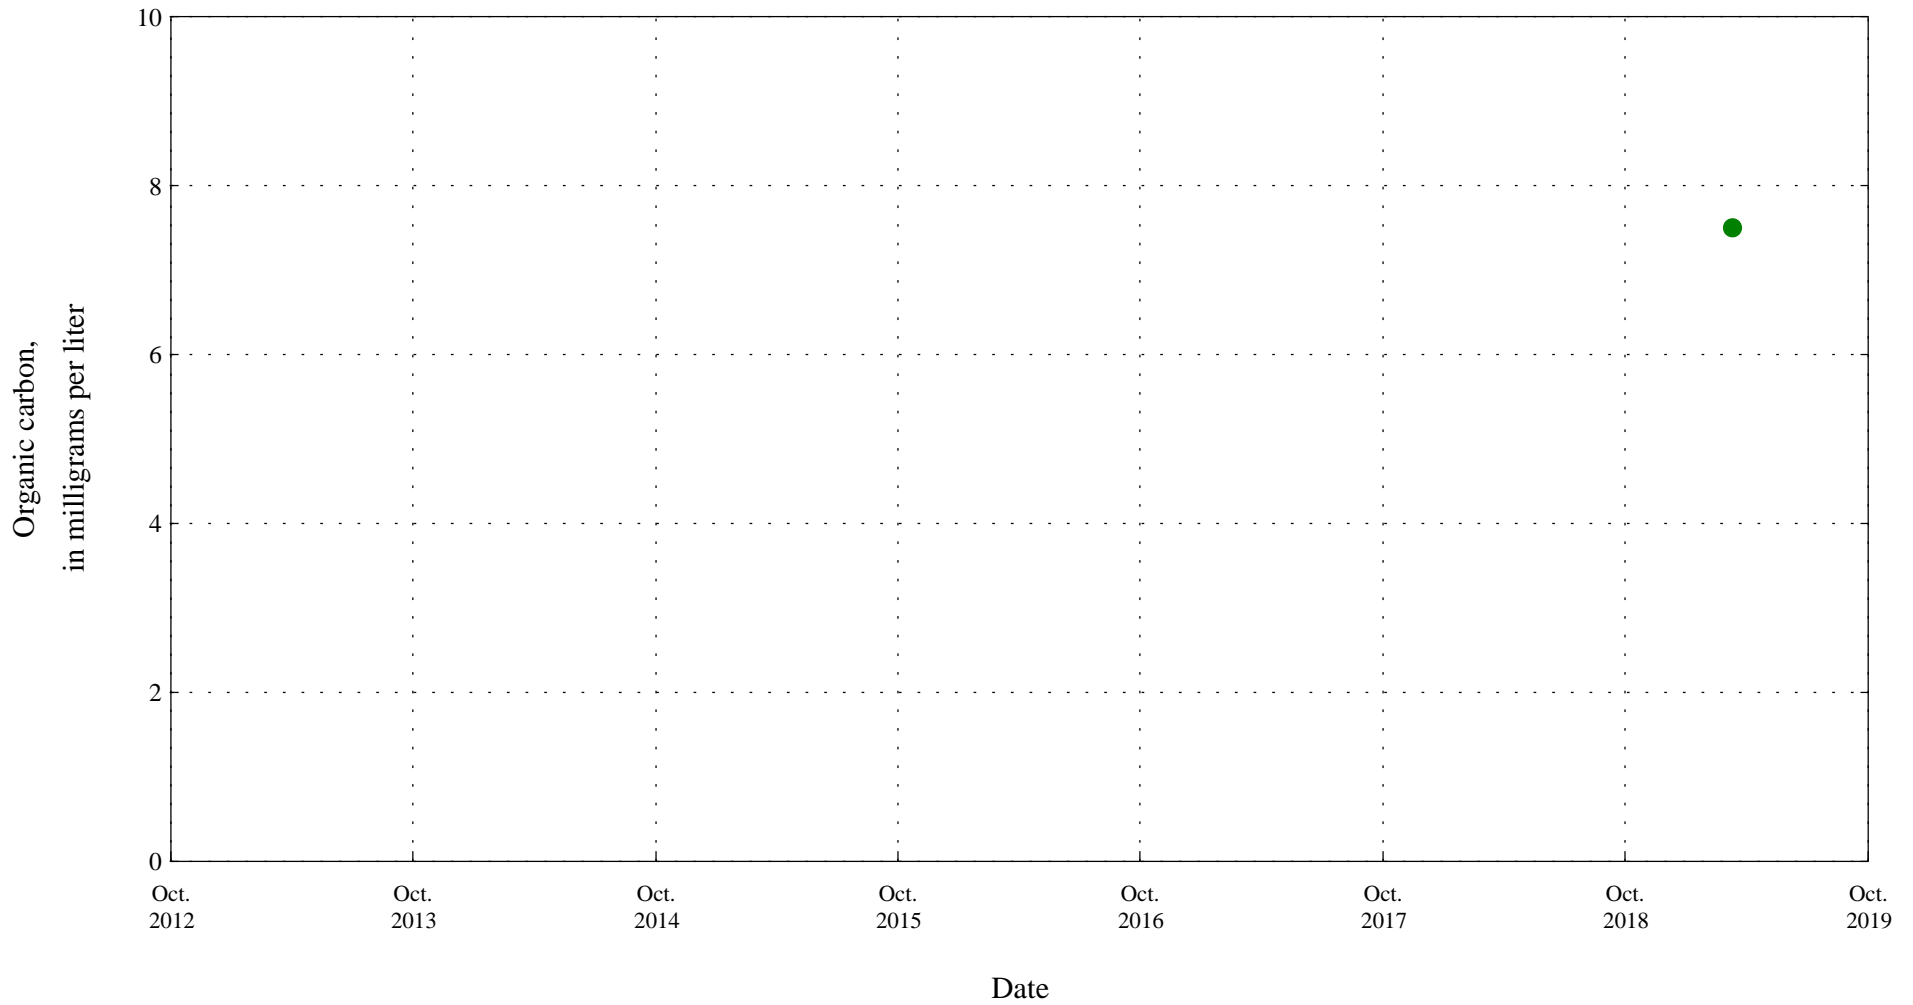Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

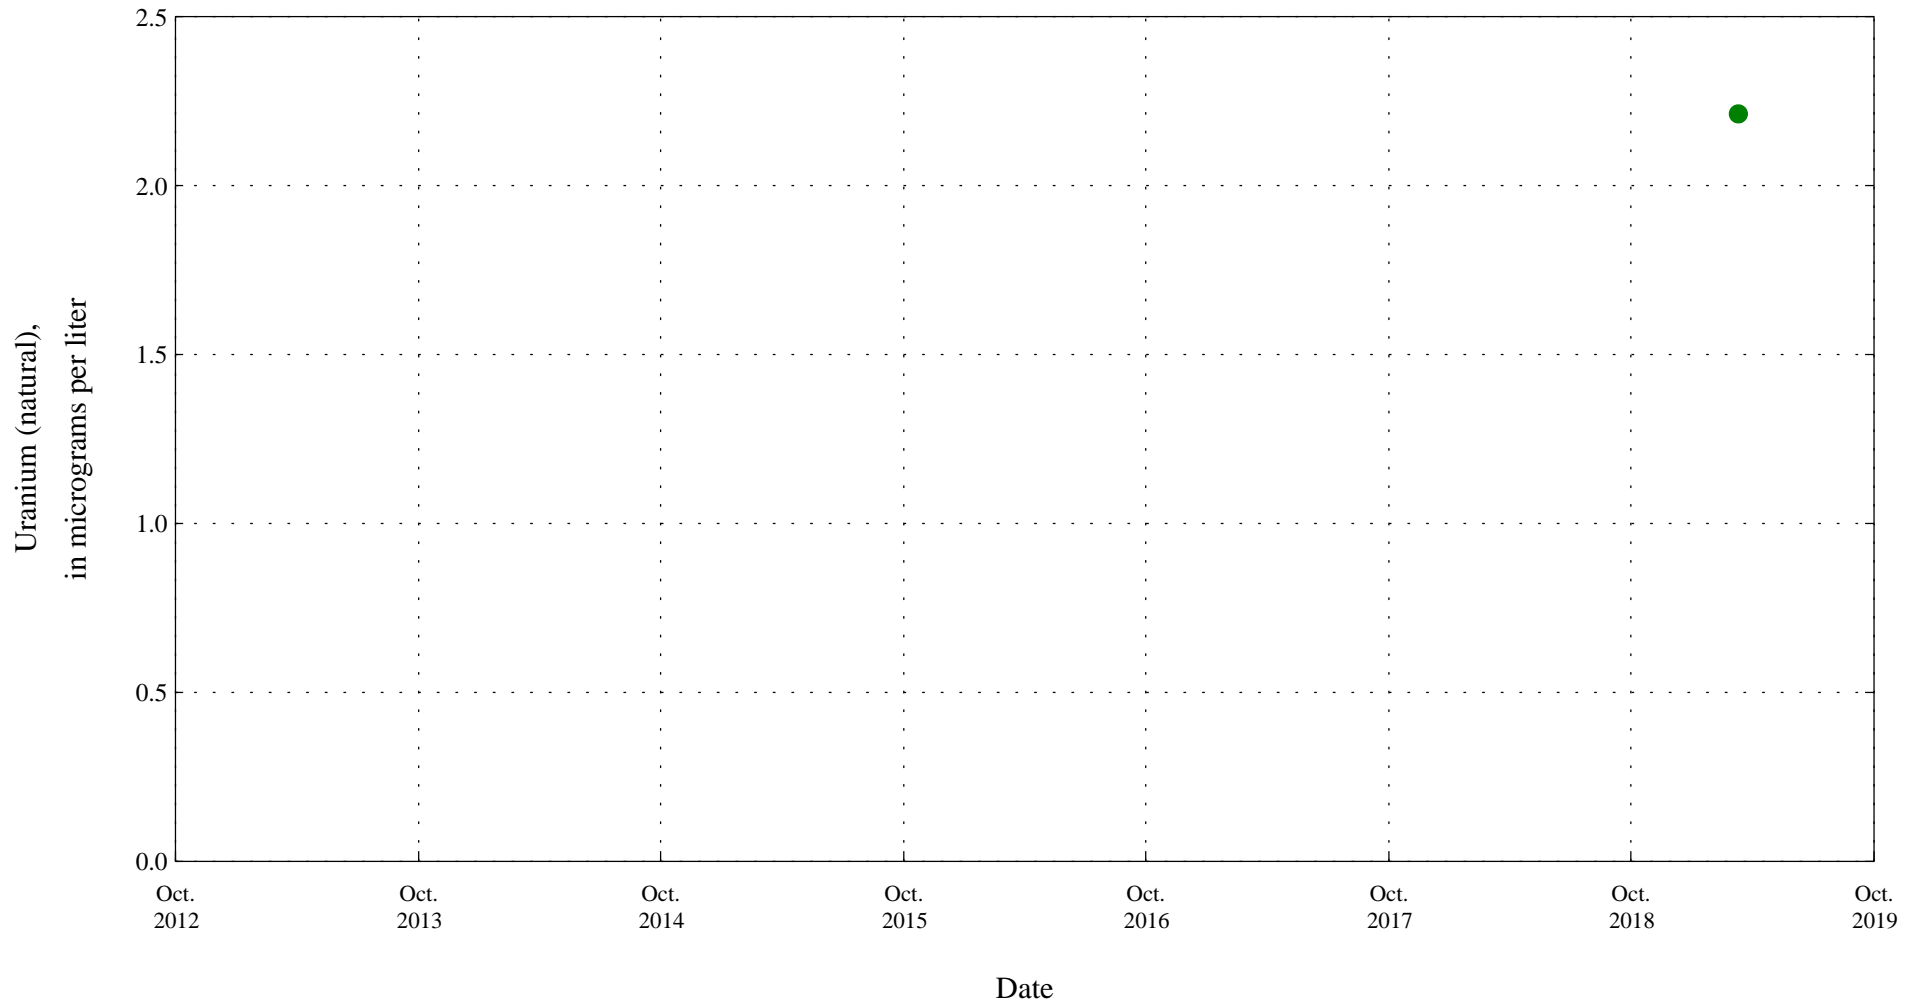Figure 48. Distribution of selected water-quality constituents relative to time for  
Spring Creek downstream of Las Vegas St at Colorado Springs, Co., station 384833104473900.



● ● ● Current Data

Basic Standard Chronic Standard 30.0