Figure 63. Distribution of selected water-quality constituents relative to time for

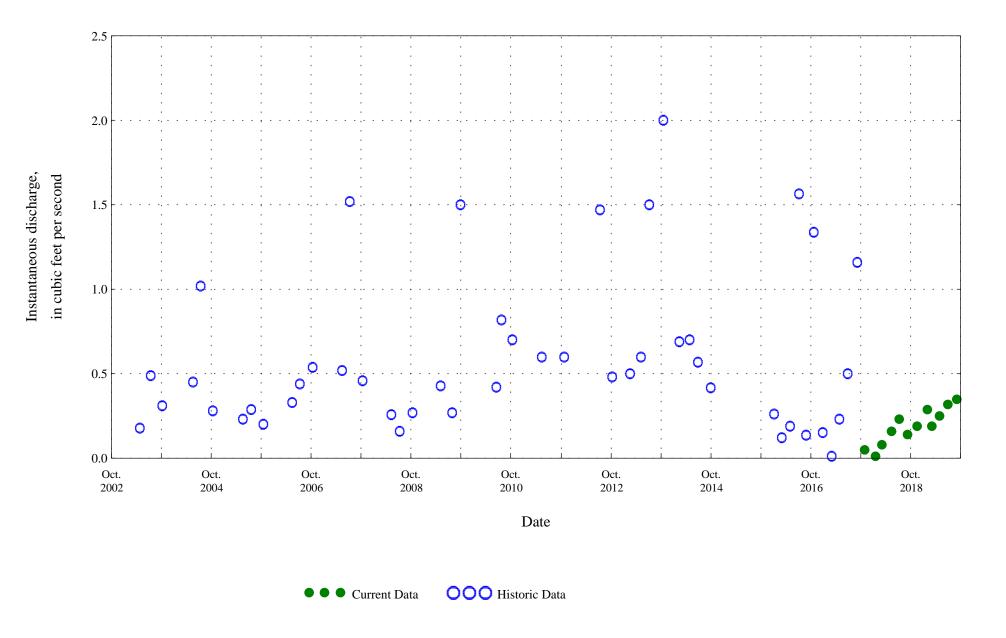




Figure 63. Distribution of selected water-quality constituents relative to time for



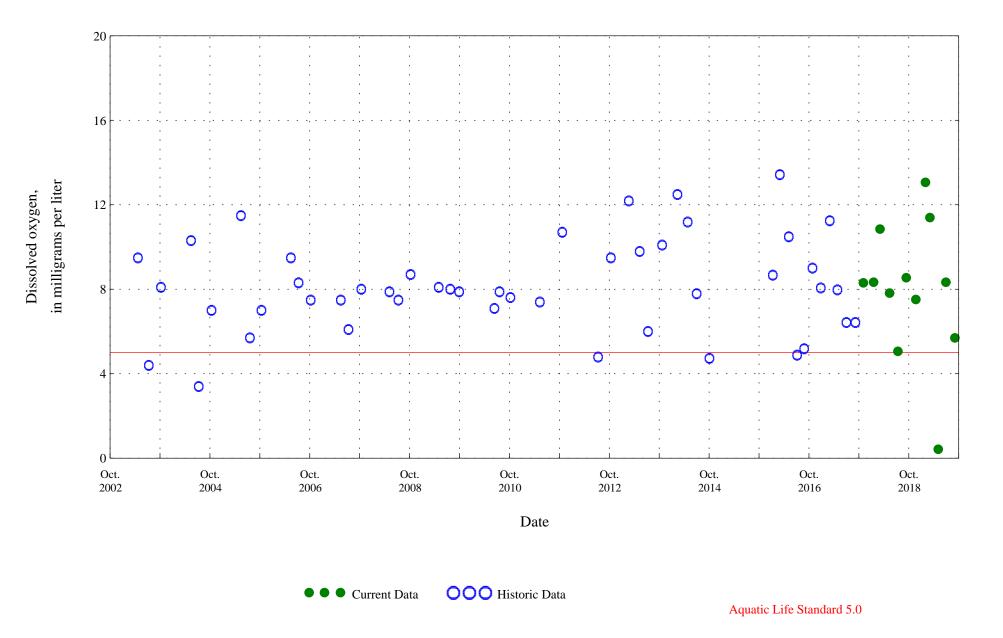




Figure 63. Distribution of selected water-quality constituents relative to time for



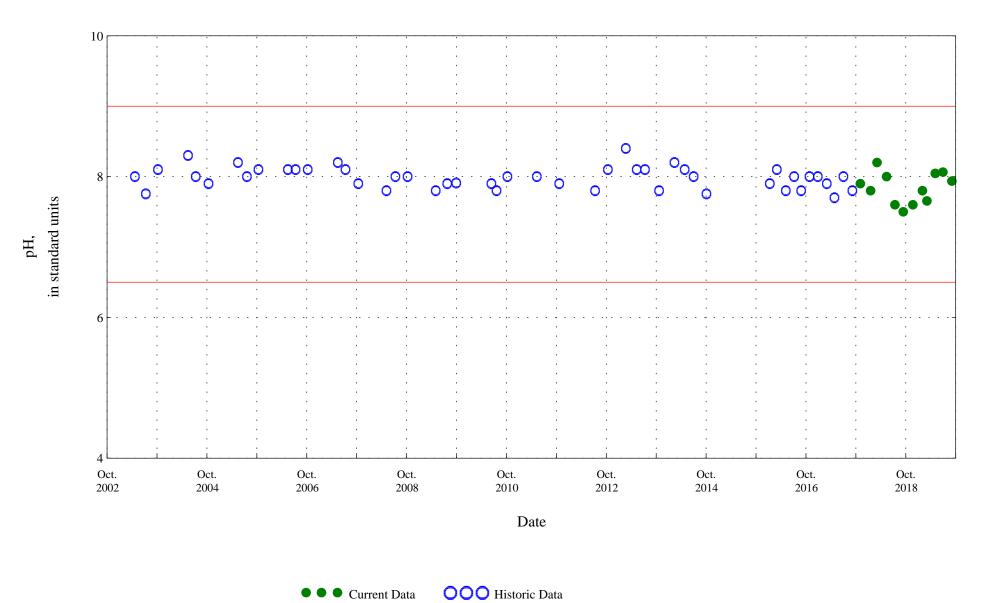

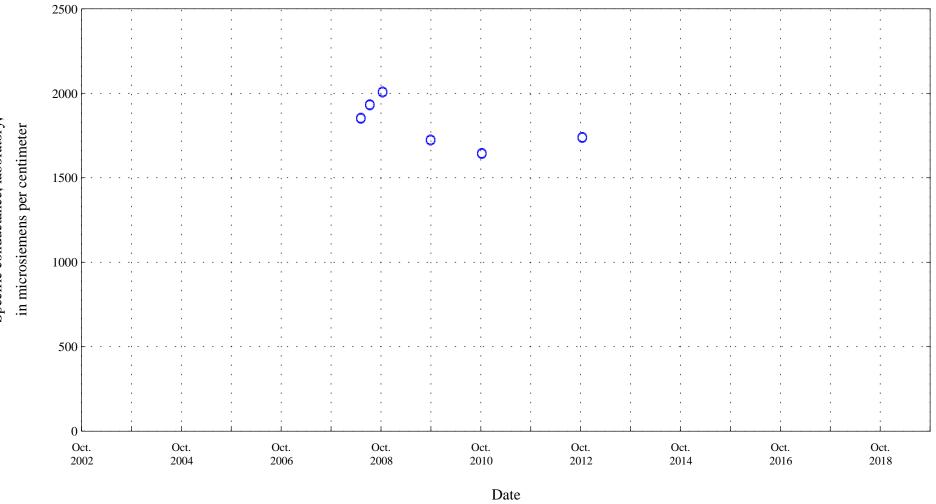





Specific conductance, laboratory,

Figure 63. Distribution of selected water-quality constituents relative to time for


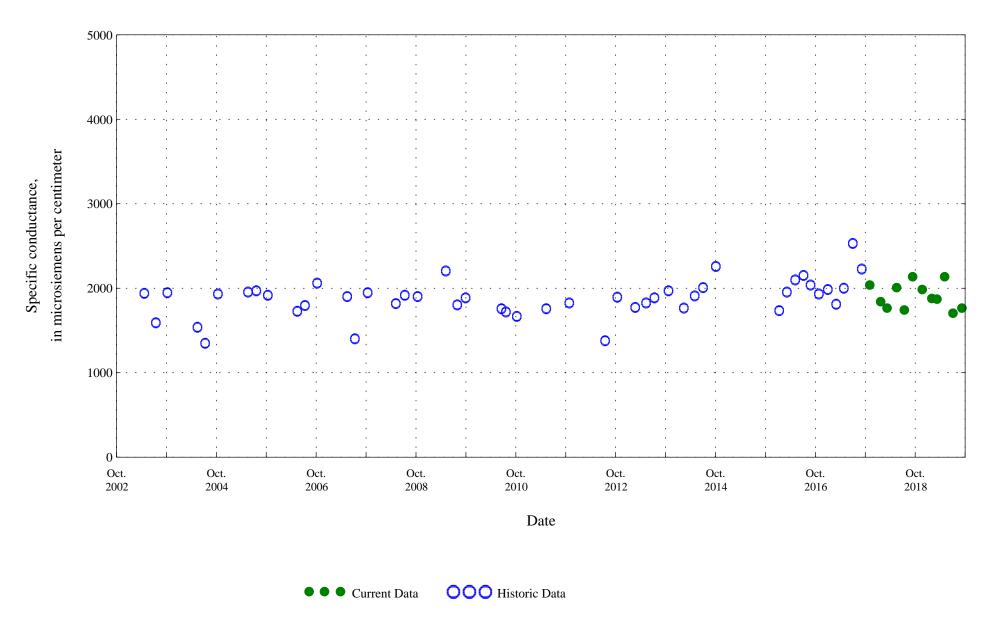




Figure 63. Distribution of selected water-quality constituents relative to time for

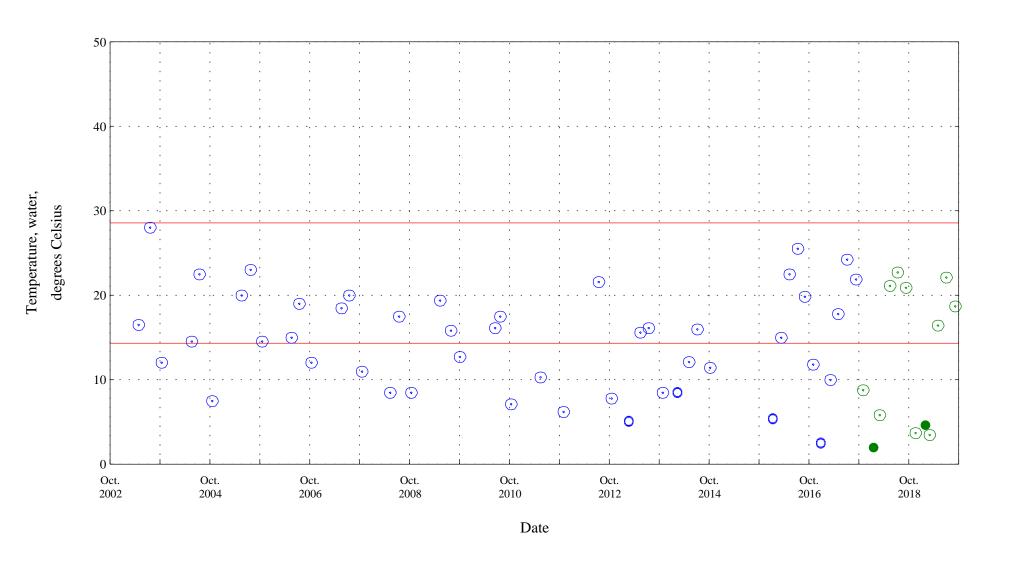

⊙ ⊙ ⊙ Current Data, Warm Season Std

⊙ ⊙ ⊙ Historic Data, Warm Season Std

Aquatic Life Dec - Feb, Cool Season Std 14.3 Aquatic Life Mar - Nov, Warm Season Std 28.6

Current Data, Cool Season Std

OOO Historic Data, Cool Season Std



Figure 63. Distribution of selected water-quality constituents relative to time for

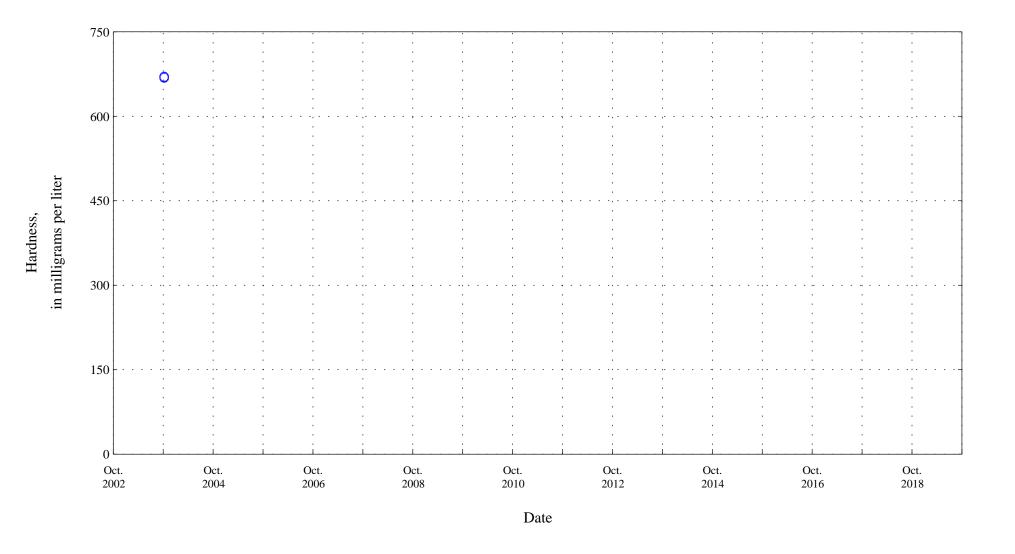






Figure 63. Distribution of selected water-quality constituents relative to time for

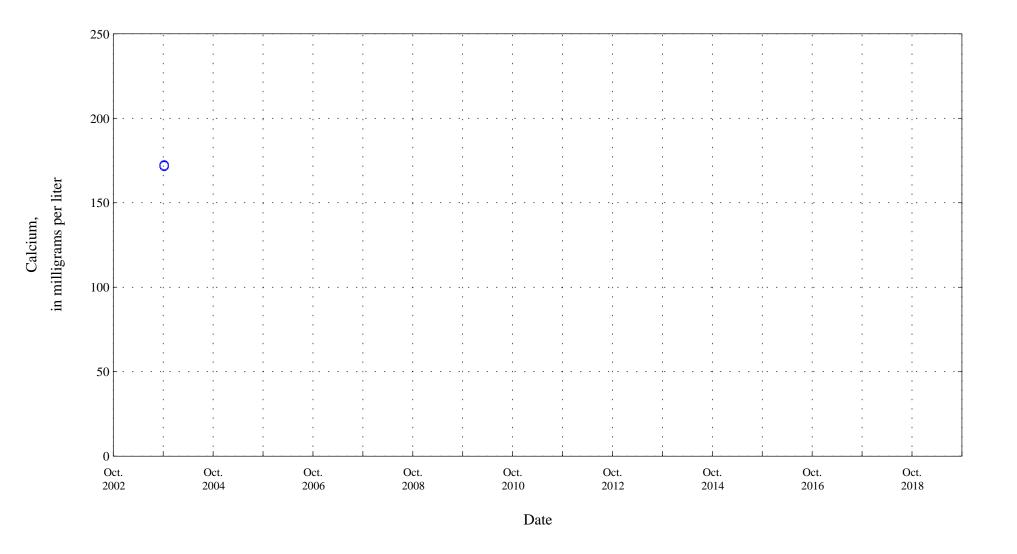






Figure 63. Distribution of selected water-quality constituents relative to time for

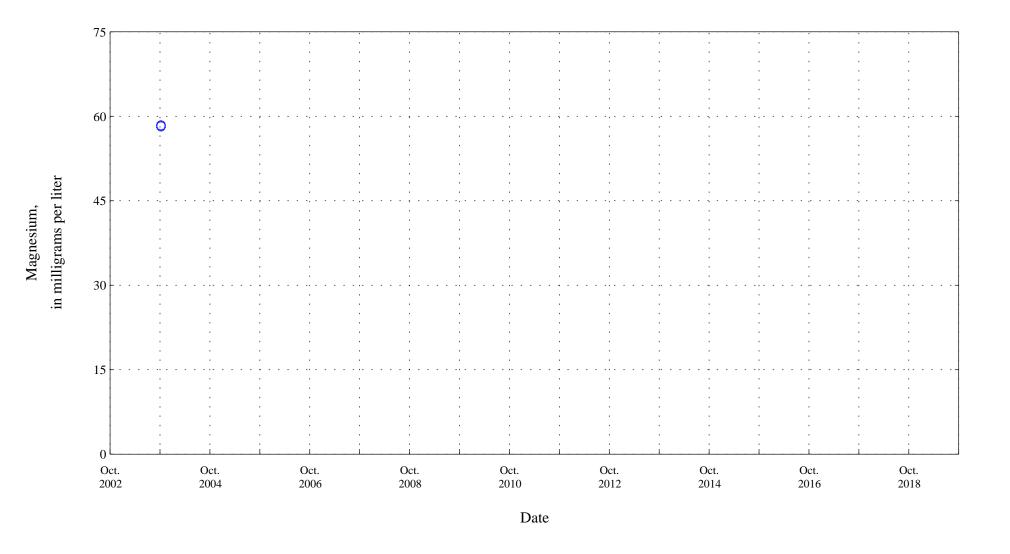






Figure 63. Distribution of selected water-quality constituents relative to time for

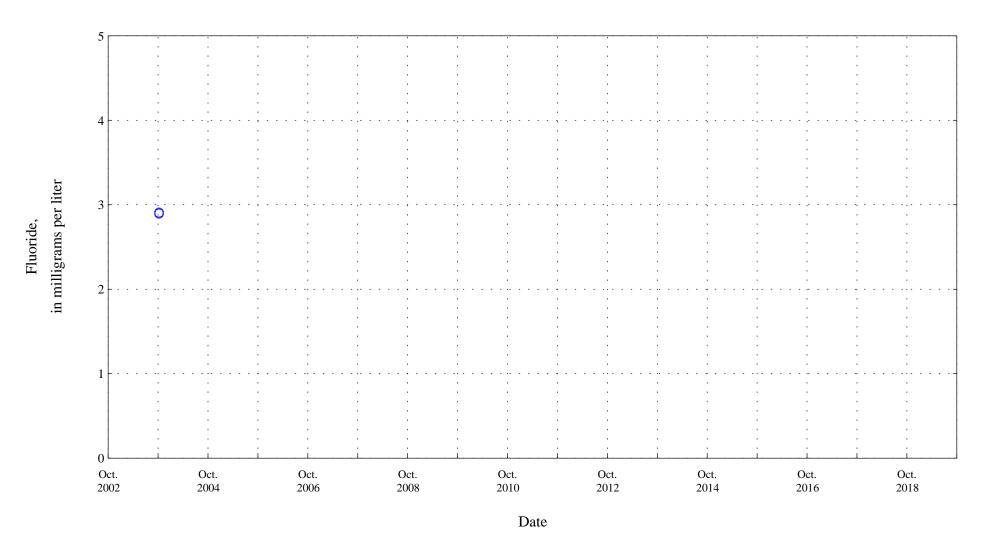






Figure 63. Distribution of selected water-quality constituents relative to time for


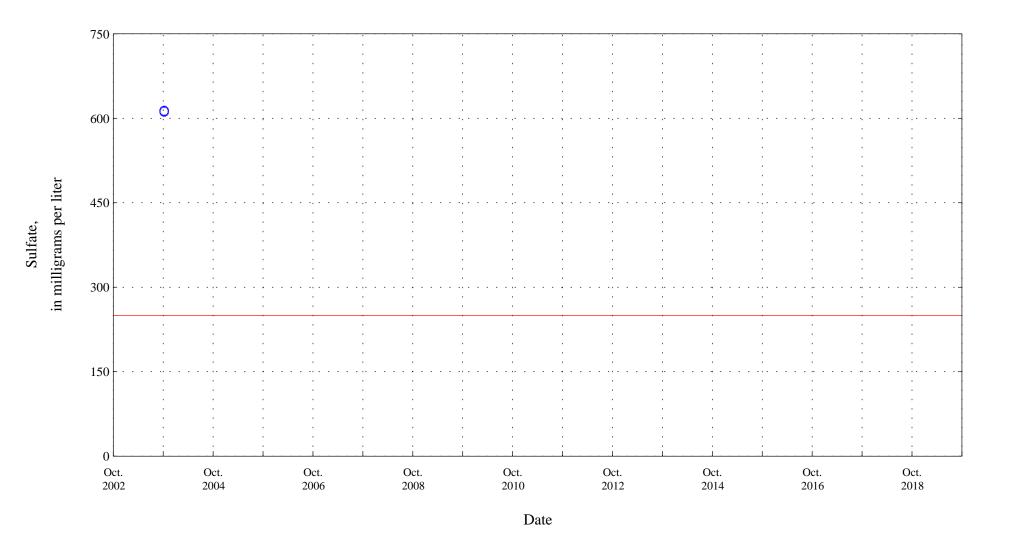






Figure 63. Distribution of selected water-quality constituents relative to time for

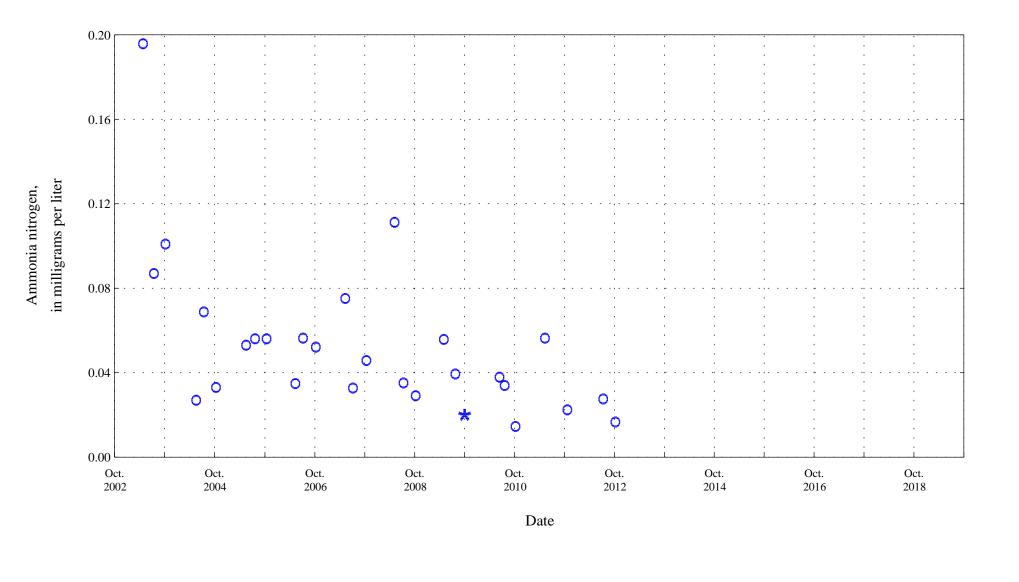


OOO Historic Data

Aquatic Life Acute Standard 5.9 Aquatic Life Chronic Standard 2.1

* * * Historic Censored Data




Figure 63. Distribution of selected water-quality constituents relative to time for

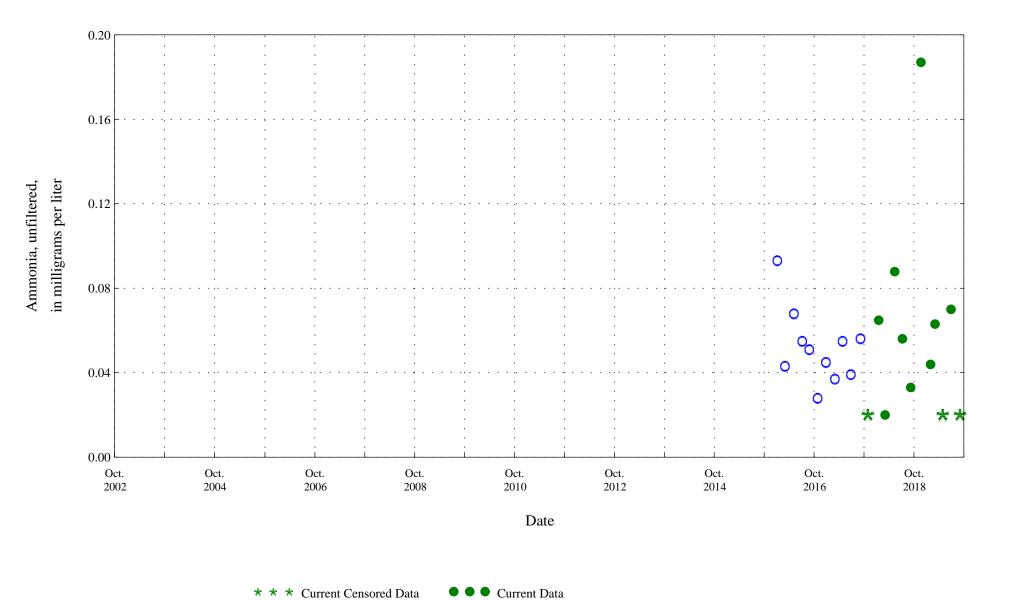




OOO Historic Data

Figure 63. Distribution of selected water-quality constituents relative to time for

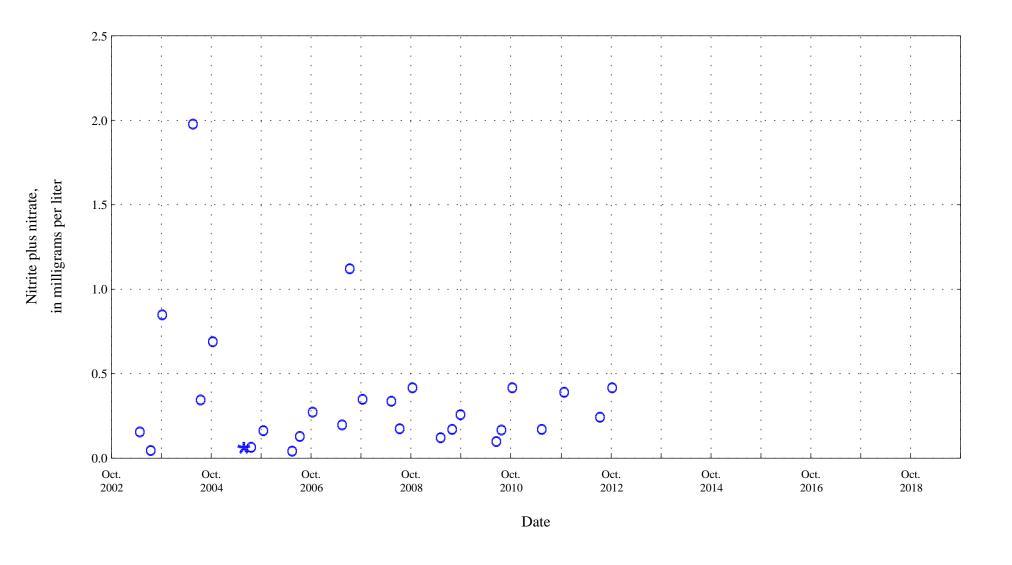





Human Health Based Water Supply Acute Standard 10.0



Figure 63. Distribution of selected water-quality constituents relative to time for

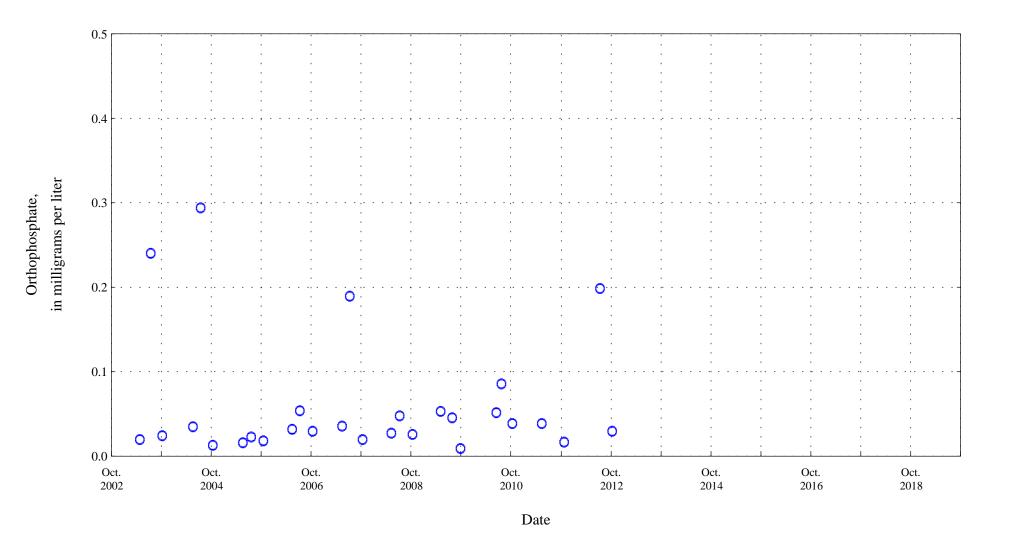
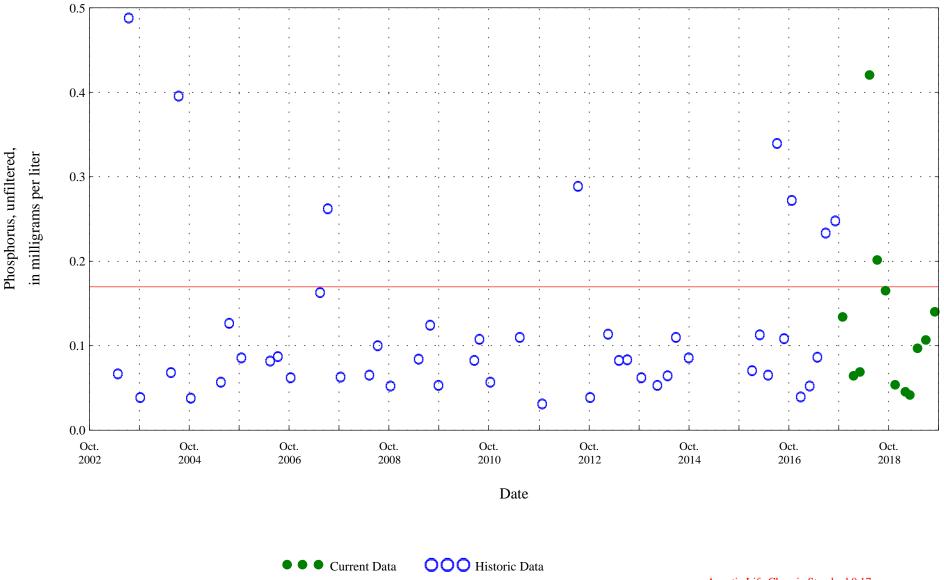






Figure 63. Distribution of selected water-quality constituents relative to time for





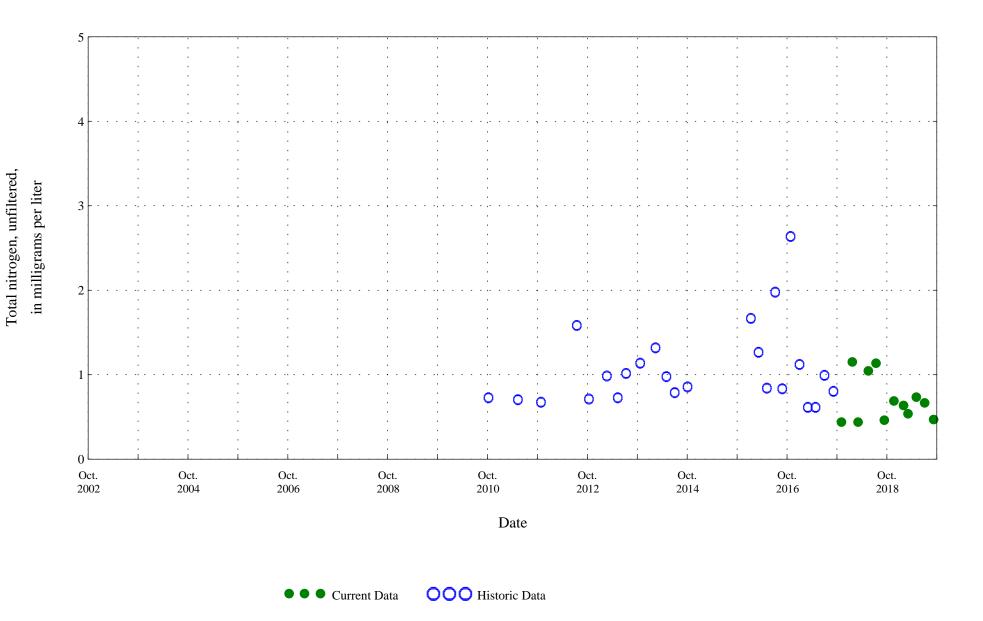




Figure 63. Distribution of selected water-quality constituents relative to time for

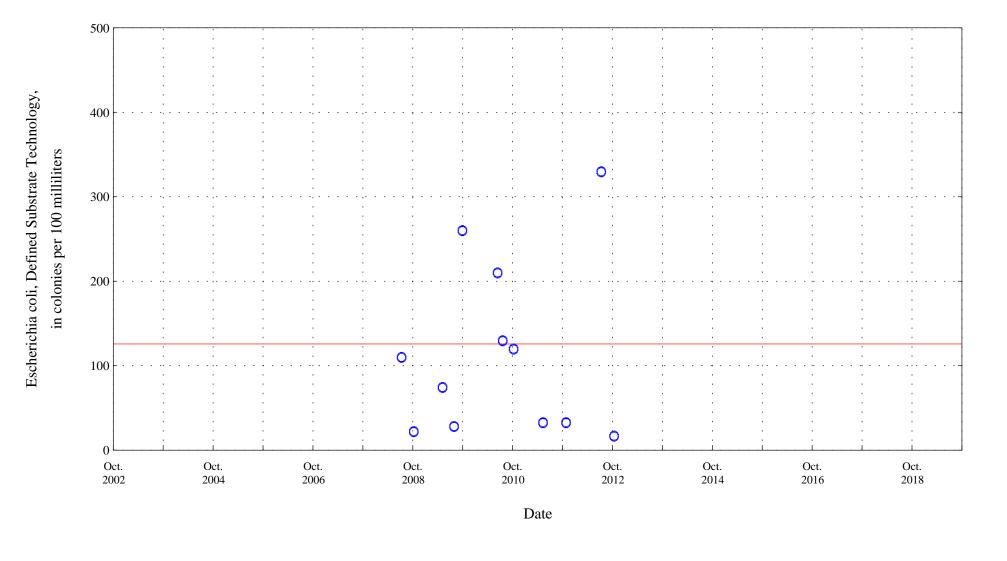








Figure 63. Distribution of selected water-quality constituents relative to time for

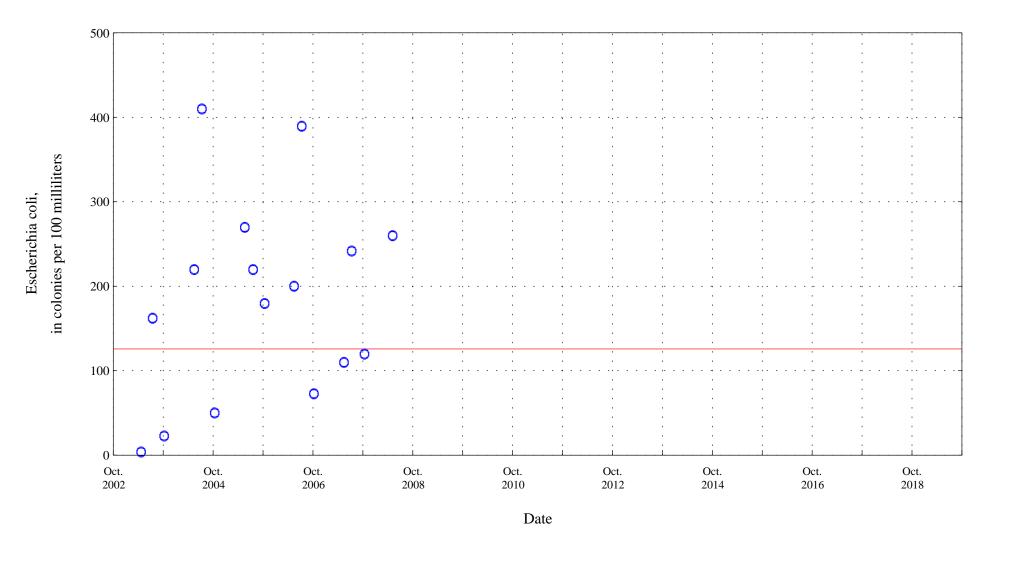








Figure 63. Distribution of selected water-quality constituents relative to time for

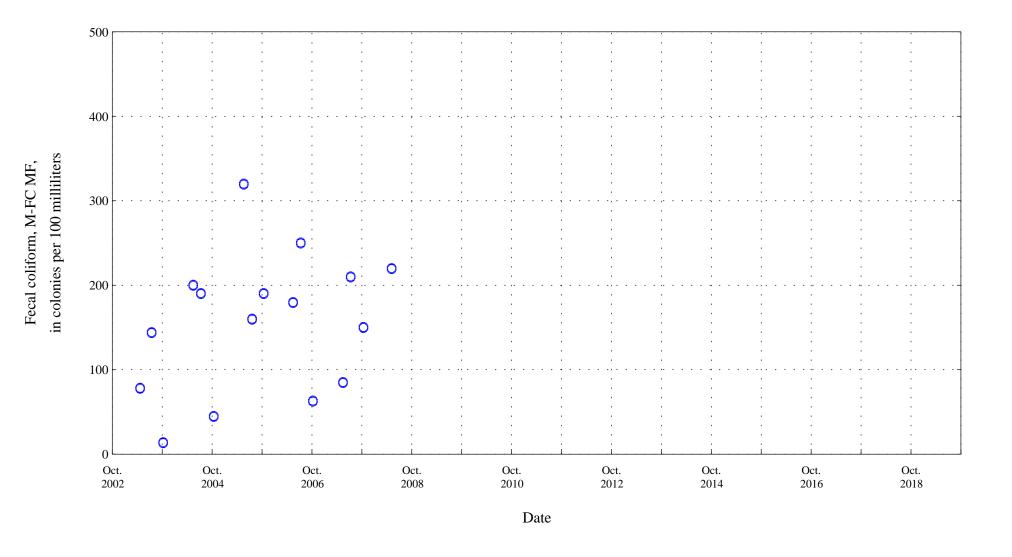






Figure 63. Distribution of selected water-quality constituents relative to time for

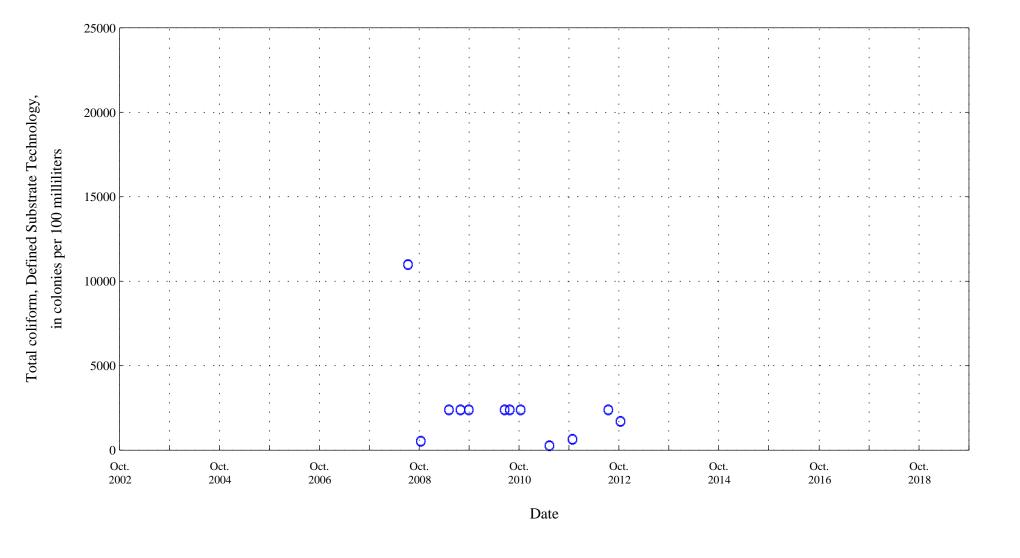






Figure 63. Distribution of selected water-quality constituents relative to time for

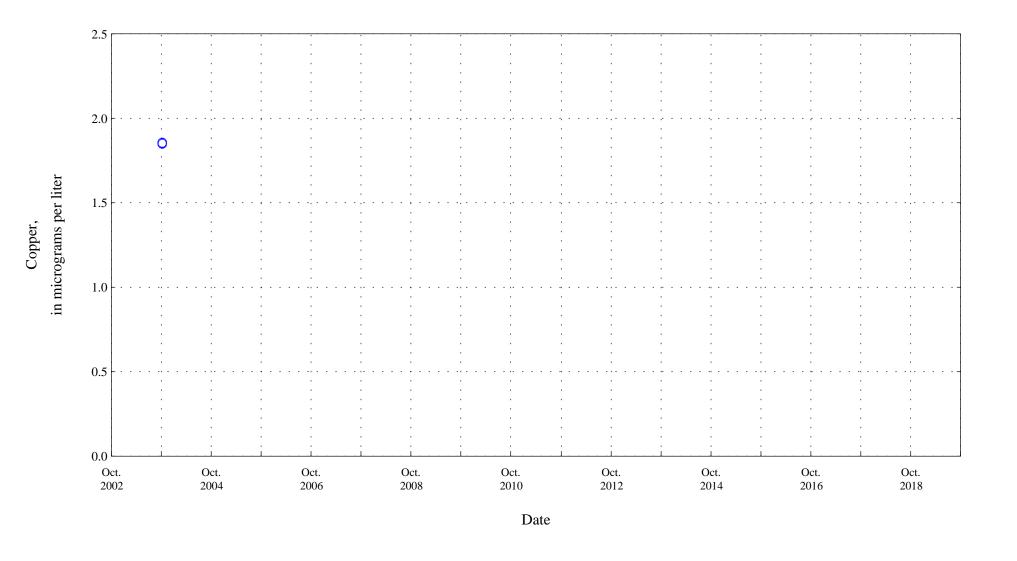








Figure 63. Distribution of selected water-quality constituents relative to time for


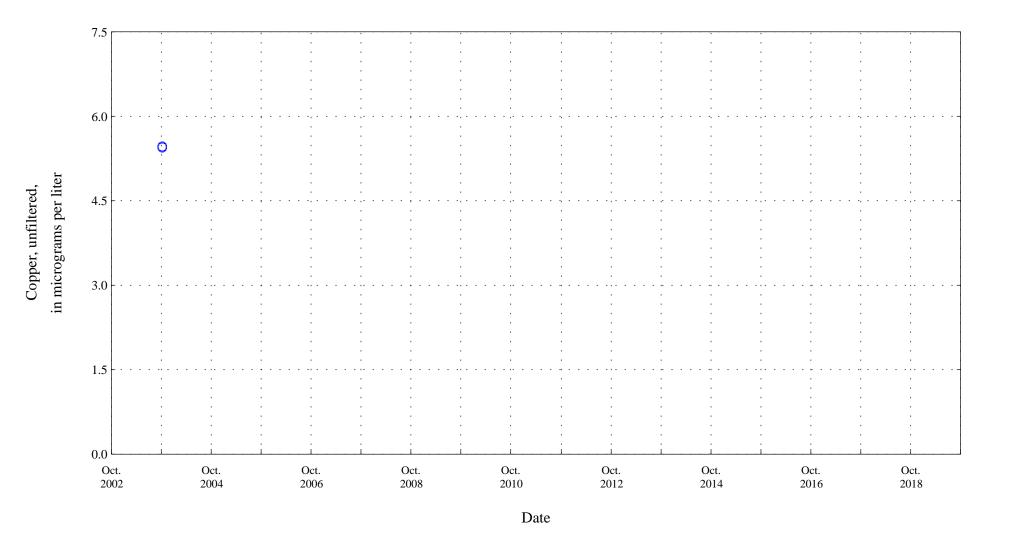






Figure 63. Distribution of selected water-quality constituents relative to time for




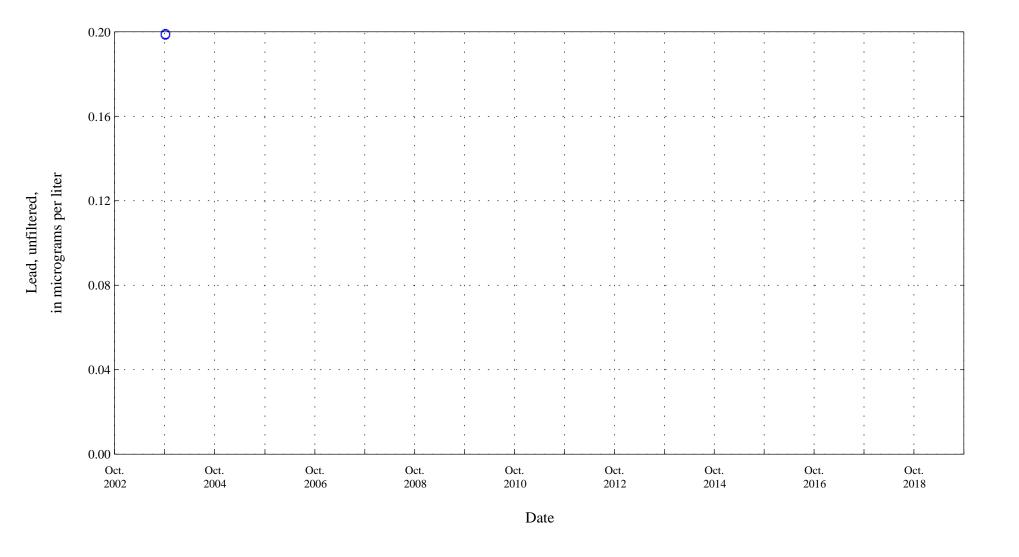

Water Supply Acute Standard 50.0



Figure 63. Distribution of selected water-quality constituents relative to time for

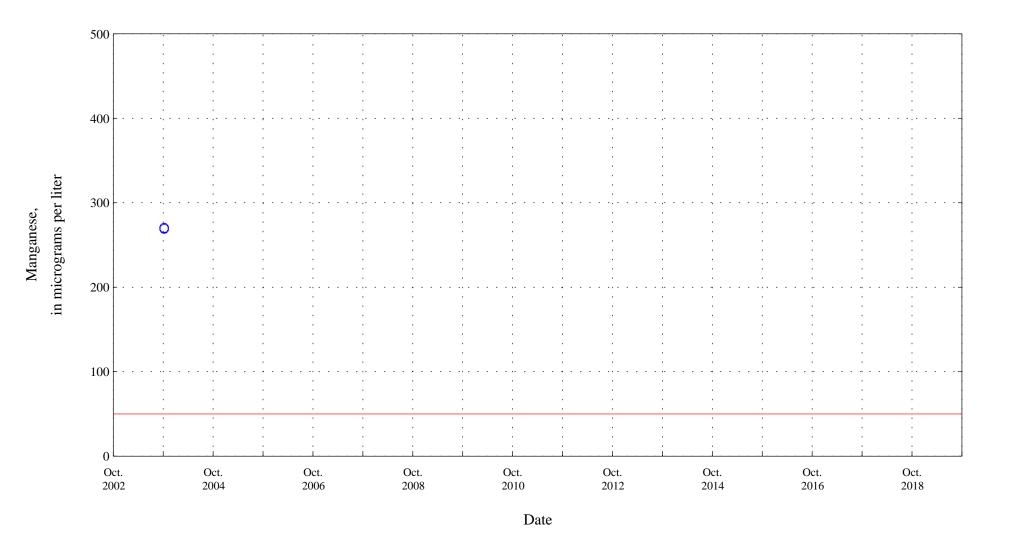






Figure 63. Distribution of selected water-quality constituents relative to time for

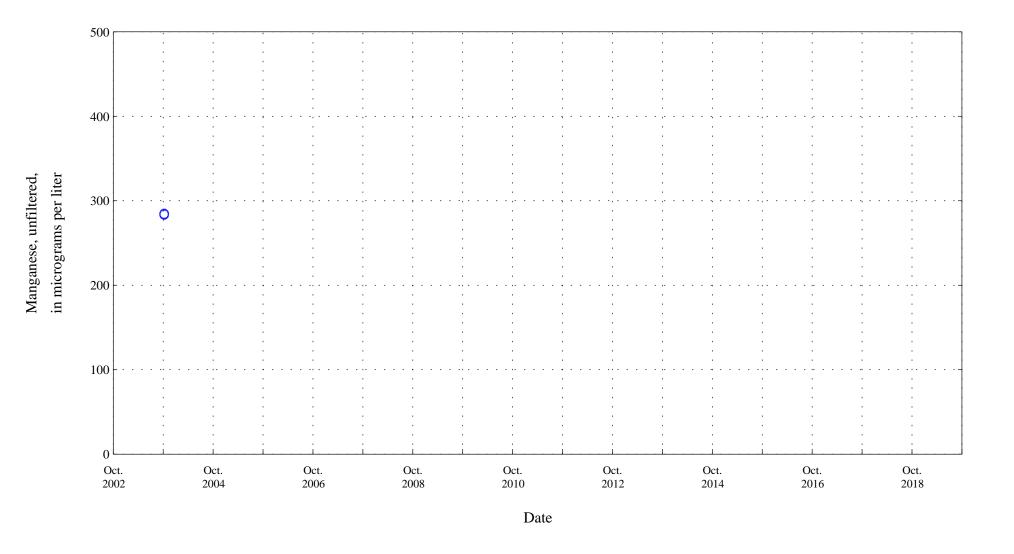






Figure 63. Distribution of selected water-quality constituents relative to time for

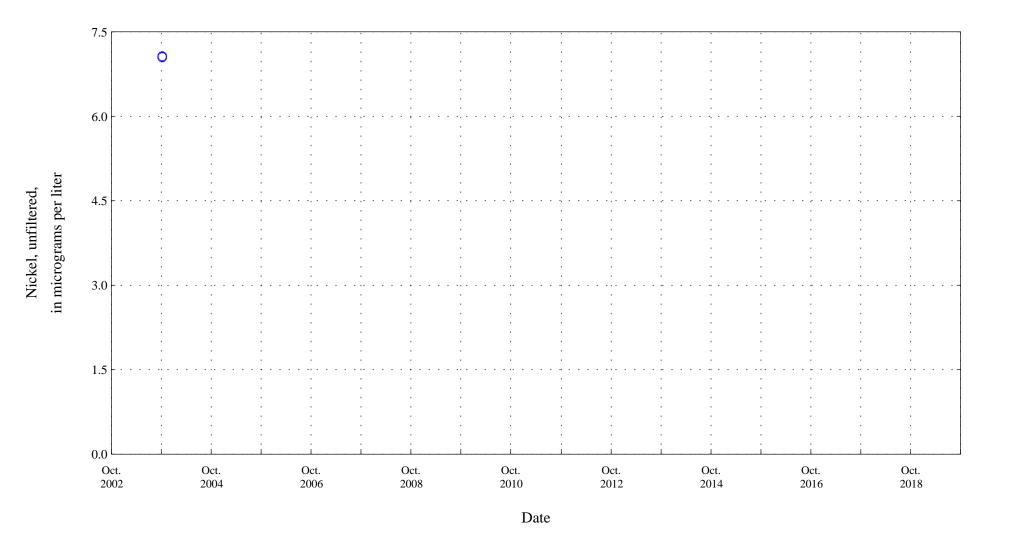








Figure 63. Distribution of selected water-quality constituents relative to time for

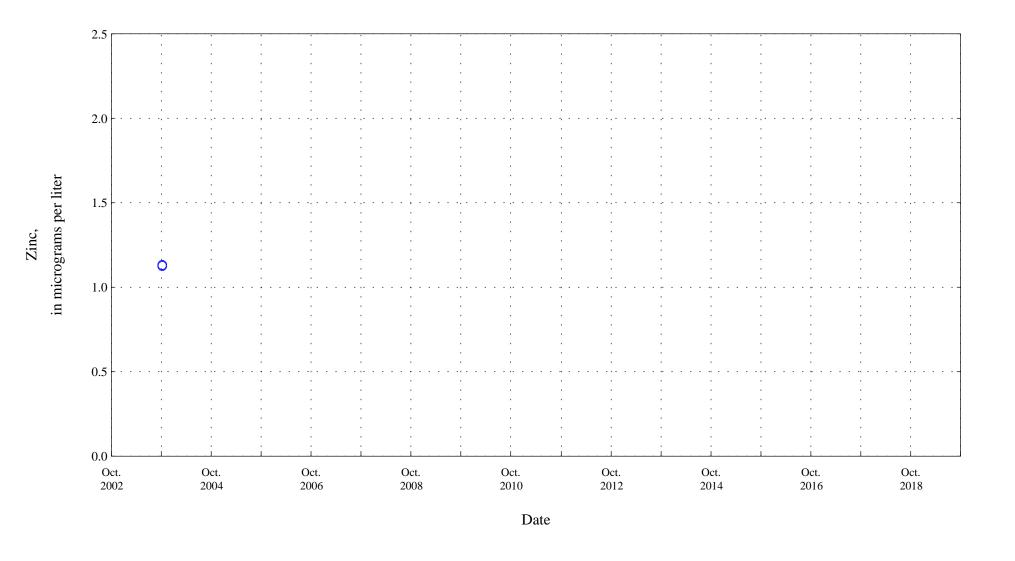








Figure 63. Distribution of selected water-quality constituents relative to time for

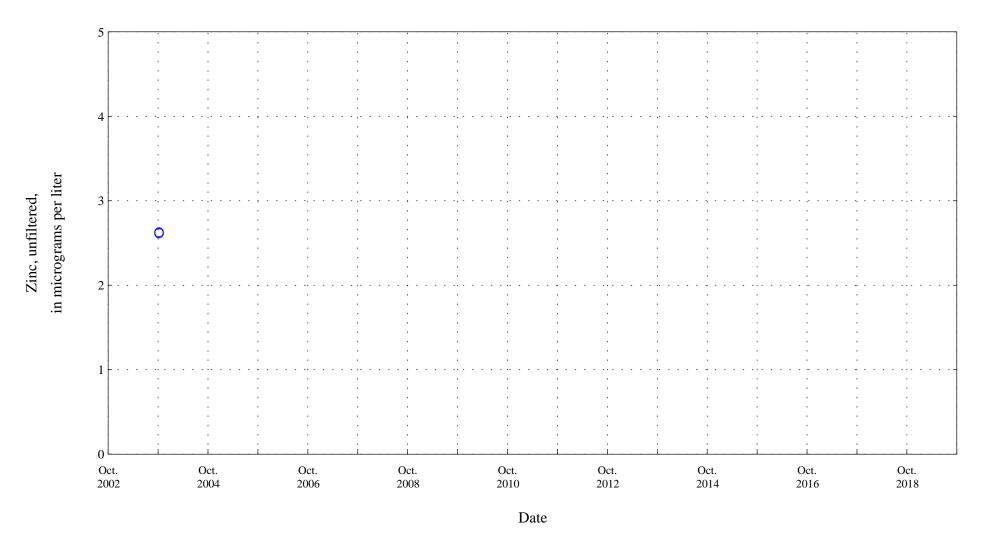






Figure 63. Distribution of selected water-quality constituents relative to time for

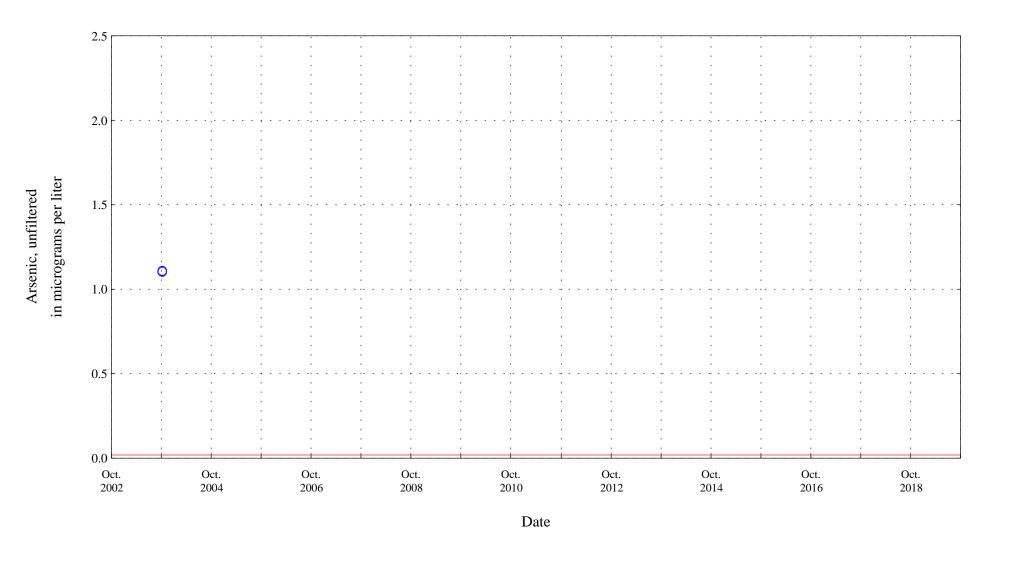








Figure 63. Distribution of selected water-quality constituents relative to time for

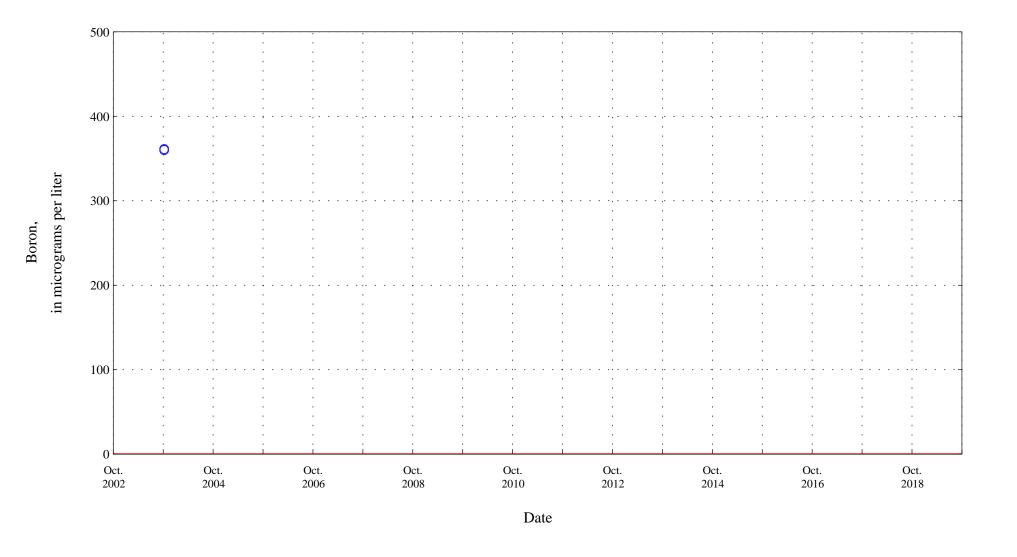








Figure 63. Distribution of selected water-quality constituents relative to time for


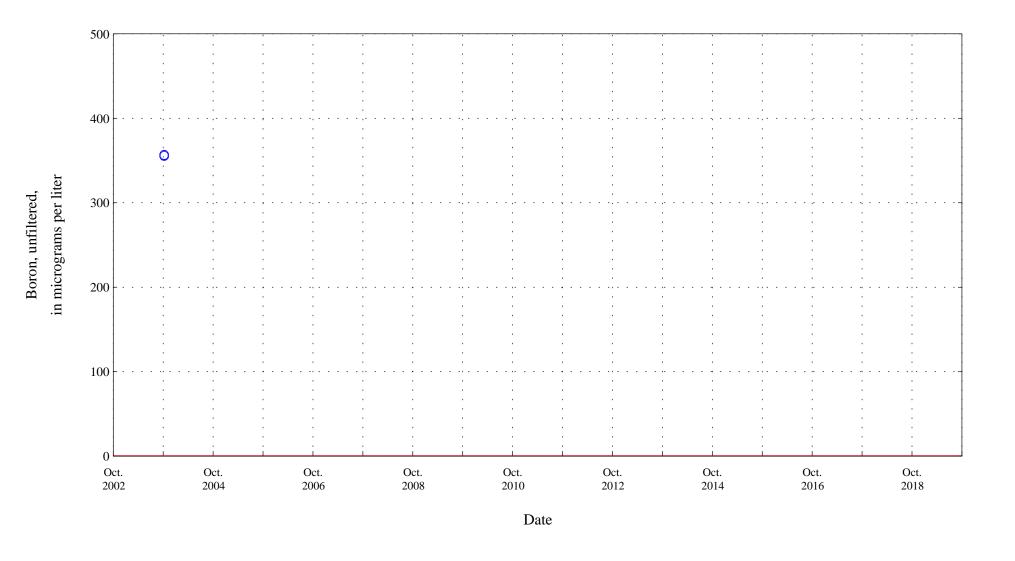









Figure 63. Distribution of selected water-quality constituents relative to time for

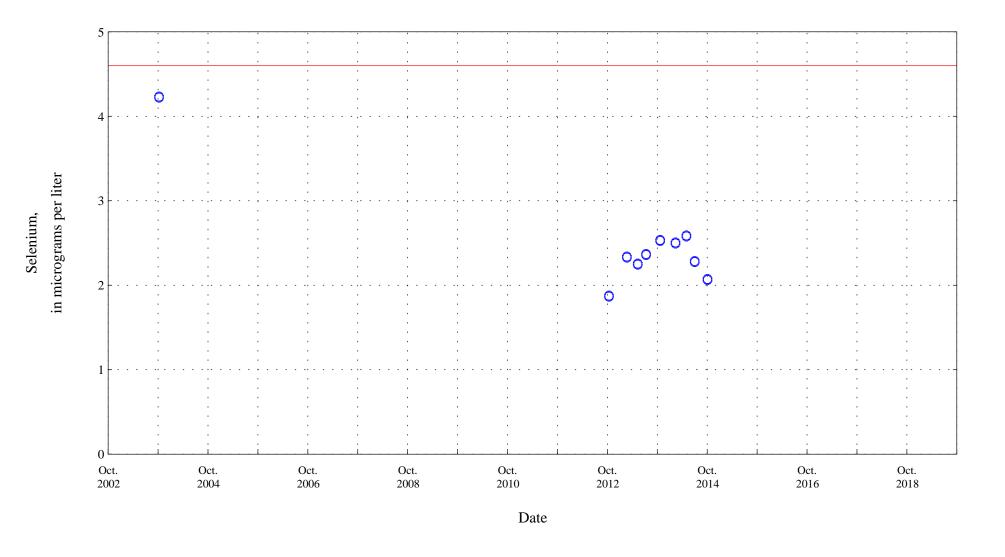







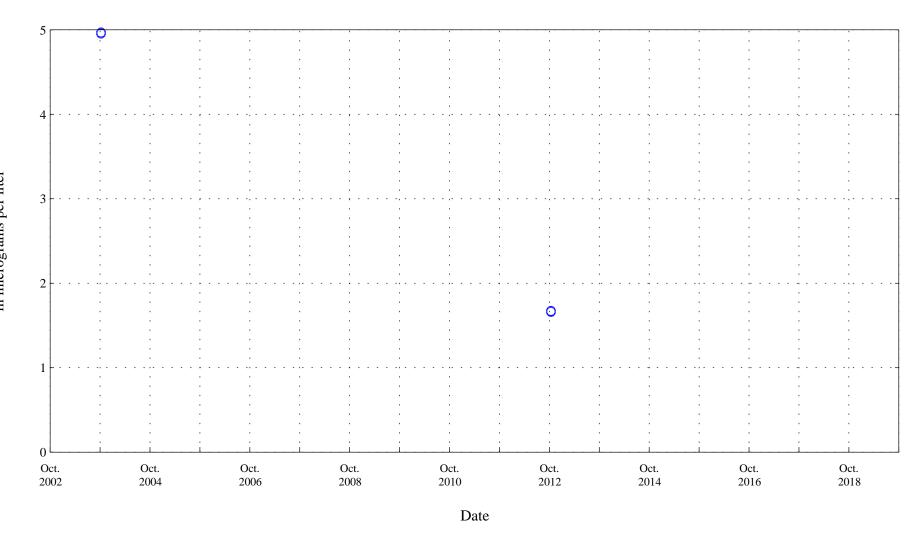





Selenium, unfiltered, in micrograms per liter

Figure 63. Distribution of selected water-quality constituents relative to time for

