Figure 13. Distribution of selected water-quality constituents relative to time for

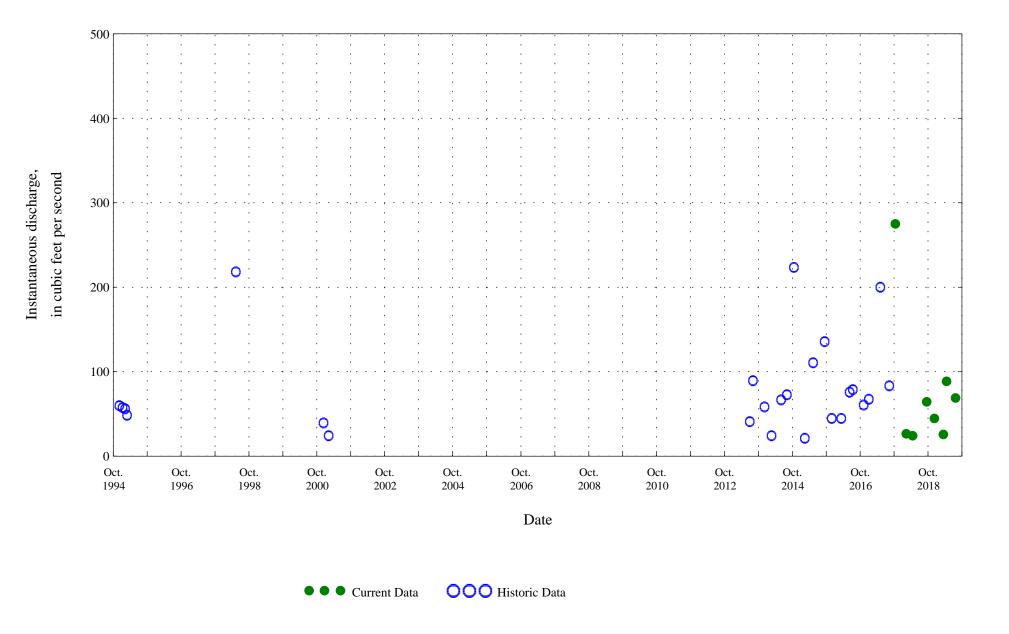




Figure 13. Distribution of selected water-quality constituents relative to time for

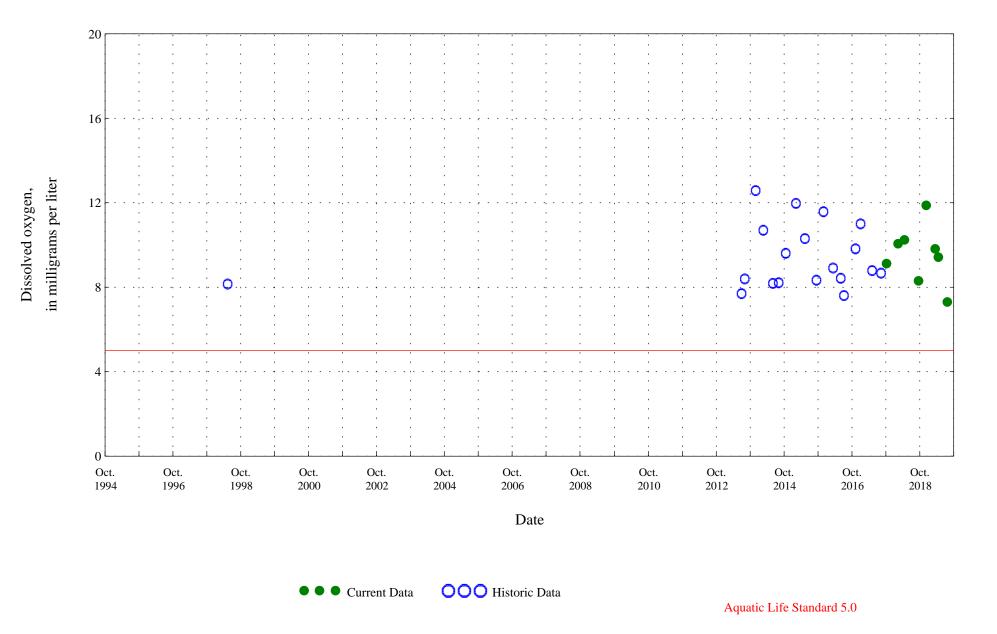





Figure 13. Distribution of selected water-quality constituents relative to time for





in standard units

Figure 13. Distribution of selected water-quality constituents relative to time for

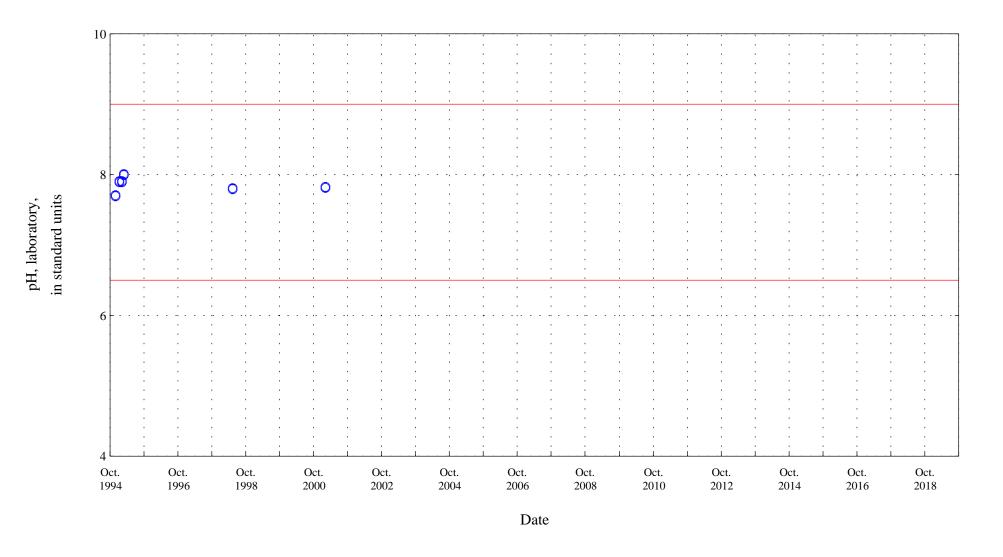







Figure 13. Distribution of selected water-quality constituents relative to time for






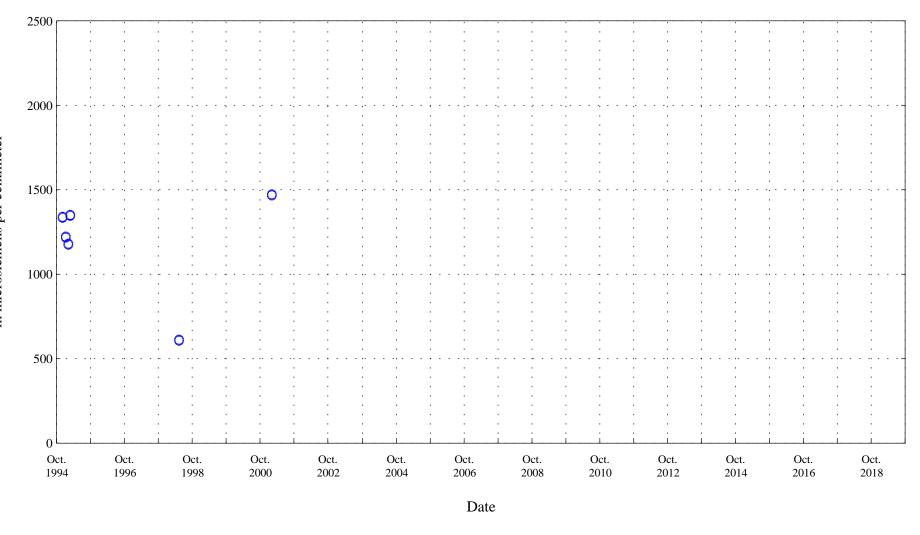

Specific conductance, laboratory, in microsiemens per centimeter


Figure 13. Distribution of selected water-quality constituents relative to time for

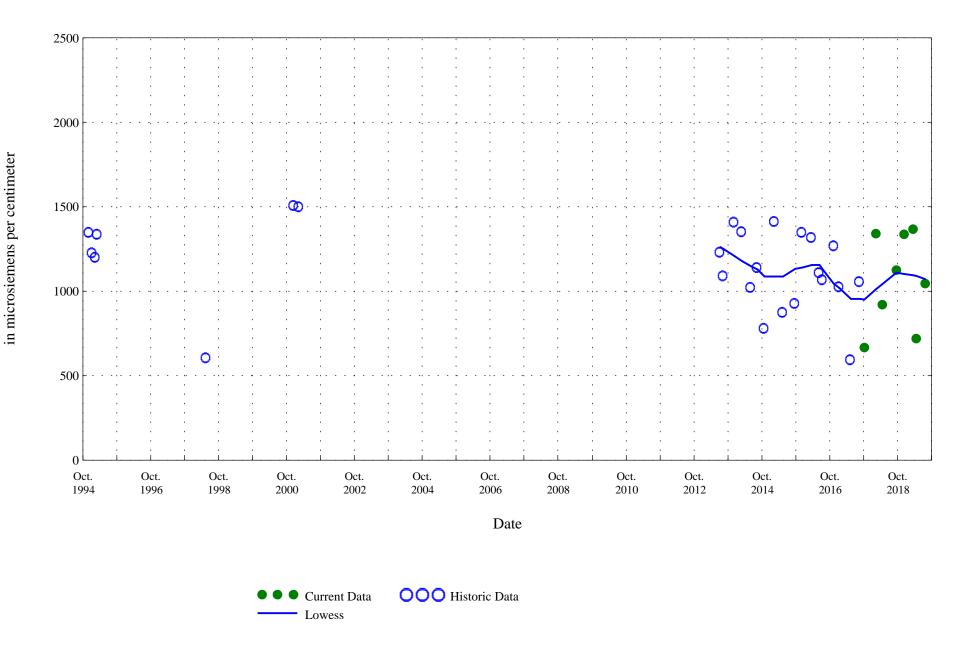



Specific conductance,

Figure 13. Distribution of selected water-quality constituents relative to time for

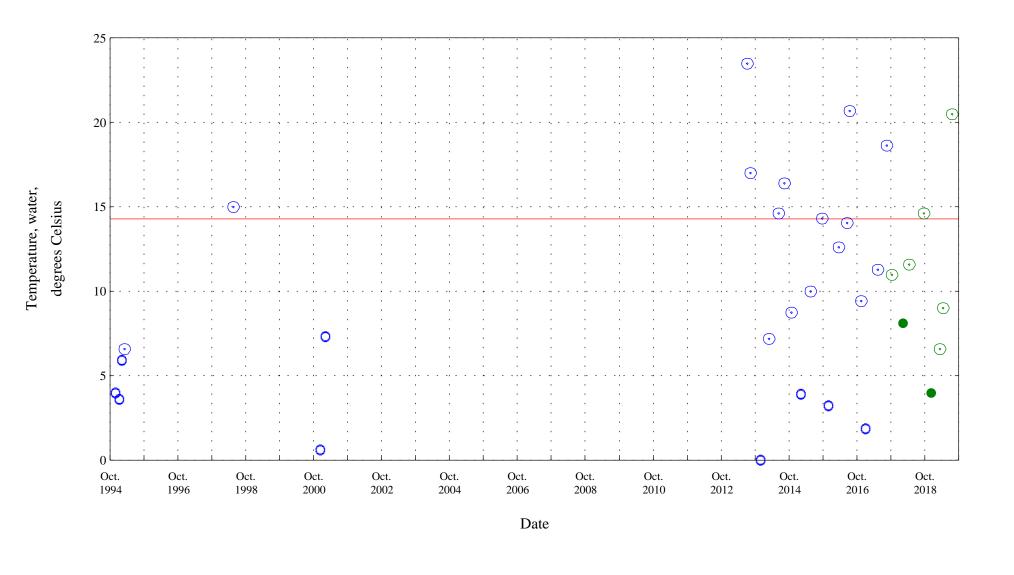

⊙ ⊙ ⊙ Current Data, Warm Season Std

⊙ ⊙ ⊙ Historic Data, Warm Season Std

Aquatic Life Dec - Feb, Cool Season Std 14.3 Aquatic Life Mar - Nov, Warm Season Std 28.6

Current Data, Cool Season Std

OOO Historic Data, Cool Season Std



Figure 13. Distribution of selected water-quality constituents relative to time for

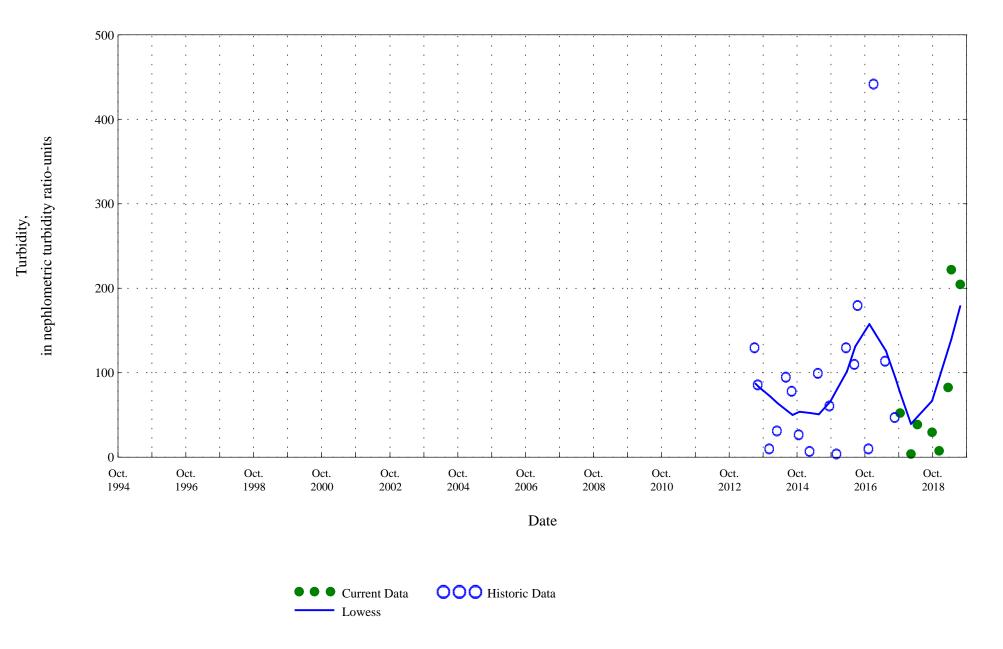




Figure 13. Distribution of selected water-quality constituents relative to time for

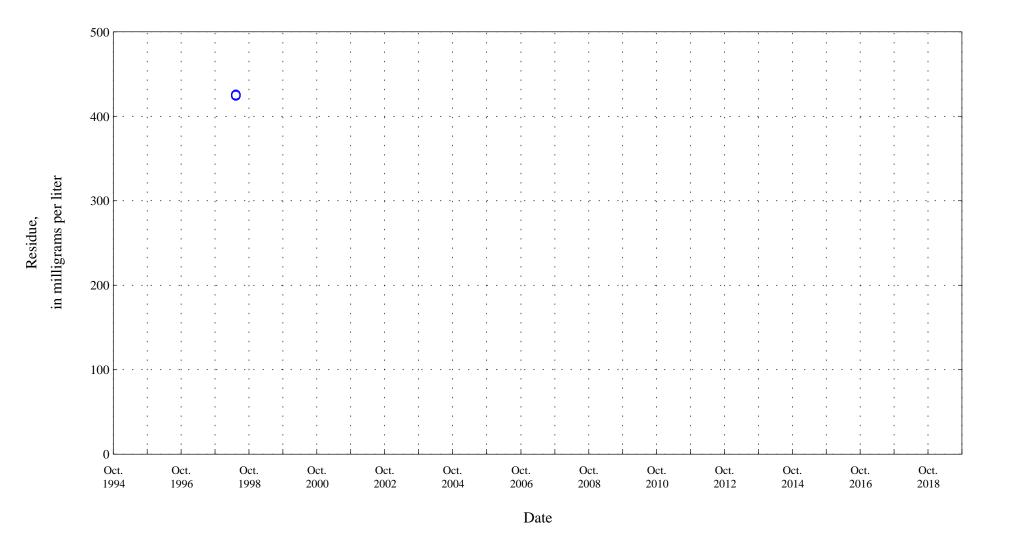






Figure 13. Distribution of selected water-quality constituents relative to time for

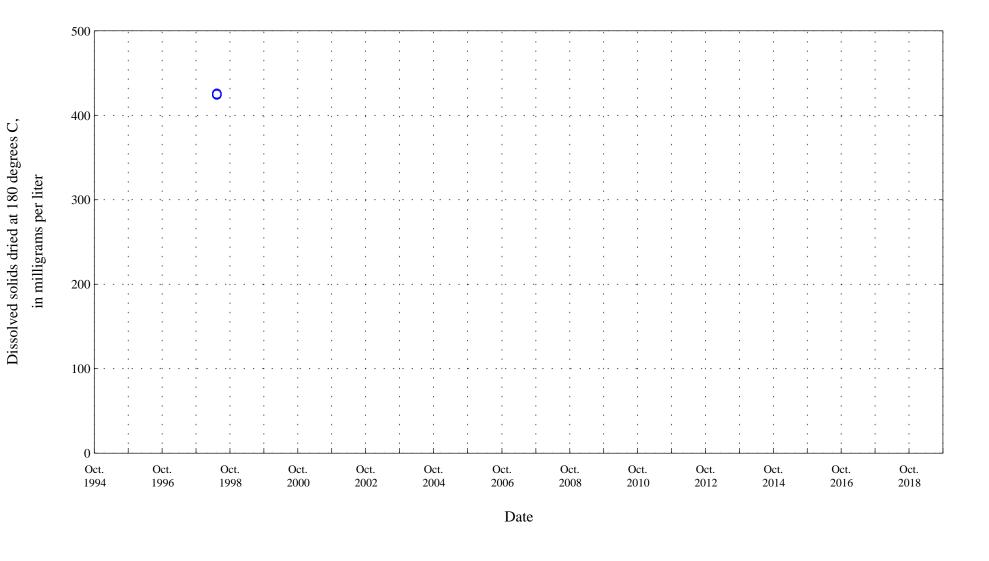






Figure 13. Distribution of selected water-quality constituents relative to time for


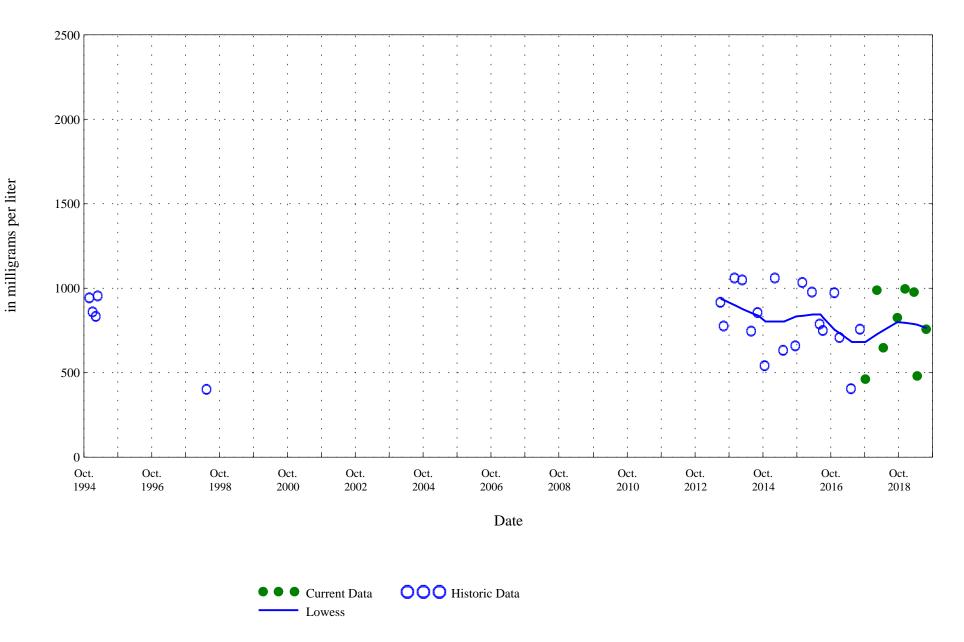





Figure 13. Distribution of selected water-quality constituents relative to time for



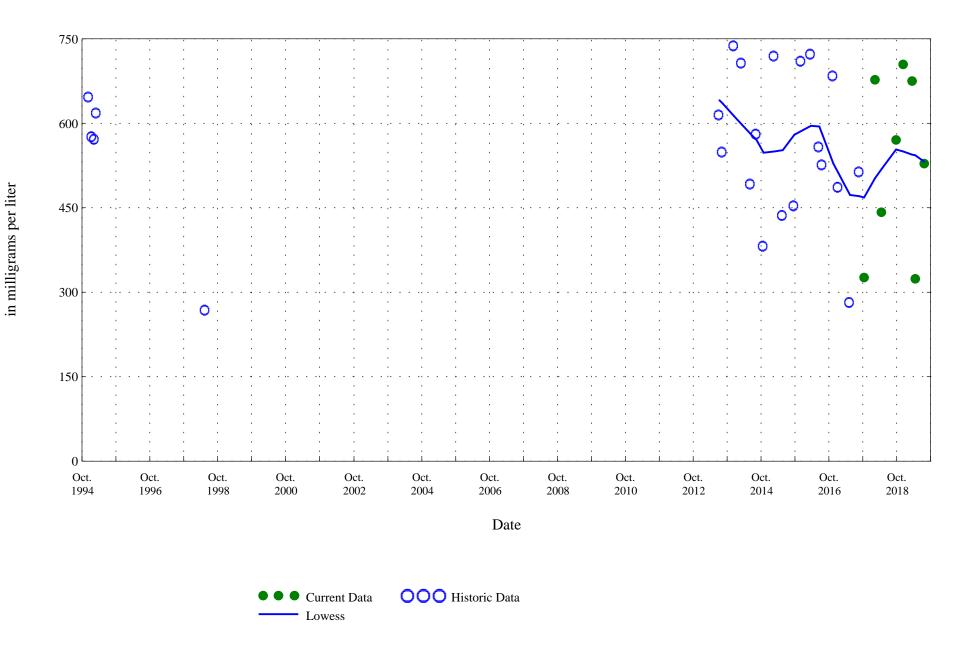

Hardness,

Figure 13. Distribution of selected water-quality constituents relative to time for

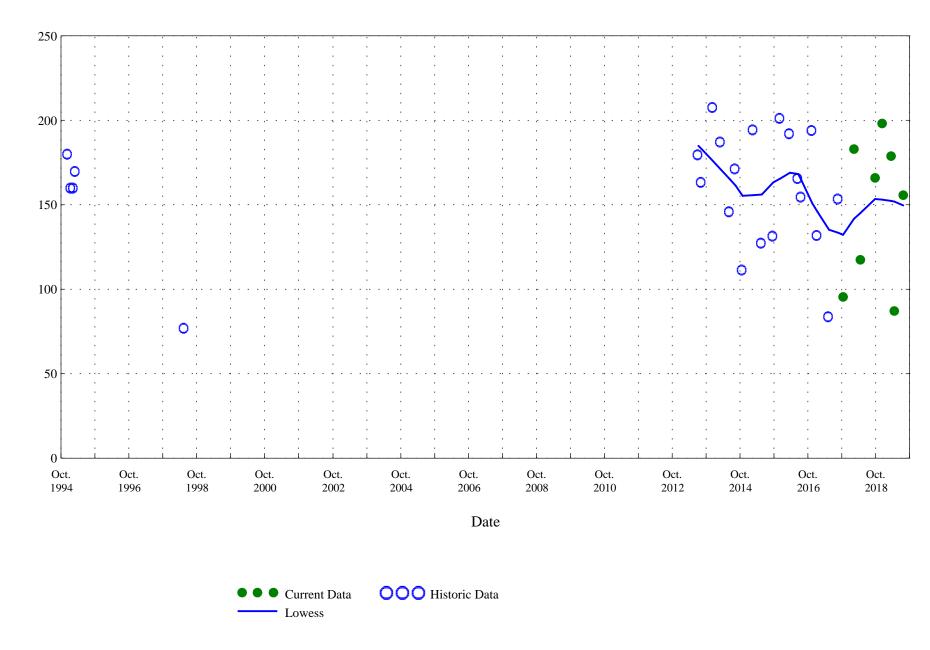




in milligrams per liter

Calcium,


Figure 13. Distribution of selected water-quality constituents relative to time for

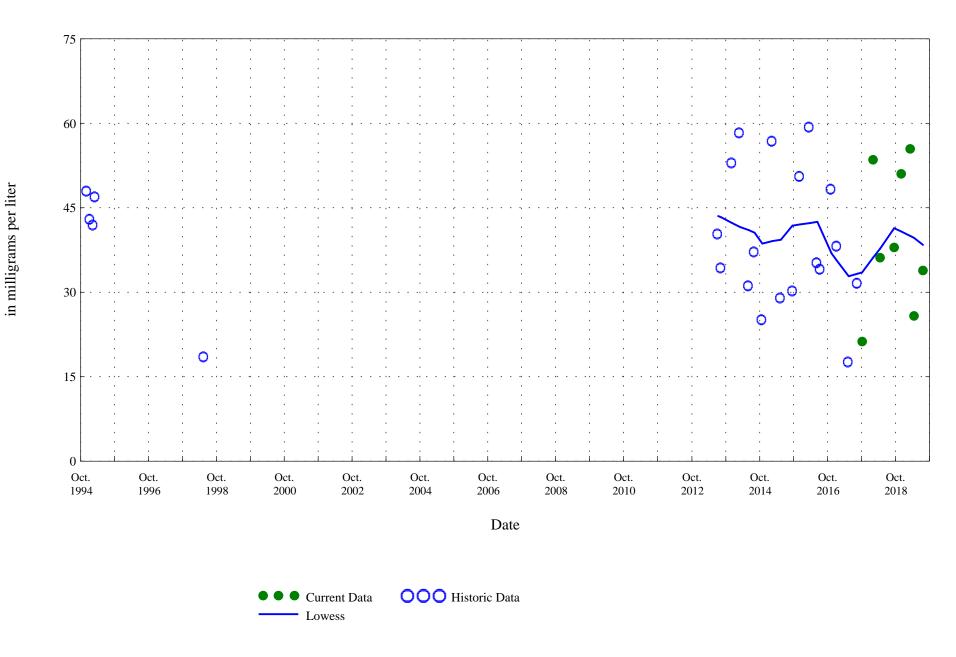



Magnesium,

Figure 13. Distribution of selected water-quality constituents relative to time for

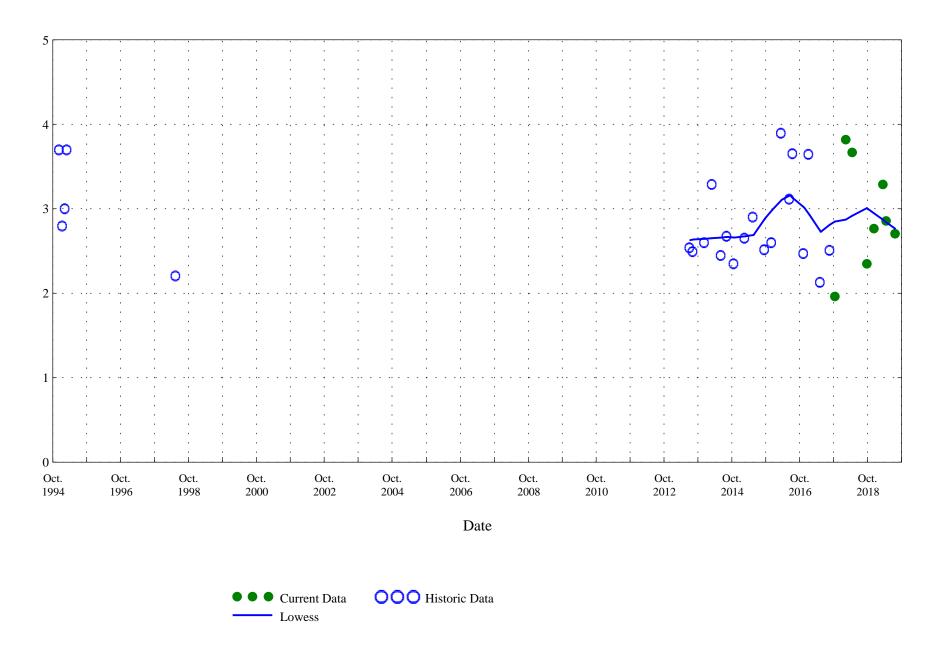




in milligrams per liter

Potassium,

Figure 13. Distribution of selected water-quality constituents relative to time for

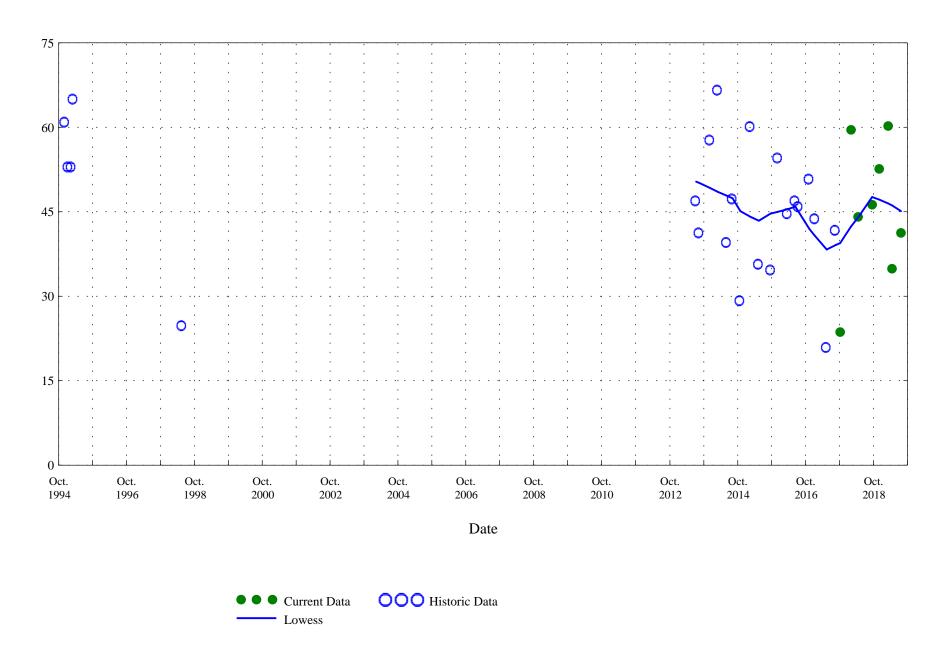



in milligrams per liter

Sodium,

Figure 13. Distribution of selected water-quality constituents relative to time for

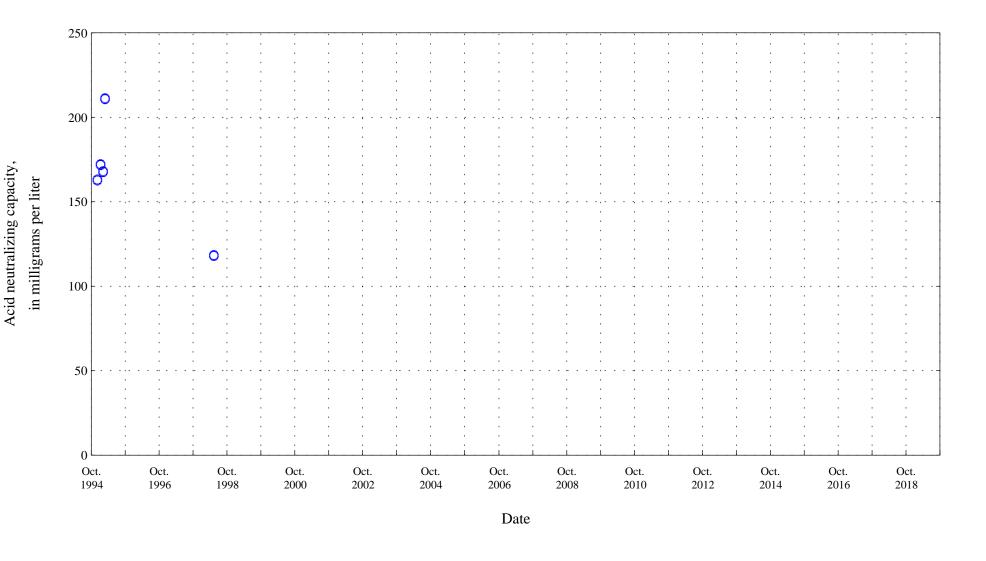






Figure 13. Distribution of selected water-quality constituents relative to time for

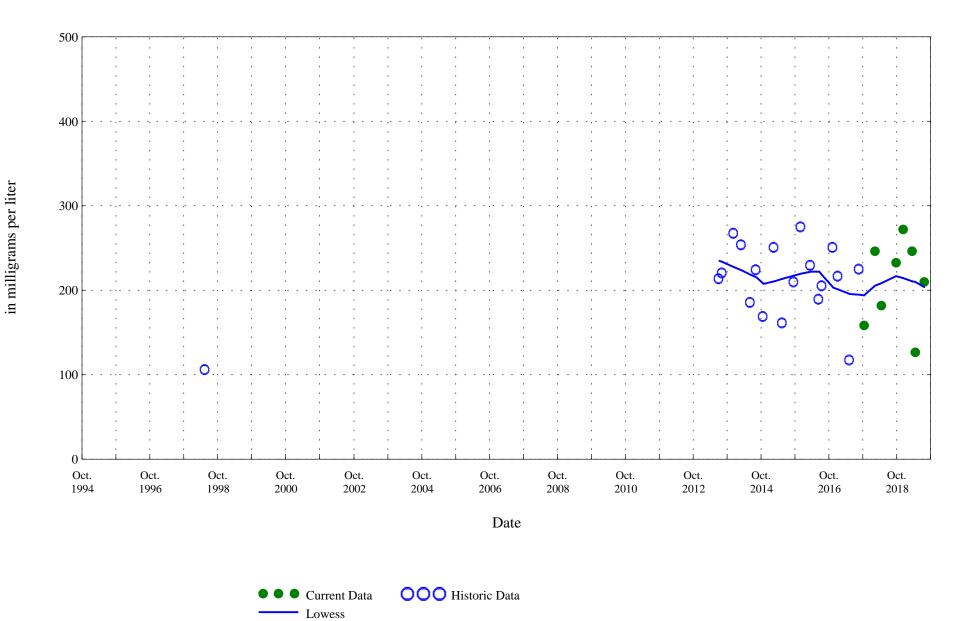




Figure 13. Distribution of selected water-quality constituents relative to time for


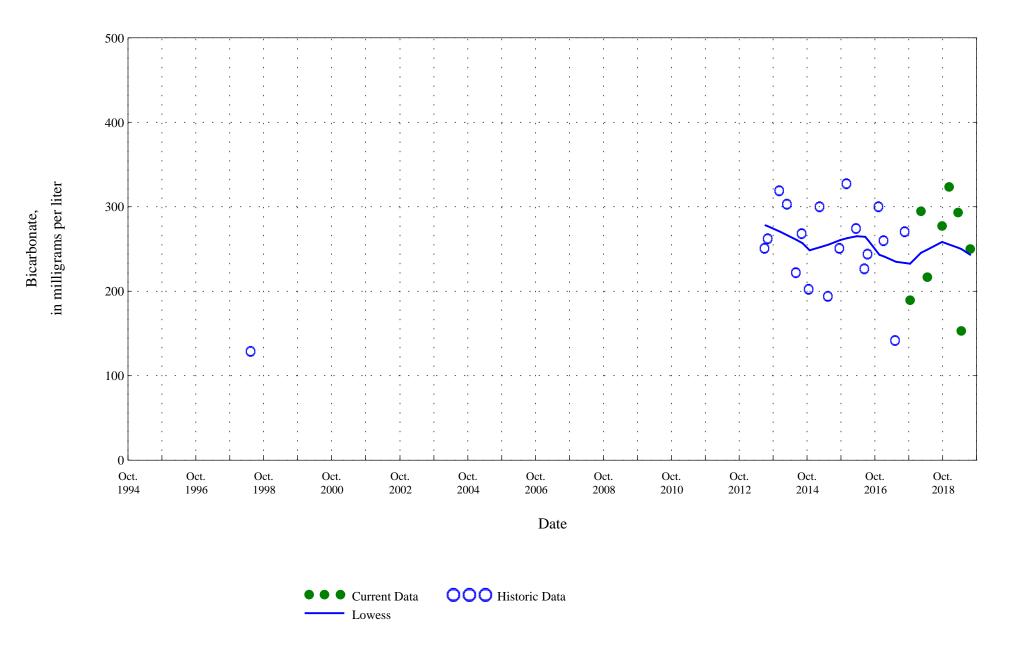





Figure 13. Distribution of selected water-quality constituents relative to time for



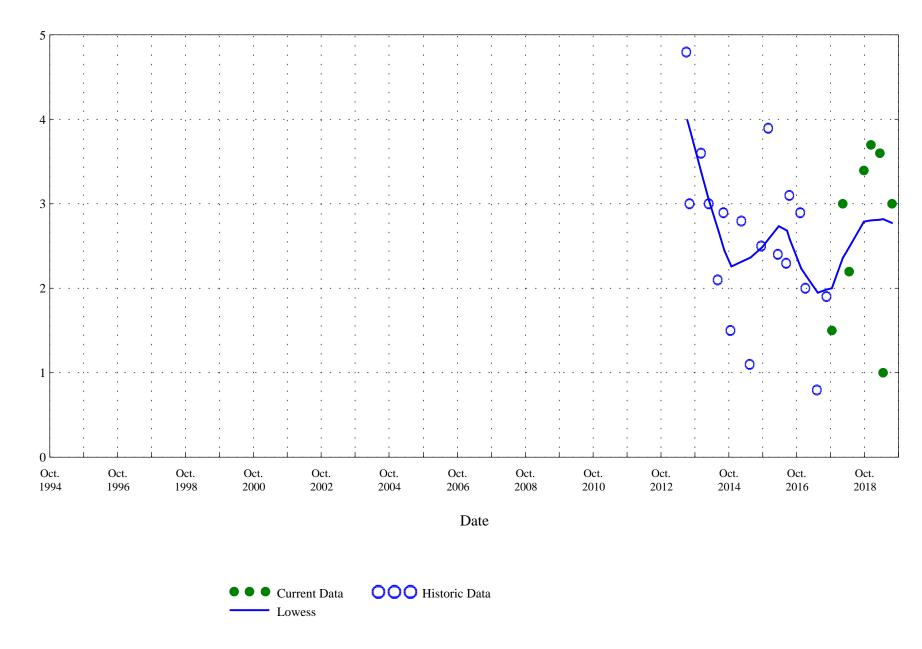

Carbonate, in milligrams per liter


Figure 13. Distribution of selected water-quality constituents relative to time for

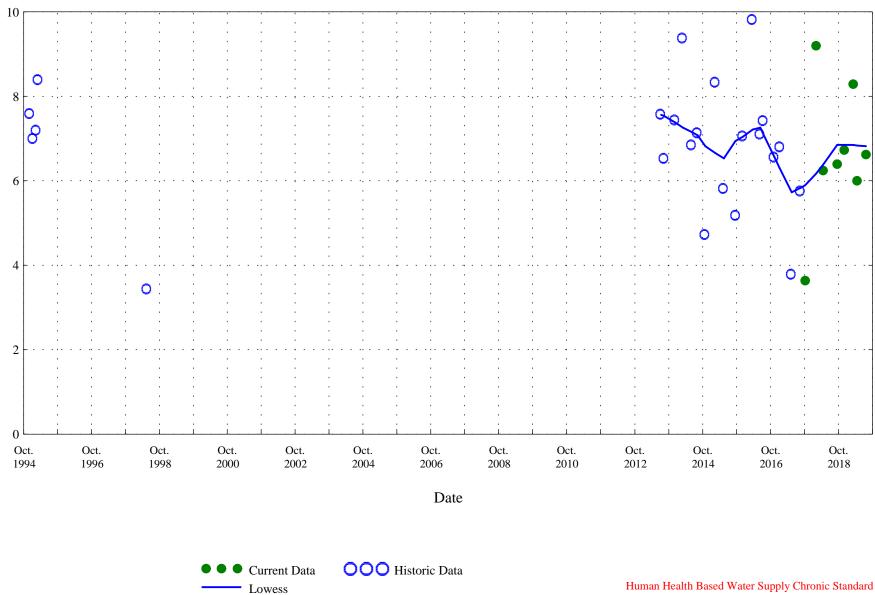



in milligrams per liter Chloride,


Figure 13. Distribution of selected water-quality constituents relative to time for

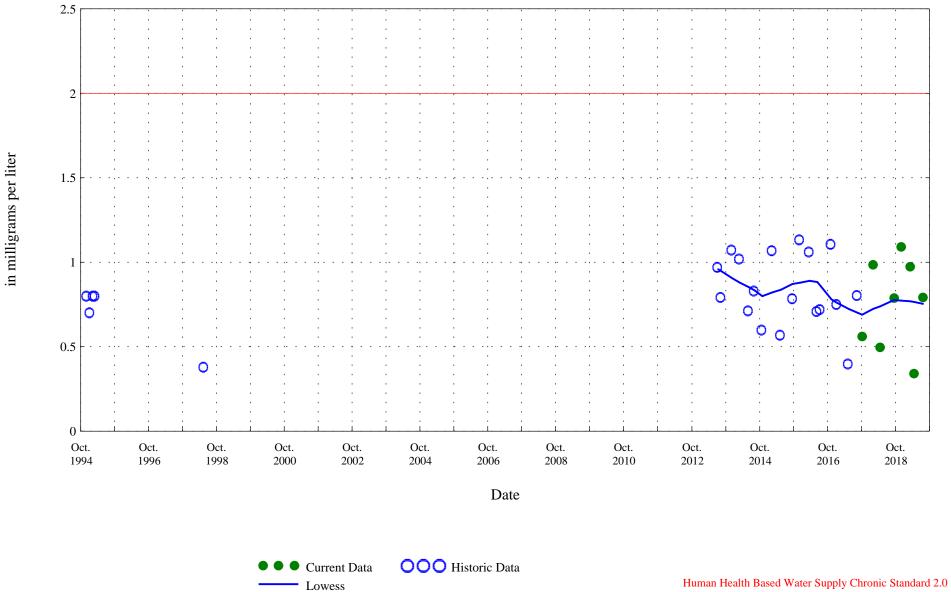



Fluoride


Figure 13. Distribution of selected water-quality constituents relative to time for

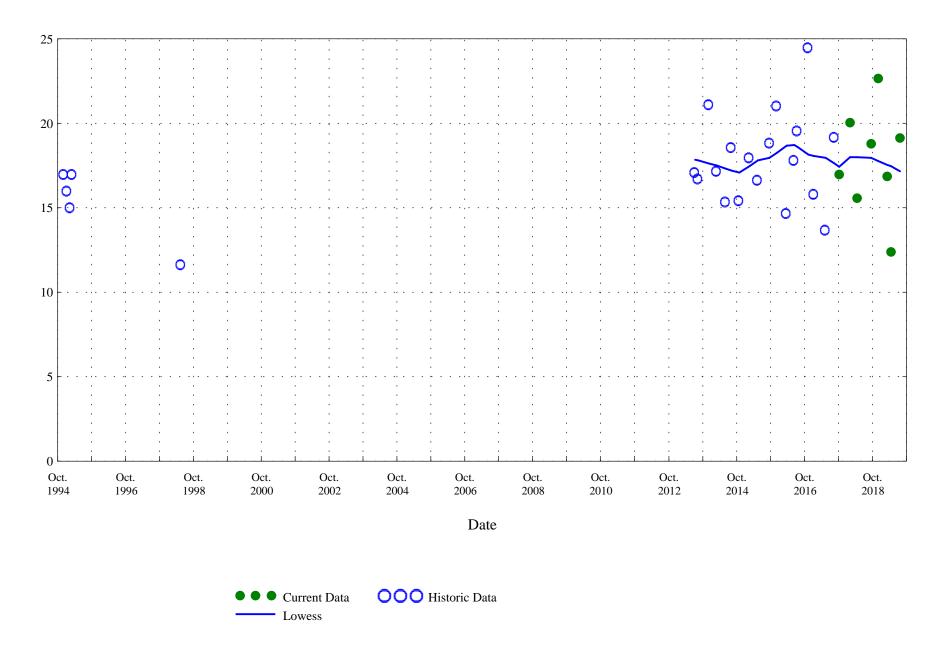



in milligrams per liter

Figure 13. Distribution of selected water-quality constituents relative to time for

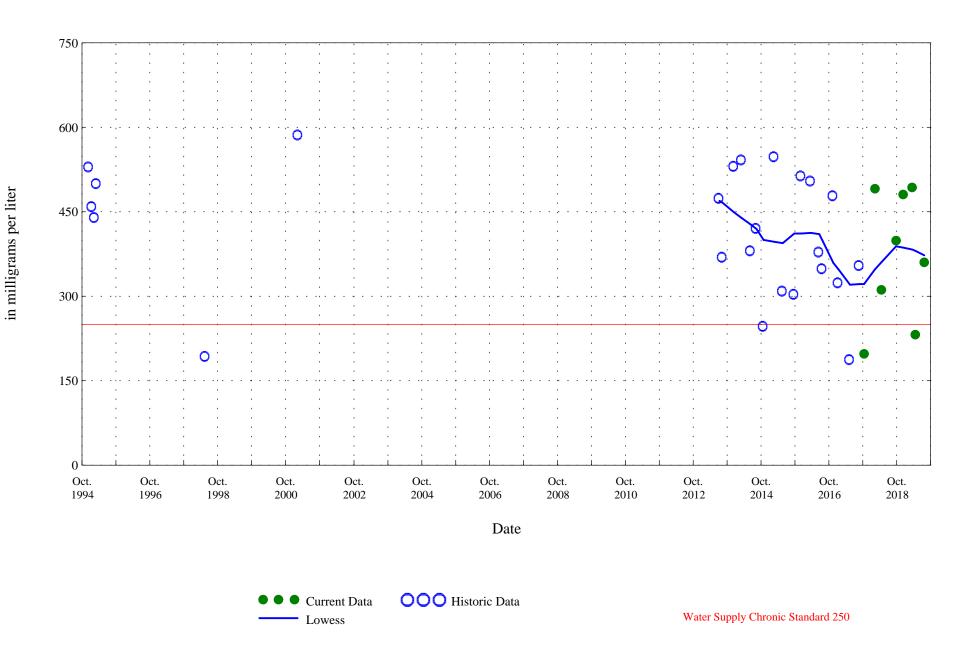



Sulfate,

Figure 13. Distribution of selected water-quality constituents relative to time for

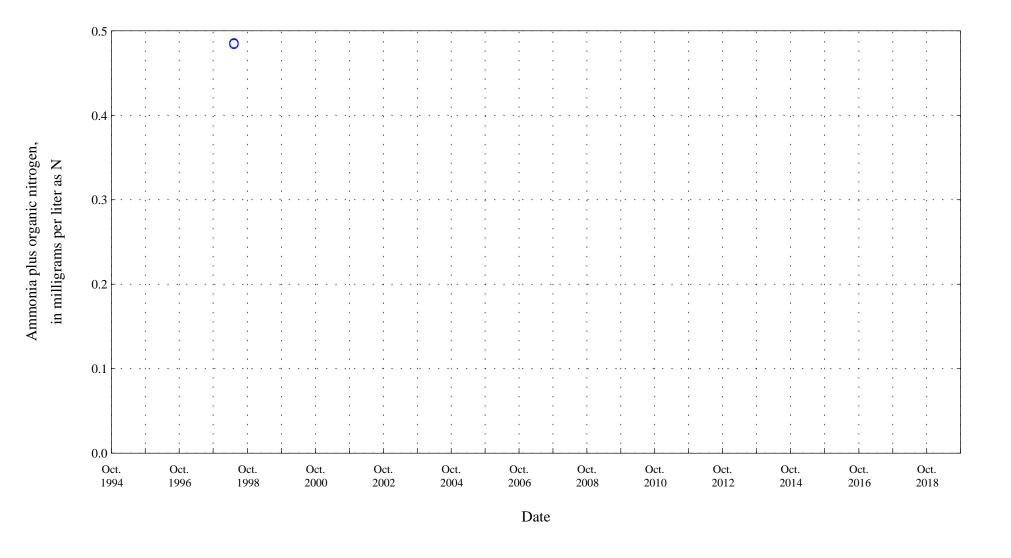






Figure 13. Distribution of selected water-quality constituents relative to time for



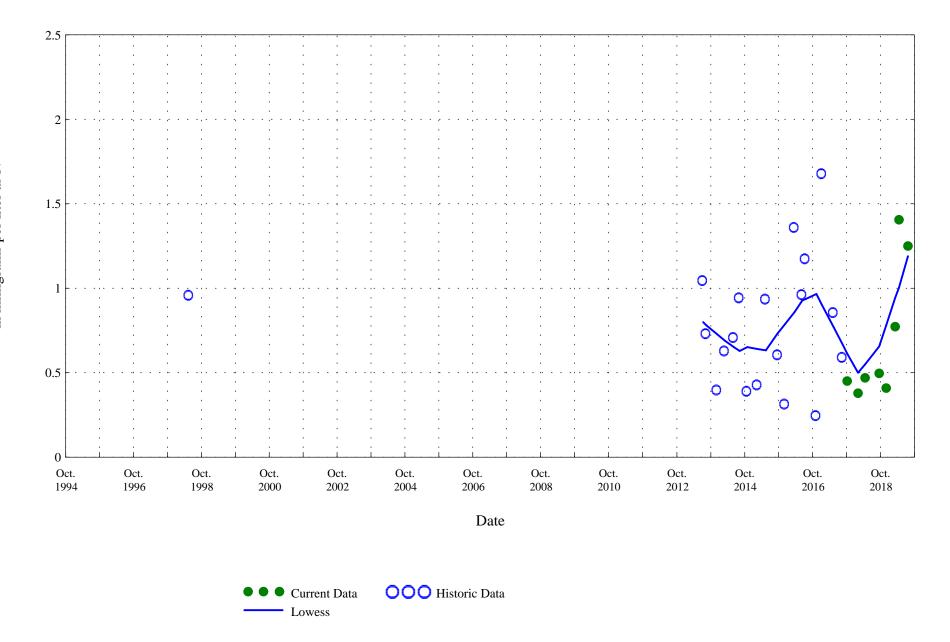




Figure 13. Distribution of selected water-quality constituents relative to time for



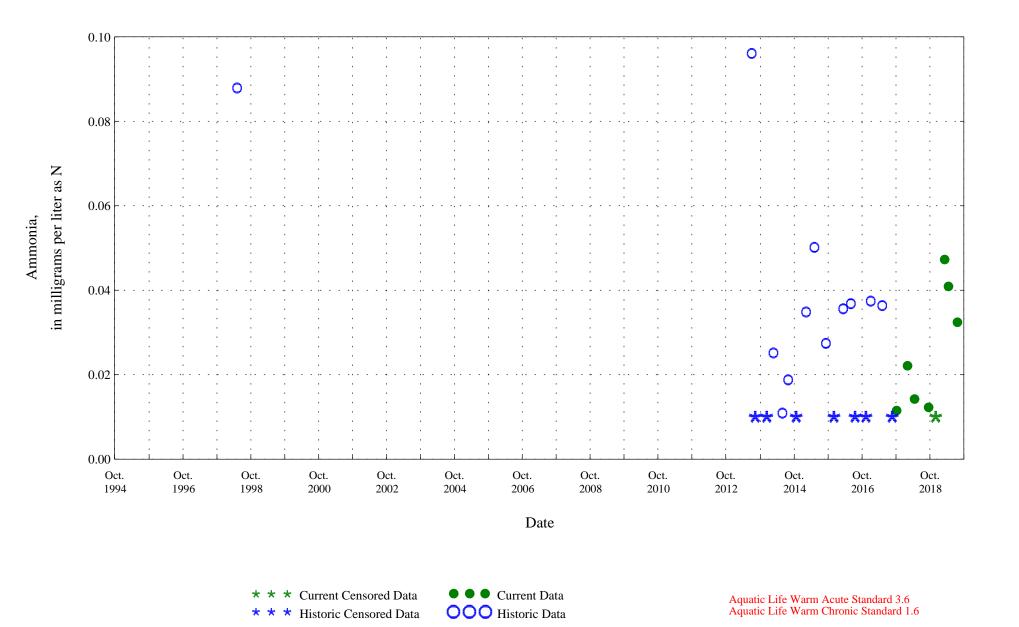

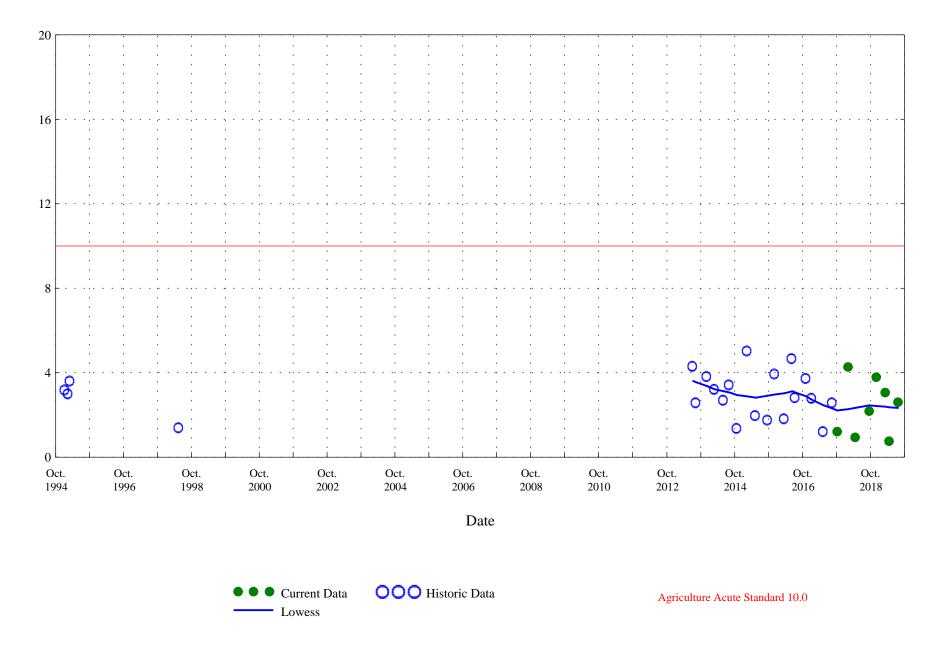



Nitrite plus nitrate in milligrams per liter as N

Figure 13. Distribution of selected water-quality constituents relative to time for

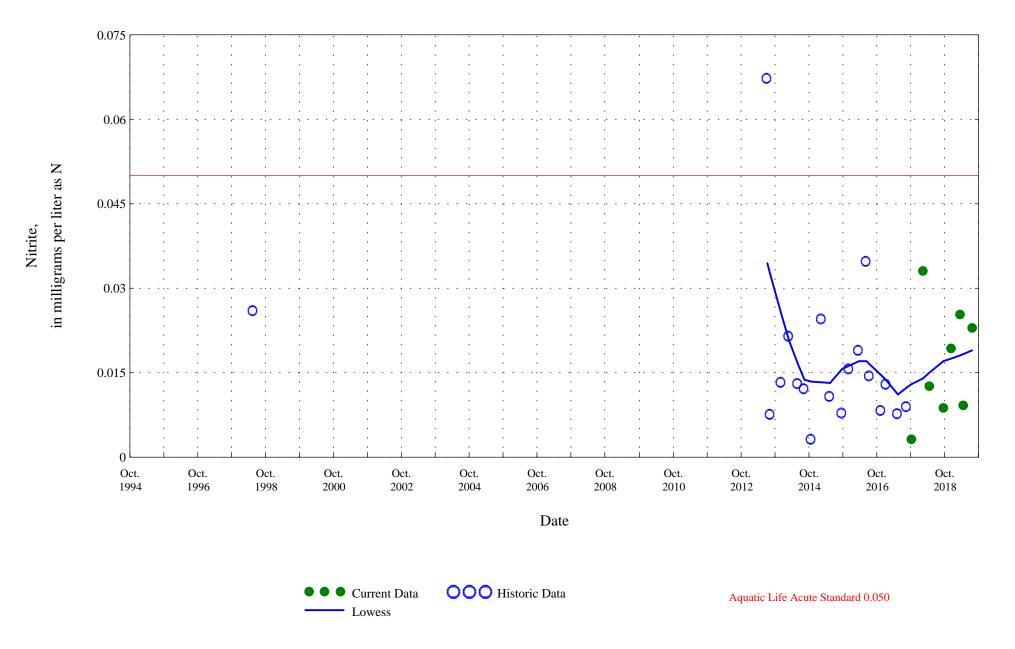




Figure 13. Distribution of selected water-quality constituents relative to time for

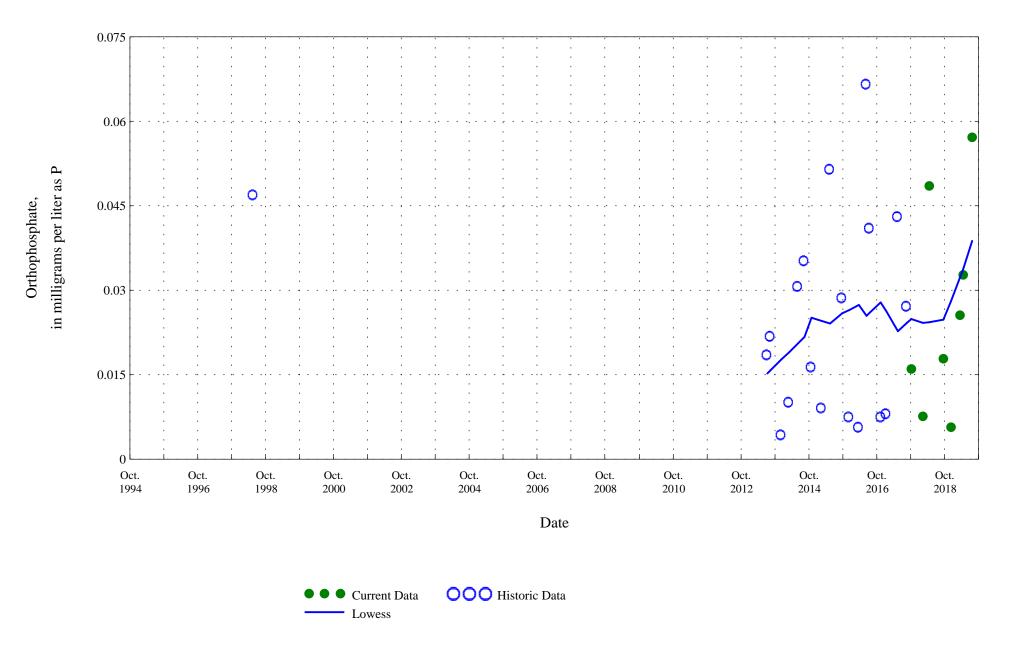




Figure 13. Distribution of selected water-quality constituents relative to time for


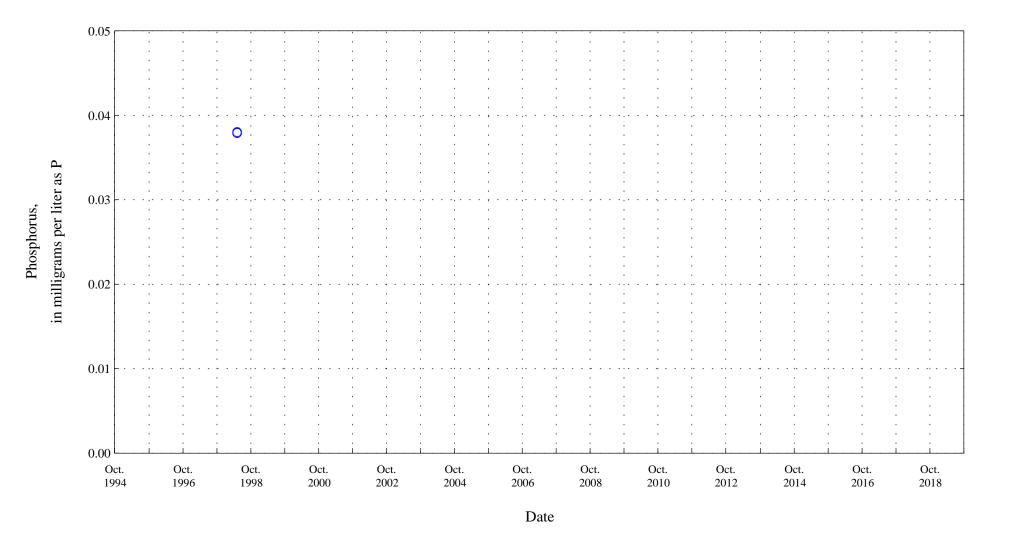






Figure 13. Distribution of selected water-quality constituents relative to time for



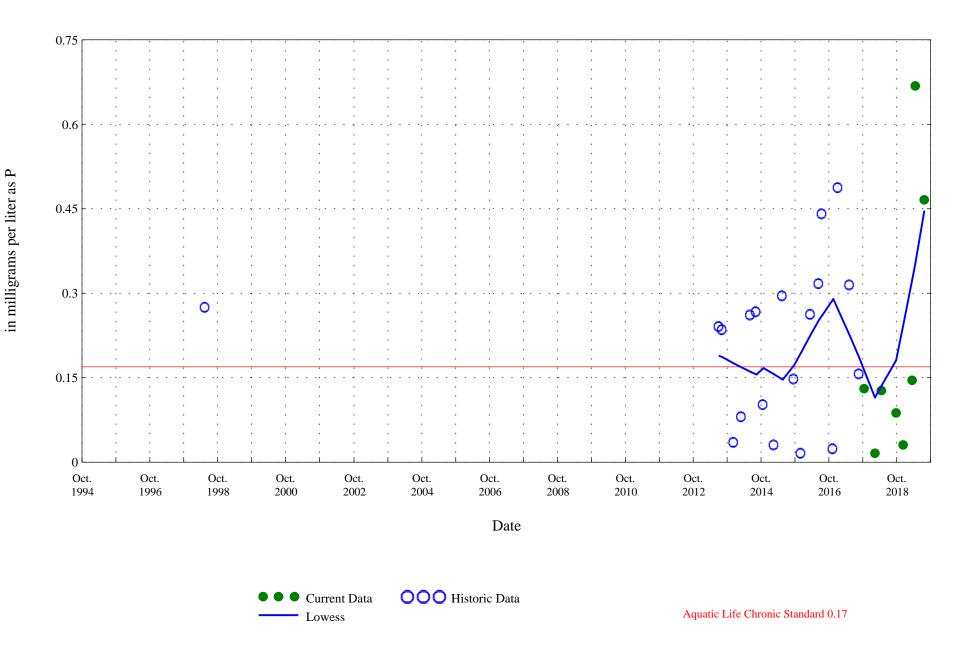

Phosphorus (total),

Figure 13. Distribution of selected water-quality constituents relative to time for

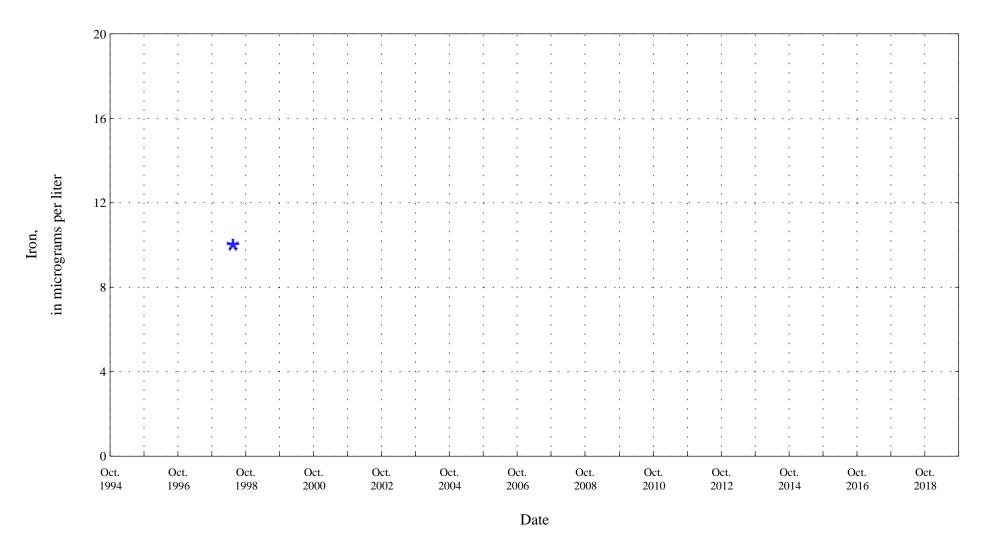






Figure 13. Distribution of selected water-quality constituents relative to time for


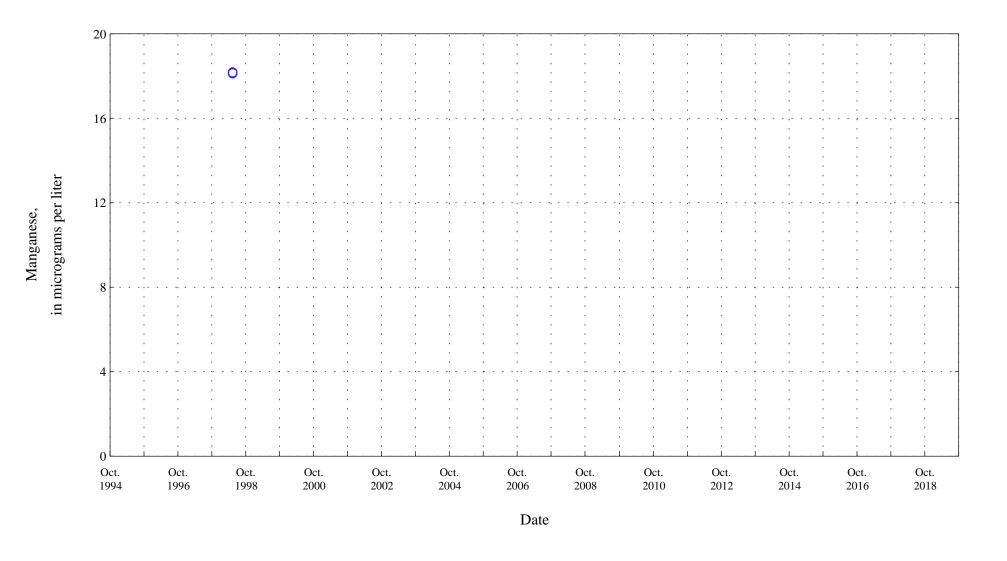








Figure 13. Distribution of selected water-quality constituents relative to time for

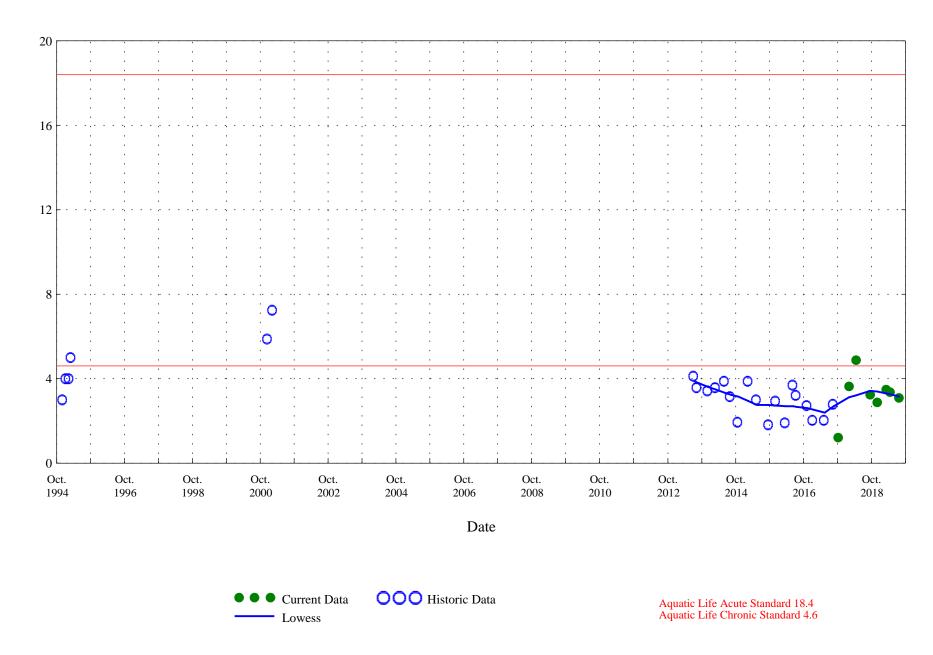



Selenium, in micrograms per liter

Figure 13. Distribution of selected water-quality constituents relative to time for

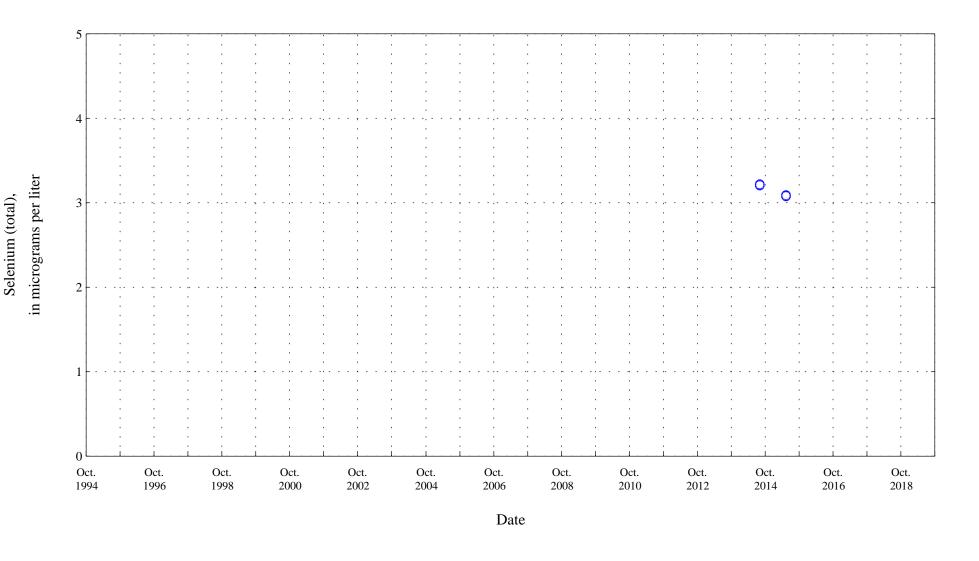






Figure 13. Distribution of selected water-quality constituents relative to time for

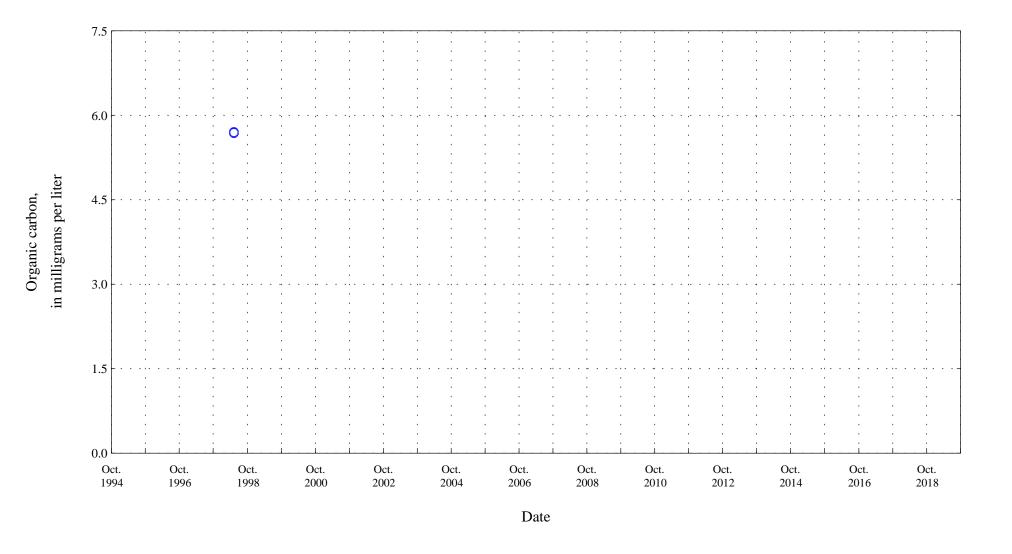






Figure 13. Distribution of selected water-quality constituents relative to time for

